




EQUIPMENT CLEARANCE APPLICATION

- Padmount equipment shall have adequate clearance on all sides from obstructions to allow maintenance and replacement of padmount equipment.
 - Obstructions include fences, buildings, light posts, trees, landscaping, sheds, etc.
- Minimum three feet (3') of clearance shall be maintained from all non-door sides.
- Minimum four feet (4') of clearance shall be maintained from all door sides to accommodate door swing.
- Minimum eight feet (8') of clearance shall be maintained from all door sides for the width of the foundation to provide safe working zone for hotsticking.

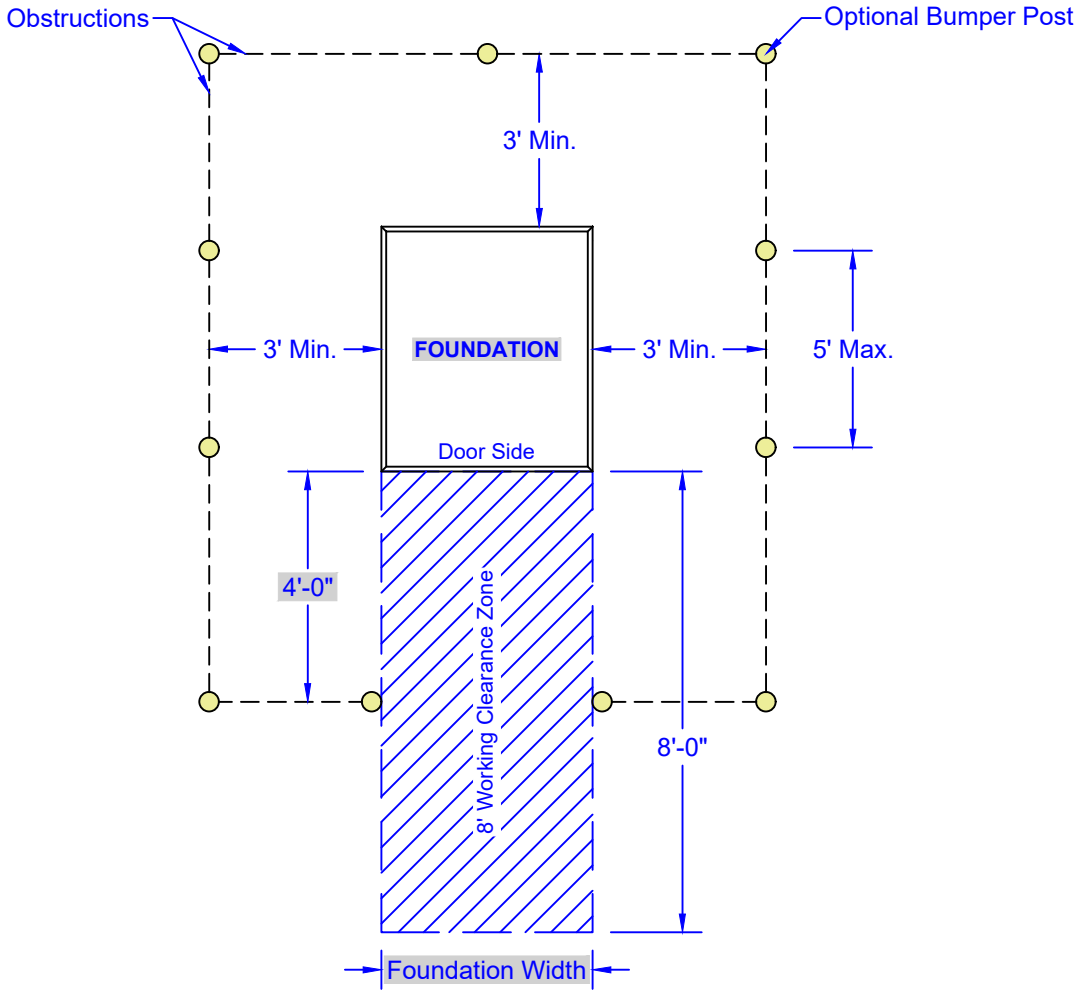

BUMPER POST APPLICATION

- Bumper posts are installed when protection is needed for a piece of padmount equipment.
- If bumper posts are required, they shall meet the same requirements as obstructions.
- Bumper posts shall be spaced no more than five feet (5') apart.

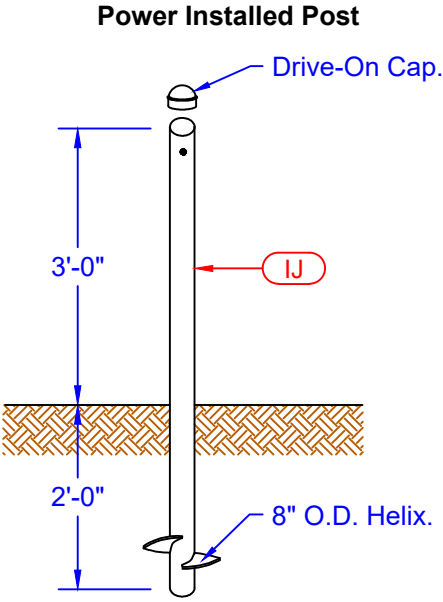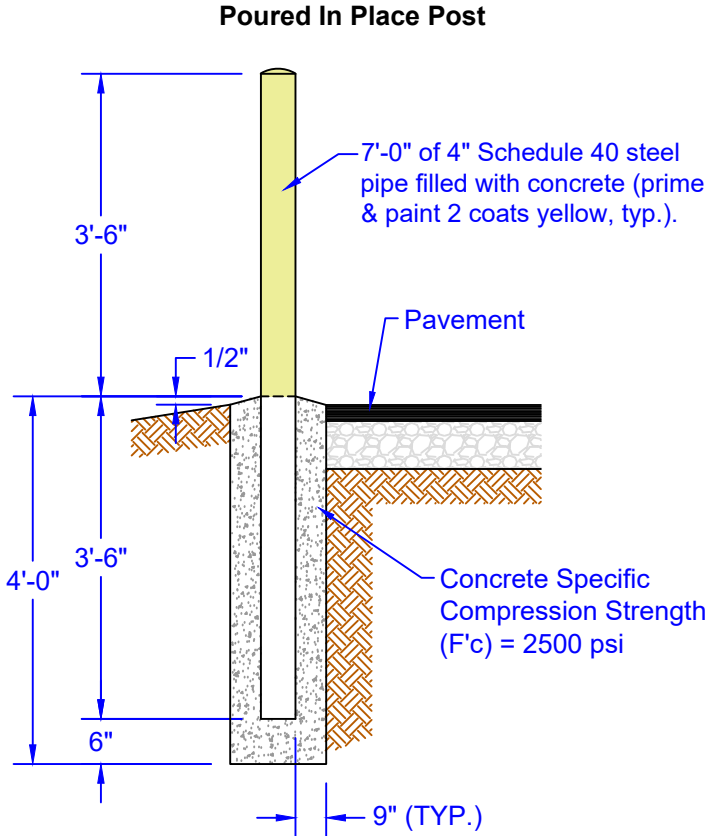

11007420

REQUIRED MATERIAL

FIG MARK	STANDARD MATERIAL DESCRIPTION	STANDARD	ITEM #	11007420
IJ	Pole, Steel, Post Bump Power, 3-1/2" X 5';	M 53-592	577223	1