

DRAFT



We exist to deliver safe, reliable energy that drives value to our customers

2024 NIPSCO INTEGRATED RESOURCE PLAN

First Stakeholder Advisory Meeting

April 23, 2024

9 A.M.-2 P.M. CT



Fair Oaks Farms



LOCATION OF
NEAREST EXIT

NEAREST PLACE TO
SEEK SHELTER

IN AN EMERGENCY,
WHO WILL DIAL 911

WHO WILL DIRECT THE
EMERGENCY RESPONDER

LOCATION OF THE
**AUTOMATED EXTERNAL
DEFIBRILLATOR (AED)**

WHO CAN
PERFORM CPR

OTHER **POTENTIAL HAZARDS**

Fire: Exit out any door that is furthest away from the fire. Gather as a group in the front parking lot – near the Tesla chargers.

Shelter: Restrooms, Jasper Ballroom (if closed), Employee Banquet Hallway.

AED Location: On the wall in the Employee Banquet Hallway.

Other Hazards: N/A

Dial 911:

Direct Responders:

CPR:

SAFETY MOMENT: FIRE SAFETY

April 30 concludes the Indiana Spring Fire Season. The risk of fire in homes and workplaces exists all times of year, however. Please remember to protect yourself, your family, and your coworkers by remaining mindful of fire threats and fire safety throughout the year.



Consider two actions that will be impactful

When new positive behaviors are implemented, or unsafe practices are eliminated, safety increases

1. Keep matches and lighters out of children's reach
2. Use flashlights during power outages rather than candles
3. Never leave a burning candle unattended
4. Turn off space heaters when you leave the room, and do not leave them unattended
5. Only use smoking materials outside
6. Keep flammable items away from anything that can get hot, such as space heaters and stove tops

Source: NISTGlobal <https://nistglobal.com/blog/2022/03/home-fire-prevention-safety-tips/>

We exist to deliver safe, reliable energy that drives value to our customers

STAKEHOLDER ADVISORY MEETING PROTOCOLS

- **Your input and feedback is critical to NIPSCO's Integrated Resource Plan (IRP) Process.**
- **The Public Advisory Process provides NIPSCO with feedback on its assumptions and sources of data. This helps inform the modeling process and overall IRP.**
- **We set aside time at the end of each section to ask questions.**
- **Your candid and ongoing feedback is key to this process:**
 - Please ask questions and make comments on the content presented
 - Please provide feedback on the process itself
- **Please identify yourself by name prior to speaking. This will help keep track of comments and follow up actions.**
- **If you wish to make a presentation during a meeting, please reach out to Erin Whitehead (ewhitehead@nisource.com).**

AGENDA

Time *Central Time	Topic	Speaker
9:00-9:10AM	Welcome & Introduction	Tara McElmurry, Communications Manager, NiSource Vince Parisi, President & COO, NIPSCO
9:10-9:20AM	Kick Off	Vince Parisi, President & COO, NIPSCO
9:20-10:00AM	NIPSCO Integrated Resource Planning Process Overview State and Federal Policy Developments Environmental Policy Review	Fred Gomos, Director Strategy, NiSource Pat Augustine, Vice President, CRA Stephen Holcomb, Director Environmental Policy & Sustainability, NiSource
10:00-10:10AM	Break	
10:10-11:00AM	2021 Short Term Action Plan Update Continuous Improvements for 2024 IRP 2024 IRP Analytical Framework	Fred Gomos, Director Strategy, NiSource Pat Augustine, Vice President, CRA
11:00-11:50AM	Lunch	
11:50AM-12:50PM	Reference Case Load Forecast	Pat Augustine, Vice President, CRA Fred Gomos, Director Strategy, NiSource
12:50-1:00PM	Break	
1:00 – 1:30PM	2024 Request for Proposal	Patrick d’Entremont, Manager Planning Commercial Support, NIPSCO Bob Lee, Vice President, CRA
1:30-1:55PM	2024 Public Advisory Process Next Steps	Fred Gomos, Director Strategy, NiSource
1:55-2:00PM	Closing	

We exist to deliver safe, reliable energy that drives value to our customers



We exist to deliver safe, reliable energy that drives value to our customers

KICK OFF

Vince Parisi, President & COO, NIPSCO



PREMIER REGULATED UTILITY BUSINESS



NATURAL GAS

COLUMBIA GAS OF KENTUCKY

COLUMBIA GAS OF MARYLAND

COLUMBIA GAS OF OHIO

COLUMBIA GAS OF PENNSYLVANIA

COLUMBIA GAS OF VIRGINIA

NIPSCO GAS

NIPSCO

ELECTRIC

NIPSCO ELECTRIC

SIGNIFICANT SCALE
ACROSS 6 STATES

~3.2M

GAS CUSTOMERS

~500K

ELECTRIC CUSTOMERS

We exist to deliver safe, reliable energy that drives value to our customers

NIPSCO PROFILE


Working to Become Indiana's Premier Utility

Electric

- 483,000 Electric Customers in 20 Counties
- 3,365 MW Generating Capacity
 - 11 Electric Generating Facilities
(2 Coal, 1 Natural Gas, 2 Hydro, 4 Wind, 2 solar)
 - 1,000 MW of New Wind Energy
(Rosewater, Jordan Creek and Indiana Crossroads Wind I & II online in 2020 2021 and 2023)
 - 465 MW of New Solar Energy
(Dunns Bridge I and Indiana Crossroads solar online in 2023)
- 12,800 Miles of Transmission and Distribution
 - Interconnect with 5 Major Utilities (3 MISO; 2 PJM)
 - Serves 2 Network Customers and Other Independent Power Producers

Natural Gas

- 859,000 Natural Gas Customers; 32 Counties
- 17,000 Miles of Transmission and Distribution Line/Main
- Interconnections with Seven Major Interstate Pipelines
- Two On-System Storage Facilities

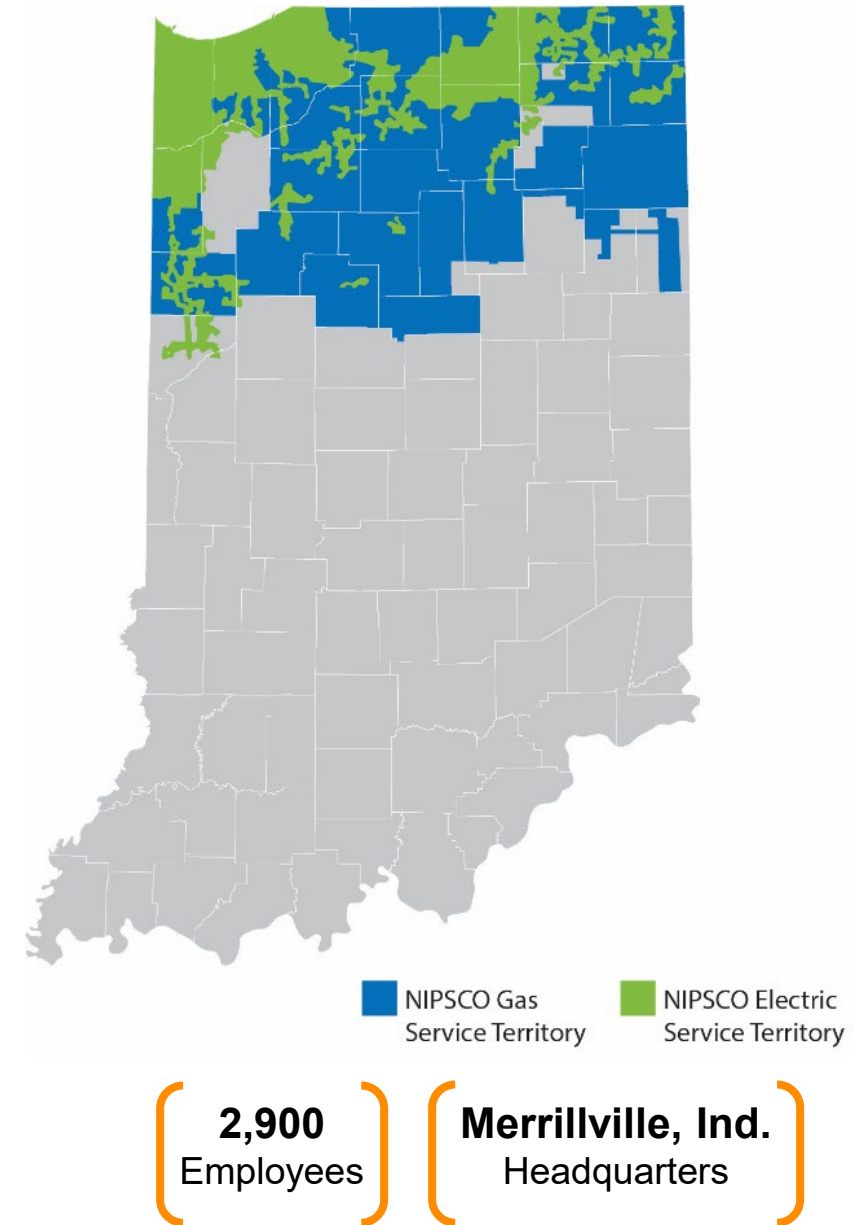


We exist to deliver safe, reliable energy that drives value to our customers

CURRENT & FUTURE NIPSCO GENERATION PORTFOLIO

Robust Renewable Investments in Indiana

NEW GENERATION FACILITIES*	INSTALLED CAPACITY (MW)	COUNTY	IN SERVICE
ROSEWATER WIND	102 MW	WHITE	2020 COMPLETE
JORDAN CREEK WIND	400 MW	BENTON & WARREN	2020 COMPLETE
INDIANA CROSSROADS WIND	302 MW	WHITE	2021 COMPLETE
DUNNS BRIDGE SOLAR I	265 MW	JASPER	2022 COMPLETE
INDIANA CROSSROADS SOLAR	200 MW	WHITE	2023 COMPLETE
INDIANA CROSSROADS II WIND	200 MW	WHITE	2023 COMPLETE
GREEN RIVER SOLAR	200 MW	BRECKINRIDGE & MEADE (KY)	2024 CONSTRUCTION
DUNNS BRIDGE SOLAR II	435 MW + 75 MW BATTERY	JASPER	2024 CONSTRUCTION
CAVALRY SOLAR	200 MW + 60 MW BATTERY	WHITE	2024 CONSTRUCTION
GIBSON SOLAR	200 MW	GIBSON	2025 PRE-CONSTRUCTION
FAIRBANKS SOLAR	250 MW	SULLIVAN	2025 CONSTRUCTION
TEMPLETON WIND	200 MW	BENTON	2025 PRE-CONSTRUCTION
CARPENTER WIND	200 MW	JASPER	2025 PRE-CONSTRUCTION
APPLESEED SOLAR	200 MW	CASS	2025 PRE-CONSTRUCTION
GAS PEAKING RESOURCE	400 MW	JASPER	2027 PRE-CONSTRUCTION PENDING IURC APPROVAL

GENERATION FACILITIES	INSTALLED CAPACITY (MW)	FUEL	COUNTY
MICHIGAN CITY RETIRING 2028	455 MW	COAL	LAPORTE
R.M. SCHAHFER RETIRING 2025 (COAL) – 2028 (NG)	722 MW + 155 MW	COAL + NATURAL GAS	JASPER
SUGAR CREEK	563 MW	NATURAL GAS	VIGO
NORWAY HYDRO	7.2 MW	WATER	WHITE
OAKDALE HYDRO	9.2 MW	WATER	CARROLL

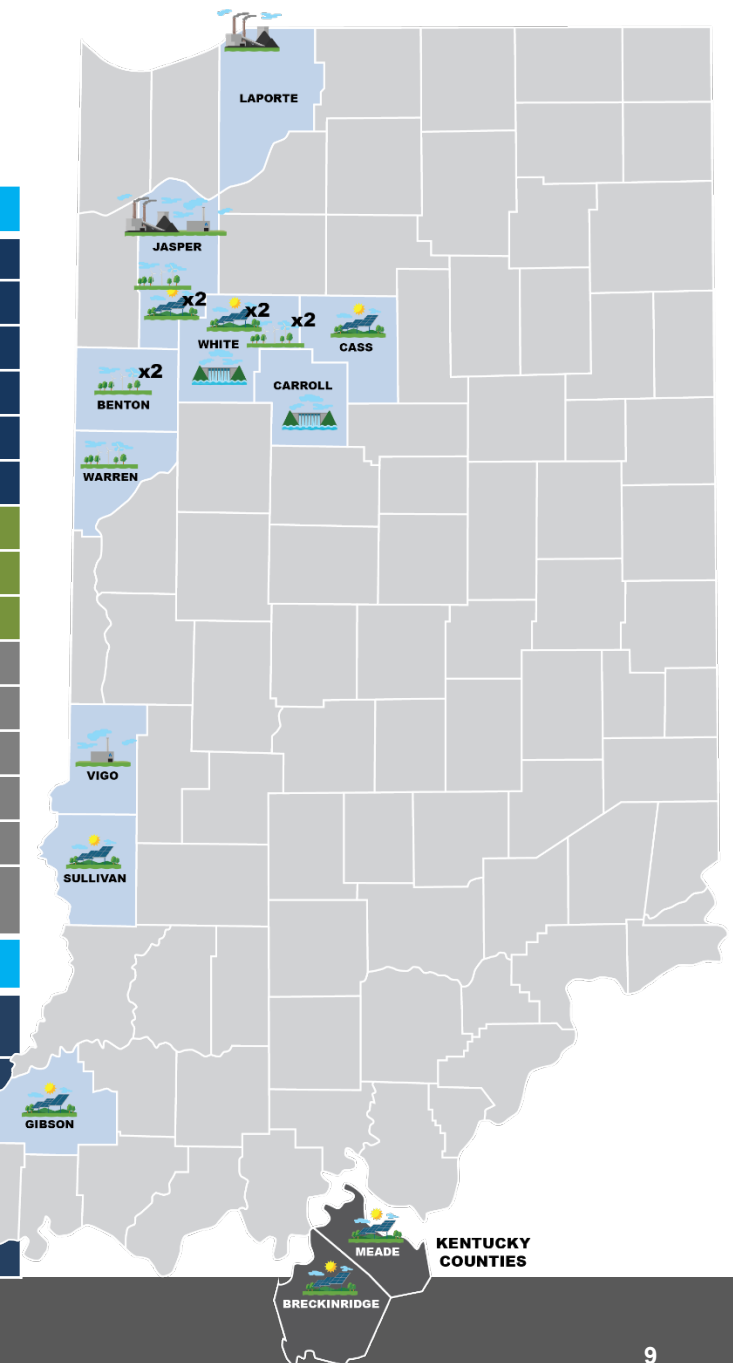

* Since 2018

We exist to deliver safe, reliable energy that drives value to our customers

PILLARS OF OUR ONGOING GENERATION TRANSITION PLAN

This plan creates a vision for the future that is better for our customers and it's consistent with our goal to transition to the best cost and cleanest electric supply mix available while maintaining reliability, diversity and flexibility for the technology and market changes on the horizon.



**Reliable and
sustainable**

**Flexibility for
the future**

**Local and statewide
economic benefits**

**Best plan for customers
and the company**

We exist to deliver safe, reliable energy that drives value to our customers



We exist to deliver safe, reliable energy that drives value to our customers

NIPSCO INTEGRATED RESOURCE PLANNING PROCESS OVERVIEW


Fred Gomos, Director Strategy, NiSource

Pat Augustine, Vice President, CRA



HOW DOES NIPSCO PLAN FOR THE FUTURE?

- At least every three years, NIPSCO outlines its long-term plan to supply electricity to customers over the next 20 years
- This study – known as an Integrated Resource Plan – is required of all electric utilities in Indiana
- The IRP process includes an extensive analysis of a range of resource options evaluated against objectives for portfolios to be reliable, affordable, sustainable, diverse and flexible

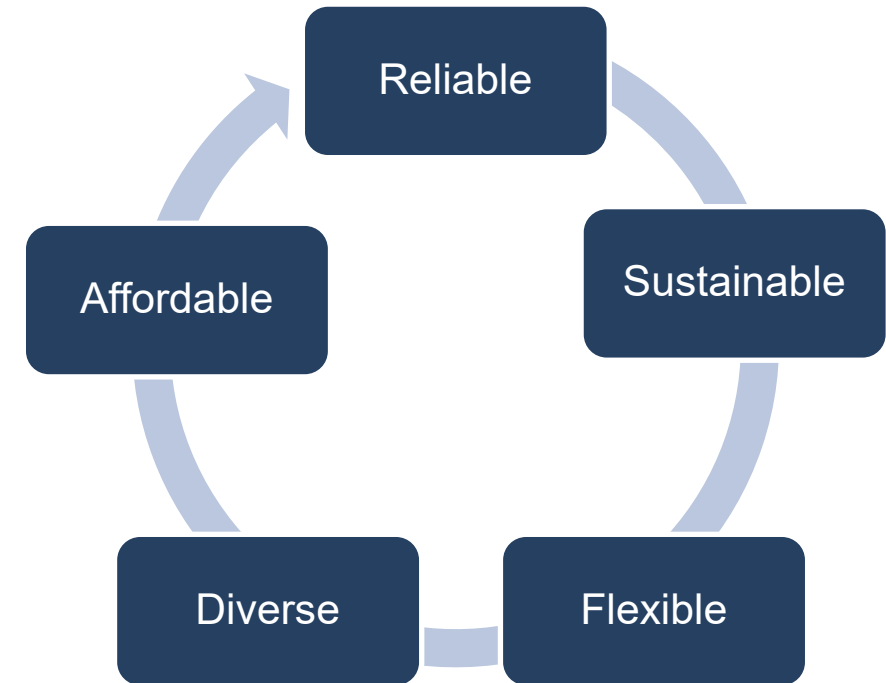


Requires Careful Planning and Consideration for:

- NIPSCO's employees
- Environmental regulations and market rules
- The local economy

NIPSCO RESOURCE PLANNING APPROACH

NIPSCO's five-step process is consistent with its approach from the 2018 and 2021 IRPs

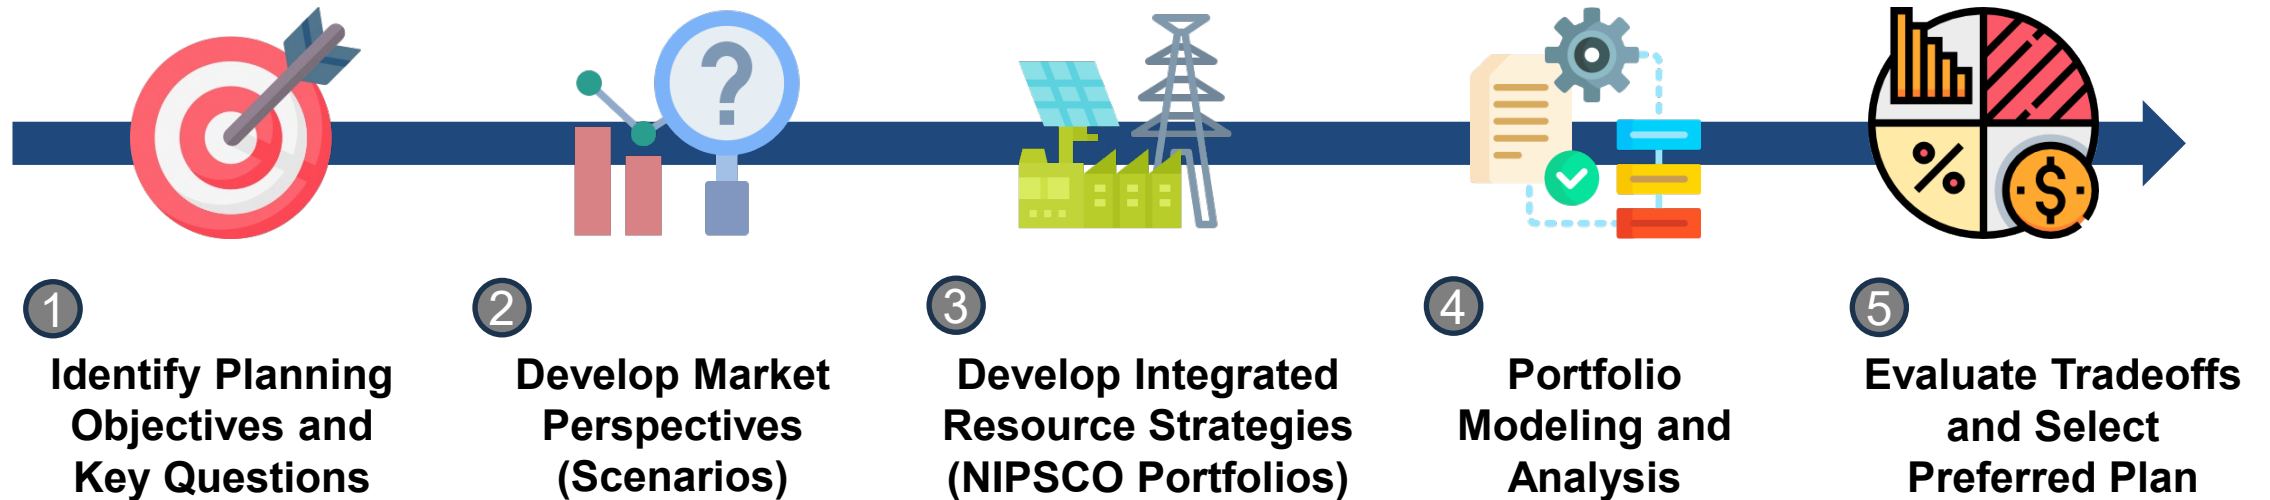

Emerging issues for 2024

- *Evolving reliability and social impact objectives*
- *Environmental policy*
- *New technology options*
- *MISO market design evolution*
- *Emerging load trends*
- *Enhanced reliability analysis*
- *MISO market trends*

We exist to deliver safe, reliable energy that drives value to our customers



We exist to deliver safe, reliable energy that drives value to our customers

STATE AND FEDERAL DEVELOPMENTS SINCE THE 2021 IRP & ENVIRONMENTAL POLICY REVIEW

Fred Gomos, Director Strategy, NiSource

Pat Augustine, Vice President, CRA


Stephen Holcomb, Director Environmental Policy & Sustainability, NiSource



STATE POLICY CHANGES – FIVE PILLARS OF LONG-TERM PLANNING


- *House Enrolled Act 1278 led to the creation of the Indiana 21st Century Energy Task Force, which has established **five pillars that utilities must consider when undertaking long-term planning in the state***
- *The Five Pillars are **Reliability, Resilience, Affordability, Stability, and Environmental Sustainability**, which are consistent with the criteria NIPSCO uses for resource planning decisions*

Reliability

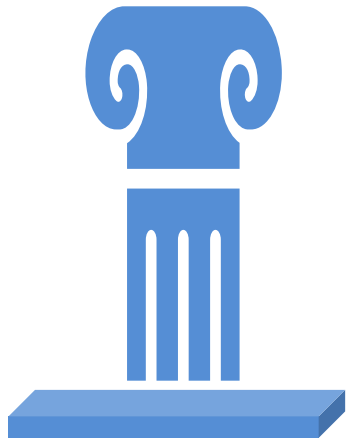


- Resource adequacy
- Operating reliability

Resilience

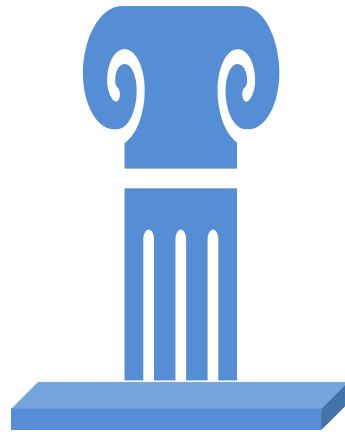


- Respond to catastrophic events

Affordability

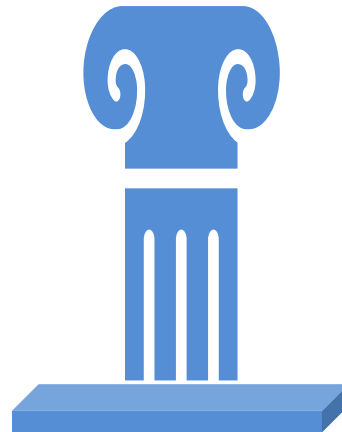


- Affordability across all customer classes
- Diverse resource mix

Stability

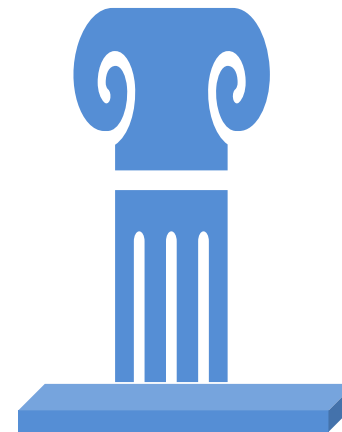

- Ability to deliver stable electric service to all customers

Environmental Sustainability

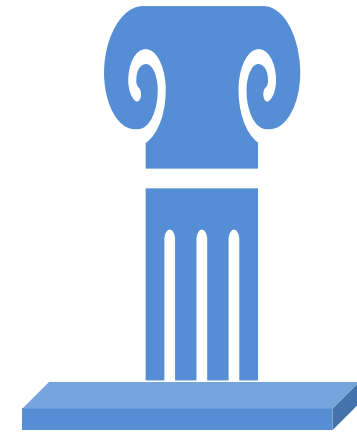

- Account for both environmental regulations and consumers' demands


We exist to deliver safe, reliable energy that drives value to our customers

SIGNIFICANT CHANGES IN THE MIDCONTINENT INDEPENDENT SYSTEM OPERATOR (MISO) RESOURCE MIX ARE DRIVING NEW RESOURCE ADEQUACY CHALLENGES

- *MISO's Reliability Imperative is the term MISO uses to describe the shared responsibility of MISO, its members and states to address the urgent and complex challenges to electric system reliability in the MISO region*
- *MISO's Reliability Imperative calls out "Market Redefinition" as a Key Pillar*

Key Initiatives in MISO's Reliability Imperative:

- *Ensure resources are accurately accredited*
- *Identify critical system reliability attributes*
- *Ensure accurate pricing of energy & reserves*

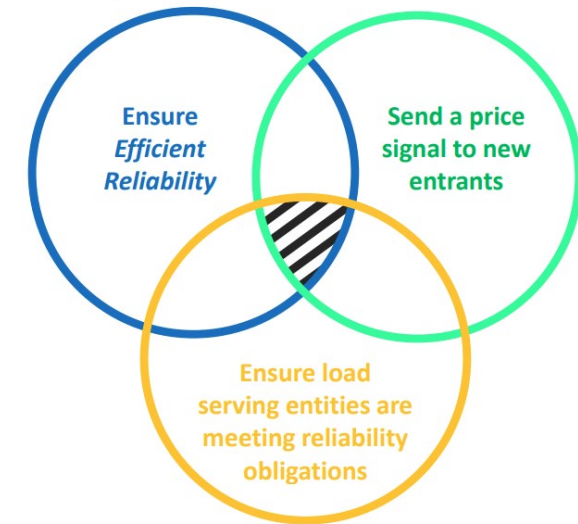

"Resource accreditation is the process of accurately measuring and assigning a capacity value to a resource based on its contribution to system reliability during periods of highest risk."

Sources:

Resource Accreditation White Paper Version 1.1 <https://cdn.misoenergy.org/Resource%20Accreditation%20White%20Paper%20Version%201.1630728.pdf>



Ensuring Efficient Reliability NEW DESIGN PRINCIPLES FOR CAPACITY ACCREDITATION <https://www.esig.energy/wp-content/uploads/2023/02/ESIG-Design-principles-capacity-accreditation-report-2023.pdf>

MISO's Response to the Reliability Imperative, Updated February 2024. <https://cdn.misoenergy.org/2024%20Reliability%20Imperative%20report%20Feb.%2021%20Final504018.pdf?v=20240221104216>

We exist to deliver safe, reliable energy that drives value to our customers

RECENT MISO RESOURCE ADEQUACY DEVELOPMENTS AND MARKET REFORMS

- **2023** – MISO implemented a **4-season capacity construct** with obligations and resource accreditations varying by the four seasons across the *MISO Planning Year*
- **2025** – MISO plans to implement a “**downward sloping**” reliability-based **demand curve** to value capacity across a range of reserve margin levels
- **2028** – MISO filed its **Direct Loss of Load (“D-LOL”)** market design proposal on March 28, 2024 with the FERC, driving towards marginal capacity accreditation, with obligations and resource accreditations focused on **performance during tight margin hours**
- Other metrics and markets could be developed for other desired system attributes

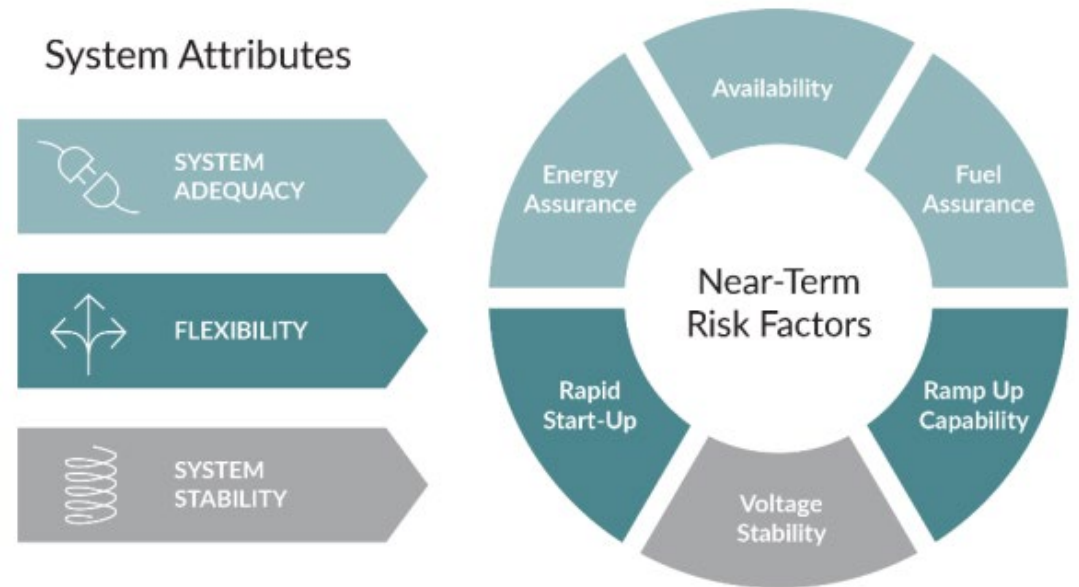

Sources:

<https://cdn.misoenergy.org/20240228%20RASC%20Item%2005c%20RA%20Model%20Enhancement%20Presentation631891.pdf>

<https://cdn.misoenergy.org/2023%20Attributes%20Roadmap631174.pdf>

We exist to deliver safe, reliable energy that drives value to our customers


D-LOL KEY TAKEAWAYS

NIPSCO's 2024 IRP will evaluate the potential impacts associated with D-LOL implementation



MISO made its filing on March 28, 2024

FERC approval is still required, and stakeholders have raised several questions and concerns




Performance during tight hours will matter more

Strong incentive to perform during hours when net load *and* outages are high




Highly dependent on LOLE* assumptions

Based on historical weather data and may not capture all future trends



Accreditations will likely change

MISO has signaled significant drops for certain technology types, but future market conditions will matter



NIPSCO Obligation likely to decline

Shift in timing of tight hours likely to lead to obligation declines, but magnitude is uncertain

* LOLE = Loss of load expectation

We exist to deliver safe, reliable energy that drives value to our customers

INFLATION REDUCTION ACT (IRA)

The Inflation Reduction Act, containing several incentives related to the power sector, was signed into law in August 2022.

- **Production Tax Credit (PTC)**
 - 10-year credit of \$27.5/MWh (growing with inflation)*
 - Re-introduced the PTC for solar and created new universal clean energy PTC
 - Eligibility through 2035**
- **Investment Tax Credit (ITC)**
 - Upfront credit equal to 30% of qualifying investment*
 - Extended the ITC to stand-alone storage
 - Eligibility through 2035**
- **New Hydrogen PTC** (up to \$3/kg)
- Increased 12-year **CCUS[^] credit** value to \$85/ton
- New “bonus” credit opportunities exist:
 - 10% additional credit if cited in an **“energy community”**
 - 10% additional credit for facilities constructed with **domestically manufactured components**
 - 20% additional credit for **low-income benefit projects** at small-scale
- New monetization opportunities via **tax credit transfer**: tax credits can be directly sold to other parties if original beneficiary lacks a tax liability

*Assuming apprenticeship and prevailing wage requirements are met

** Credit availability could be extended longer if U.S. power sector emission reduction targets are not achieved


[^] CCUS = Carbon capture utilization and storage

We exist to deliver safe, reliable energy that drives value to our customers

IRA ENERGY COMMUNITY OPPORTUNITIES IN INDIANA


- Many Energy Community locations exist in Indiana, largely due to retired coal generating units or coal mines in the state
- NIPSCO is currently taking advantage of the bonus credits that are available for multiple solar and solar + storage projects currently under construction and in development

Existing Coal-Retirement Census Tracts

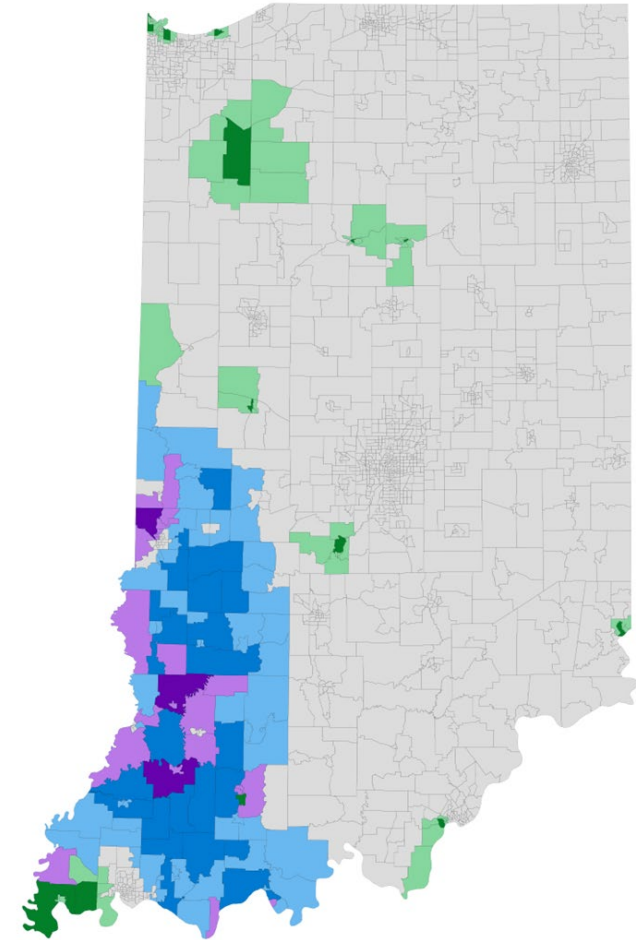

IRA LOW-INCOME ECONOMIC BENEFIT PROJECTS (LIEBPs)

- LIEBPs provide 20% ITC credit adders for a limited number of **small-scale (5MW or less)** clean energy projects each year
- Projects must reduce bills for low-income customers and must pass through a competitive US Dept of Energy application process, though strategic site selection and financial benefit allocations could increase likelihood of acceptance
- LIEBPs located in climate justice census tracts will receive priority consideration in the application process, greatly improving chances of project qualification

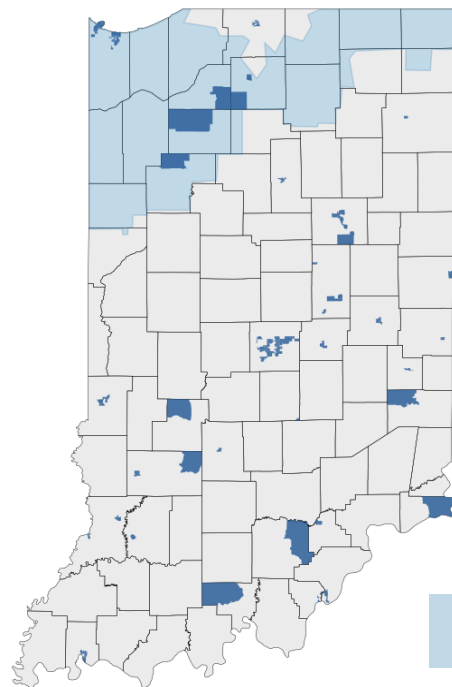


Climate Justice Census Tracts Definition

Census Tracts with both:

- ≥ 65th percentile of low-income households
- ≥ 90th percentile for PM2.5 exposure **or** ≥ 90th percentile for energy burden

Light blue square: NIPSO Service Territory
Dark blue square: Climate Justice Census Tracts

Projects located in persistent poverty counties also receive priority consideration. However, there are currently no counties in Indiana under this classification.

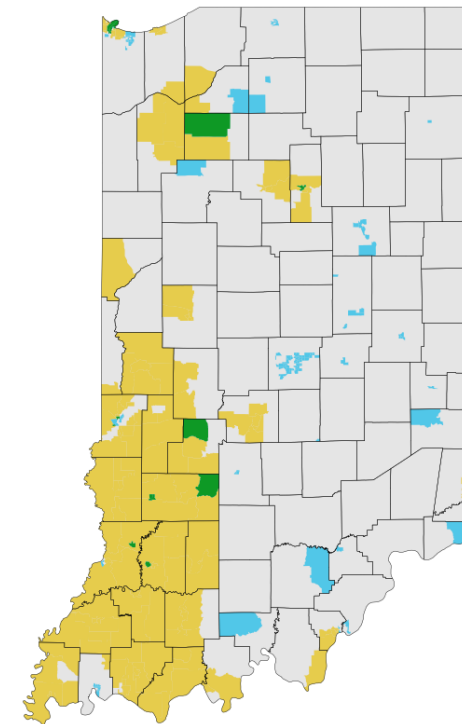

Light gray square: 30% ITC
Yellow square: 40% ITC (energy community only)
Light blue square: 50% ITC (LIEBP only)
Green square: 60% ITC (LIEBP and energy community)

We exist to deliver safe, reliable energy that drives value to our customers

ENVIRONMENTAL POLICY: PROPOSED CLEAN AIR ACT SECTION 111(b) AND (d) RULES

- On May 11, 2023, EPA proposed greenhouse gas standards and guidelines for fossil fuel-fired power plants. This set of proposed rules was published in the Federal Register on May 23, 2023.
- The rule is the latest EPA effort to regulate greenhouse gases from the power sector, following the Clean Power Plan (CPP) and the Affordable Clean Energy Rule (ACE)
- EPA expects to issue a final rule this Spring

EPA Proposed Rule under Clean Air Act Section 111

Existing Coal Units

- Long term operations: CCS at 90% capture rate by 2030
- Retire prior to 2040: Co-fire 40% natural gas by 2030
- Retire prior to 2035: Limit operations to 20% capacity factor
- Retire prior to 2032: No restrictions

Existing Gas Units

- Draft rule initially indicated that existing gas units above a certain size and capacity factor would be subject to CCUS or hydrogen blending requirements
- EPA has now indicated that existing gas units will **not** be covered by **this** rulemaking, but will be covered by another rule

New Gas Units

- Low load: 20% capacity factor max if burning natural gas
- Medium load: Blend 30% H2 by 2032
- High load: Use CCS to achieve 90% reduction by 2035 or blend 30% H2 by 2032 ramping to 96% by 2038

ENVIRONMENTAL REGULATIONS IMPACT PORTFOLIO OPERATIONS AND PLANNING

NIPSCO's coal fleet remains in compliance with several key environmental regulations, including Effluent Limitation Guidelines (ELG), the Coal Combustion Residuals (CCR) Rule, Mercury and Air Toxics Standards (MATS), and the Good Neighbor Rule

- Retirement of Schahfer Units 17 and 18 by 2025 avoids significant capital costs needed to comply with the ELG and CCR Rules and NPDES permit, as well as future potential costs to comply with the Good Neighbor Rule and the proposed MATS update

	ELG Rule	Schahfer NPDES Permit	CCR Rule
Purpose	Establishes national standards for treatment of wastewater streams	Authorization from IDEM to discharge wastewater in accordance with effluent limitations, monitoring requirements, and other conditions	Regulates new and existing coal ash landfills and certain surface impoundments
Regulated	Wastewater streams associated with bottom ash, boiler slag, FGD, fly ash, flue gas mercury control waste, landfill leachate, and non-chemical metal cleaning waste	Wastewater discharge from Schahfer Generating Station	CCRs from bottom ash, boiler slag, fly ash and certain FGD solids
Compliance Plan	<ul style="list-style-type: none"> • Michigan City Unit 12 zero liquid discharge • Schahfer Unit 17 & 18 retirement by 2025 	<ul style="list-style-type: none"> • Comply with effluent limitations and monitoring requirements • Closed-cycle cooling via cooling towers • Schahfer Unit 17 & 18 retirement by 2025 	Phased Compliance 2015 – 2053+ <ul style="list-style-type: none"> • Phase I: Separate ponds from generation • Phase II: Close CCR ponds • Phase III: Implement groundwater remedy and monitoring Schahfer Unit 17 & 18 retirement by 2025

We exist to deliver safe, reliable energy that drives value to our customers

ENVIRONMENTAL REGULATIONS IMPACT PORTFOLIO OPERATIONS AND PLANNING

NIPSCO's coal fleet remains in compliance with several key environmental regulations, including Effluent Limitation Guidelines (ELG), the Coal Combustion Residuals (CCR) Rule, Mercury and Air Toxics Standards (MATS), and the Good Neighbor Rule

- Retirement of Schahfer Units 17 and 18 by 2025 avoids significant capital costs needed to comply with the ELG and CCR Rules and NPDES permit, as well as future potential costs to comply with the Good Neighbor Rule and the proposed MATS update

	MATS	Good Neighbor Rule	Power Plant GHG Rule
Purpose	Regulates mercury emissions and other hazardous air pollutants from coal-fired power plants	Eliminate significant contributions to nonattainment, or interference with maintenance of, the 2015 ozone NAAQS in downwind states	Limit greenhouse gas emissions from power plants under Clean Air Act Section 111
Regulated	Mercury and other hazardous air pollutants	Regulates NOx emissions from emission sources in the electric power and other sectors	Existing coal units plus new gas units (best system of emission reduction based on capacity factor)
Compliance Plan	<p>Operation of existing pollution control technology</p> <p>Facility averaging for Schahfer Unit 17 & 18 mercury emissions</p> <p>Schahfer Unit 17 & 18 retirement by 2025</p>	<p>Operation of existing pollution control technology</p> <p>EPA allocation of emission allowances</p> <p>Schahfer Unit 17 & 18 retirement by 2025</p>	<p>New gas peaker expected to comply, whether by normal operation, by limiting capacity factor below 20%, or by co-firing hydrogen at capacity factors above 20% in 2032+</p> <p>No impact expected for Sugar Creek Generating Station and NIPSCO's coal plants.</p>

We exist to deliver safe, reliable energy that drives value to our customers

WE ARE COMMITTED TO MEETING OUR ENVIRONMENTAL IMPROVEMENT TARGETS

On Track to Meet Our Targets Through the Operation of Pollution Control Technology and the Retirement of Coal by 2028

	PROGRESS THROUGH 2023 % REDUCTIONS FROM 2005 LEVELS	TARGET 2025 % REDUCTIONS FROM 2005 LEVELS	TARGET 2030 % REDUCTIONS FROM 2005 LEVELS
CARBON DIOXIDE (CO2) (ELECTRIC GENERATION, SCOPE 1 EMISSIONS)	75%	50%	90%
NITROGEN OXIDES (NOX) EMISSIONS	94%	90%	99%
SULFUR DIOXIDE (SO2) EMISSIONS	98%	90%	99%
MERCURY EMISSIONS	96%	90%	99%
WATER WITHDRAWAL	92%	90%	99%
WATER DISCHARGE	94%	90%	99%
COAL ASH GENERATED	68%	60%	100%

In 2022, we furthered our commitment to sustainability by announcing a 2040 Net Zero Goal for greenhouse gas emissions



Committed to Protecting Human Health and the Environment

We exist to deliver safe, reliable energy that drives value to our customers



We exist to deliver safe, reliable energy that drives value to our customers

BREAK





We exist to deliver safe, reliable energy that drives value to our customers

2021 SHORT-TERM ACTION PLAN UPDATE

Fred Gomos, Director Strategy, NiSource
Pat Augustine, Vice President, CRA



PROGRESS ON ADVANCING THE 2021 IRP PREFERRED PLAN AND SHORT-TERM ACTION PLAN

Non-Exhaustive

	<u>2021 Short Term Action Plan</u>	<u>Progress To Date</u>
Retirement	<ul style="list-style-type: none">• Retire Schahfer Coal Units 17/18 by 2023¹• Retire Michigan City Unit 12 and Schahfer 16A/B by 2028• Identify and implement required reliability/transmission upgrades resulting from the retirement of the units	<ul style="list-style-type: none">• Completed transmission upgrades to support the retirement of Schahfer, with the last phase planned completed in June 2023• Schahfer Units 17/18 on track to retire in 2025¹
Replacement	<ul style="list-style-type: none">• Deeper diligence on gas peaker and storage projects• Conduct subsequent RFPs• File CPCNs and other necessary approvals for replacement projects	<ul style="list-style-type: none">• Completed technoeconomic and engineering studies to inform gas peaker asset mix that meets portfolio needs• Conducted an RFP for All Source and Schahfer replacement capacity in Fall 2022• Seeking approval for new and restructured projects
Continue To Monitor	<ul style="list-style-type: none">• Continue to actively monitor technology and MISO market trends	<ul style="list-style-type: none">• Performed refreshed 2023 portfolio analysis integrating dynamic market changes impacting the energy industry

¹In 2022 the retirement date for the remaining coal units at Schahfer was moved to 2025 from the previously planned 2023 as a result of various factors impacting the supply chain for NIPSCO's solar projects needed to replace the capacity of the coal units

We exist to deliver safe, reliable energy that drives value to our customers

EVOLUTION OF NIPSCO'S PREFERRED PLAN

- The latest MISO market rules updates, passage of the IRA, and 2022 RFP data resulted in a slight pivot towards resources that can provide more winter capacity and an opportunity to shift the highest-cost solar energy towards incremental wind energy
- As laid out in NIPSCO's 2021 IRP Short-Term Action Plan, flexibility in procurement activities and short-term capacity purchases remain important

Portfolio Components	2021 IRP Preferred Plan	Latest Progress	
Schahfer 17/18 Retirement Date	Mid-2023	Late 2025	Coal retirement dates pushed, and short-term capacity contract amounts vary according to annual needs
Michigan City 12 Retirement Date	Between 2026 and 2028	2028	
Short-Term Capacity Contracts	150 MW	100 MW (10-yr) plus 300 MW+ for nearer-term, as needed	
New Gas Peaking	Up to 300 MW	~400 MW	Winter capacity more valuable and wind energy more competitive relative to solar due to IRA production tax credits
2018-19 RFP Renewable Projects	As per CPCN approvals	Dropped ~600 MW of solar projects with escalating costs	
New Solar	100 – 250 MW	200 MW	
New Wind	Up to 200 MW	400 MW	
Sugar Creek Uprate	30 – 53 MW	~30 MW ¹	Stable components of IRP preferred plan
DSM	~68 MW at summer peak	~68 MW at summer peak	
New Storage	135 – 370 MW	125 – 200 MW	

¹ Sugar Creek received additional capacity in January 2024

We exist to deliver safe, reliable energy that drives value to our customers


SUMMARY OF THE STATUS OF NIPSCO PORTFOLIO ADDITIONS SINCE 2018 IRP – FACILITIES IN SERVICE

Since the 2018 IRP, NIPSCO has acquired and placed into service four wind farms and two solar farms through PPA or Joint Venture Tax Equity Partnership

In-Service Projects	Technology	Structure	Capacity (MW ICAP)	In-Service Date
Jordan Creek	Wind	PPA	400	12-2020
Rosewater	Wind	Tax Equity Partnership	102	12-2020
Indiana Crossroads Wind I	Wind	Tax Equity Partnership	302	12-2021
Indiana Crossroads Solar	Solar	Tax Equity Partnership	200	06-2023
Dunns Bridge I	Solar	Tax Equity Partnership	265	06-2023
Indiana Crossroads Wind II	Wind	PPA	204	12-2023



~1,000 MW of wind generation capacity placed into service since the 2018 IRP



465 MW of solar capacity placed into service since the 2018 IRP

We exist to deliver safe, reliable energy that drives value to our customers

SUMMARY OF THE STATUS OF NIPSCO PORTFOLIO ADDITIONS – ACTIONS SINCE THE 2021 IRP FOR FACILITIES IN DEVELOPMENT

- *An additional 400 MW of wind capacity, 1,035 MW of solar capacity, and 135 MW of storage capacity have been approved by the Commission and are expected to be in service in 2024 and 2025.*
- *NIPSCO currently has 450 MW of solar capacity and 400 MW of peaking capacity in active proceedings before the IURC.*

	Project	Technology	Structure	Capacity (MW ICAP)	Regulatory Activities Since 2021 IRP	Expected In-Service Date
Approved	Cavalry	Solar + Storage	Full Ownership	200 + 60	Change in cost / ownership structure <i>Approved 01-2024</i>	05-2024
	Dunns Bridge II	Solar + Storage	Full Ownership	435 + 75	Change in cost / ownership structure <i>Approved 01-2024</i>	12-2024
	Green River	Solar	PPA	200	Cost update <i>Approved 07-2023</i>	12-2024
	Appleseed	Solar	PPA	200	New CPCN <i>Approved 09-2023</i>	12-2025
	Templeton	Wind	PPA	200	New CPCN <i>Approved 09-2023</i>	12-2025
	Carpenter	Wind	PPA	200	New CPCN <i>Approved 10-2023</i>	12-2025
Active Proceedings	Fairbanks	Solar	Full Ownership	250	Change in cost / ownership structure <i>Active proceeding</i>	05-2025
	Gibson	Solar	Full Ownership	200	Change in cost / ownership structure <i>Active proceeding</i>	06-2025
	New Peaker	Frame + Aero	Full Ownership	~400	New CPCN <i>Active proceeding</i>	12-2027

We exist to deliver safe, reliable energy that drives value to our customers



We exist to deliver safe, reliable energy that drives value to our customers

CONTINUOUS IMPROVEMENTS FOR THE 2024 IRP

Fred Gomos, Director Strategy, NiSource
Pat Augustine, Vice President, CRA



2021 IRP FEEDBACK AND CONTINUOUS IMPROVEMENT PLAN FOR 2024

Category	2021 IRP Feedback	2024 Improvement Plan
1 Load Forecast	<ul style="list-style-type: none"> More detail on Electric Vehicle (EV) forecast; for example, penetration has not been able to separate non-NIPSCO-serviced light-duty vehicles (LDVs) from total counts in counties served by more than one utility Clearer analytic methods regarding forecasting demand from large industrial customers 	<ul style="list-style-type: none"> More rigorous EV modeling with focus on vehicle counts within service territory and by class and separate truck corridor analysis Additional econometric analysis of industrial loads, as well as review of potential additional emerging industrial load types (i.e., data centers)
2 Demand-Side Resources	<ul style="list-style-type: none"> Interaction between energy efficiency (EE) and demand response (DR) resources require further consideration; more attention to meter-based pay-for-performance program designs 	<ul style="list-style-type: none"> Additional DSM evaluation, including integration with AMI and EV charging management Continued assessment of distributed energy resources (DERs)
3 Portfolio Analysis	<ul style="list-style-type: none"> Positive feedback on reliability assessment: <ul style="list-style-type: none"> “Based on this initial effort, [NIPSCO] is well positioned to provide future analytical improvements” Other stakeholders remain interested in various alternative technologies (RICE, storage, grid-forming inverter-based technology SMR) 	<ul style="list-style-type: none"> Advance continuous improvement around reliability analysis and quantification of risk Ensure full evaluation of a wide range of new technologies either via the RFP or other means (CCS at Sugar Creek, hydrogen, SMR, LDES)
4 Stakeholder Collaboration	<ul style="list-style-type: none"> Joint Commenters requested increased collaboration in the IRP process and the RFP process <ul style="list-style-type: none"> “...comments emphasized the need for continued collaboration and improvement between stakeholders and NIPSCO for the next IRP filing” 	<ul style="list-style-type: none"> Facilitate the procurement of Aurora Energy Forecast Software licenses to interested stakeholders to enable visibility into certain modeling files Provide opportunity for feedback on upcoming RFP for interested stakeholders under a Non-Disclosure Agreement

We exist to deliver safe, reliable energy that drives value to our customers

1 LOAD FORECASTING IMPROVEMENTS

- **Enhancements to EV modeling**
 - Fuller historical data sets for current vehicles in the NIPSCO footprint
 - Class-level assessment (light, medium and heavy duty vehicles, including a detailed transportation corridor assessment for heavy duty vehicles)
 - Deeper assessment of hourly charging shapes based on type of charger, location of charger (public/private), temperature, etc.
 - Integration with DSM analysis on unmanaged vs. managed charging for light duty vehicle class
- **Updated Distributed Energy Resource (DER) modeling**
 - Incorporation of historical customer data across NIPSCO footprint
 - More rigorous uncertainty analysis based on system costs, federal tax credit policy, wholesale and retail rates, and policy construct
- **More rigorous hourly shape analysis for electrification loads**
 - Deeper assessment of MISO Futures study with hourly load impacts by season and time of day
- **New considerations for emerging economic development and data center loads**

2 ADDITIONAL DSM AND DER ASSESSMENTS

- **Evaluating integration of Advanced Metering Infrastructure (AMI) with EV charging management as part of the DSM study**
 - “Managed” charging potential will be incorporated in DSM “bundles”
- **Integrating customer-owned DER analysis with DSM study to assess opportunities for incentives for customer-owned storage installations**
 - Integration with AMI and rate design to evaluate customer-owned storage economics (to improve capacity value of DER resources)
- **Additional integration of DERs with RFP with potential evaluation across various scorecard elements (cost, reliability, environmental justice)**
 - Potential special study around DER values

3 PORTFOLIO OPTIONS

- **Ensuring broad coverage of resource options**
 - Multiple RFP events to assess the landscape of options that might provide different attributes and fulfill different needs
 - Emerging technologies will be encouraged to participate in the RFP, and NIPSCO will also assess options like carbon capture utilization and storage (CCUS), small modular reactions (SMR), long-duration storage, hydrogen, among others
 - Tax credit opportunities will be evaluated for utility scale and distributed energy resources (DER), as appropriate
- **NIPSCO will continue to use a combination of least-cost optimization analysis and thematic portfolio design to assess a range of options to evaluate performance across a range of objectives associated with cost, environmental sustainability, and reliability**

3 RELIABILITY CONSIDERATIONS WITHIN THE PORTFOLIO ANALYSIS

- Continued attention to the three reliability pillars identified in 2021 IRP, with a more robust quantitative framework to evaluate uncertainties in resource adequacy and energy adequacy, **particularly in light of ongoing MISO market design and rule developments**

	Resource Adequacy	Energy Adequacy	Operating Reliability
Definition	Having sufficient resources to reliably serve demand	Ability to provide energy in all operating hours continuously throughout the year	Ability to withstand unanticipated component losses or disturbances
IRP Considerations	<ul style="list-style-type: none">Co-optimized capacity expansion analysis across all four seasonsConsiderations around market design changes to accreditations and obligation	<ul style="list-style-type: none">More robust hourly analysis for new loadsEnhanced stochastic reliability assessment to evaluate correlations between load, renewable output, thermal availability	<ul style="list-style-type: none">Ensure key “non-economic” reliability attributes are presentAssess ancillary services value

4 NIPSCO TO SHARE AURORA MODELING INFORMATION WITH STAKEHOLDERS

- **Aurora Modeling License For Stakeholders:** As a result of the 2021 IRP Stakeholder Advisory Process, NIPSCO committed to facilitating the procurement of Aurora Energy Forecasting Software special use licenses for stakeholders*
- **Purpose:** In order to increase collaboration and allow interested stakeholders to use Aurora modeling files to perform their own analysis with certain shared inputs
- **Software Provider:** Energy Exemplar
- **IRP Use:** NIPSCO and CRA use Aurora for multiple purposes during the IRP process, including to:
 - (i) Develop perspectives and power price forecasts for the wider MISO market
 - (ii) Perform detailed portfolio optimization and production cost/dispatch analysis for the NIPSCO system

Note: The MISO-level databases are proprietary to CRA and cannot be shared with stakeholders, but all information associated with NIPSCO-level analysis will be made available

- **Duration of Use:** the limited license agreement will be 12 months, allowing for stakeholders to use the model as NIPSCO develops the IRP and for several months after NIPSCO's expected submission date during the comment period.

*See NIPSCO's "NIPSCO's Response Comments to Stakeholder Comments." https://www.in.gov/iurc/files/NIPSCO_2021-IRP_Responses-to-Stakeholder-Comments.pdf Submitted on May 24, 2022

We exist to deliver safe, reliable energy that drives value to our customers



We exist to deliver safe, reliable energy that drives value to our customers


2024 IRP ANALYTICAL FRAMEWORK

Fred Gomos, Director Strategy, NiSource
Pat Augustine, Vice President, CRA



RESOURCE PLANNING APPROACH

Key Modeling and Analysis Tools

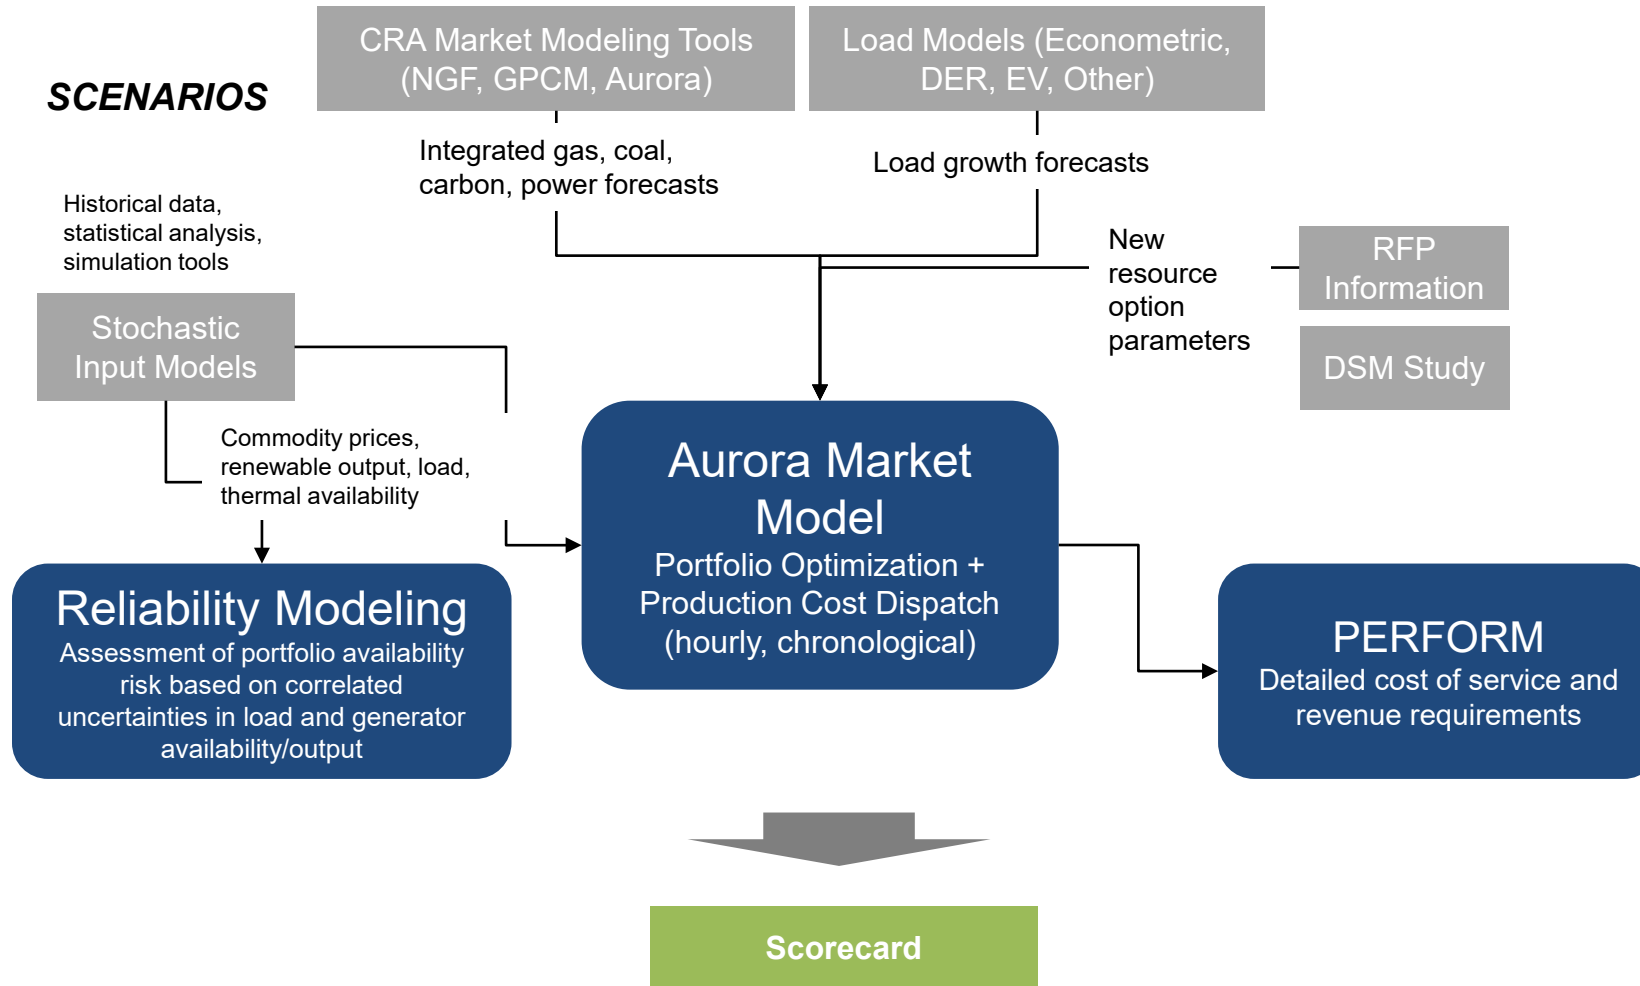

- 1 Identify key planning questions and approach
 - 2 Develop market perspectives (scenarios)
 - 3 Develop integrated resource strategies (NIPSCO portfolios)
 - 4 Portfolio modeling and analysis
 - Detailed scenario dispatch
 - Stochastic simulations
 - 5 Evaluate trade-offs and select preferred plan
- Today's meeting will start*

We exist to deliver safe, reliable energy that drives value to our customers

ANALYTICAL FRAMEWORK FOR EVALUATING FUTURE UNCERTAINTY

- Because resource decisions are generally long-lived, understanding and incorporating future risk and uncertainty is critical to making sound decisions
- NIPSCO's IRP analysis will use both scenarios and stochastic analysis to perform a robust assessment of risk

Scenarios

Single, Integrated Set of Assumptions

- Can be used to answer the “What if...” questions
 - Major events can change fundamental outlook for key drivers
 - New policy or regulation (carbon emissions regulation, tax credits)
 - Fundamental gas price change
 - Major load shifts
- Can tie portfolio performance directly to a “storyline”

Stochastic Analysis:

Probabilistic Distributions of Inputs

- Can evaluate volatility and “tail risk” impacts
 - Uncertainty in renewable resource output, generator availability, and load can impact portfolio costs and key reliability metrics
- **For the 2024 IRP, this analysis will be expanded to include more robust treatment of the correlations between renewable generation, load, resource availability, and commodity prices**

Special Studies:

Focused Research on a Single Topic or Trend

- Can be used to give an enhanced view of specific trends around policy, consumer preferences, or the economics of emerging technologies
 - Potential studies for this IRP include:
 - EV transitory charging
 - Long-duration energy storage (LDES) technology
 - Congestion studies
 - Hydrogen generation market research study
 - Other emerging technology studies

We exist to deliver safe, reliable energy that drives value to our customers

2024 IRP SCENARIOS



Reference Case (REF)

- The MISO market continues to evolve based on current expectations for load growth, commodity price trajectories, technology development, and policy change (IRA incentives continue, EPA power sector rules advance, and MISO resource adequacy enhancements proceed)



Slower Transition (ST)

- IRA incentives are reduced or ended early, and EPA power sector rules are overturned or rescinded; natural gas prices remain low and result in new gas additions remaining competitive versus renewables in the broader region, as coal capacity more gradually fades from the MISO market



Domestic Resiliency (DR)

- Continued geopolitical uncertainty and volatility drives a focus on “domestic energy independence”; electric power demand grows because of onshoring and other industrial growth (data centers); gas prices are higher due to strong demand



Aggressive Environmental Regulation (AER)

- Carbon emissions from the power sector are regulated more heavily, including through a CO2 price; restrictions on natural gas production increase gas prices













Accelerated Innovation (AI)

- Federal subsidies continue as a bridge until technology breakthroughs drive broad economy-wide decarbonization (including via electrification); new power sector technologies are commercialized, and DER, EV, microgrid, and EE adoption all increase, transforming wholesale load requirements as “Grid Edge” innovations and enabling policy advance

We exist to deliver safe, reliable energy that drives value to our customers

DIRECTIONAL SCENARIO VARIABLE INPUTS


Scenario	 Commodity Prices	 Carbon Policies	 Technology Costs	 Demand	 Market Design
 Reference Scenario (REF)	Baseline	Current Policy, including EPA power sector CO2 emission rules	Baseline	Baseline	Examine alternative capacity accreditation and obligation requirements across alternative market design concepts and based on MISO market outcomes
 Slower Transition (ST)	Low gas price due to abundant resource ↓	IRA pull-back and withdrawn EPA power sector rules ↓	Slower decline for new tech costs; stable IC costs ↑	Low DER and EV	
 Domestic Resiliency (DR)	Higher gas price due to strong demand ↑	Current policy, including EPA power sector CO2 emission rules ■	Higher due to supply chain constraints, onshoring ↑	New large loads (data centers, industrial onshoring)	
 Aggressive Environ. Regulation (AER)	Highest gas price due to production restrictions ↑	EPA power sector CO2 emission rules <i>plus</i> carbon price ↑	Baseline ■	Higher DER and EV; some electrification	
 Accelerated Innovation (AI)	Lower gas price due to demand erosion ↓	Current policy, including EPA power sector CO2 emission rules ■	New tech. advancement and decline in costs; IC cost pressures ↓	High EV and electrification plus new large loads; higher DER	

**Note that NIPSCO portfolio-level technology costs will be heavily informed by RFP data*

We exist to deliver safe, reliable energy that drives value to our customers

STOCHASTIC RELIABILITY ANALYSIS

- Stakeholder feedback from the 2021 IRP and ongoing reliability analysis activities at MISO have influenced NIPSCO's decision to make **enhancements to its stochastic analysis process for the 2024 IRP, focused on economic and reliability metrics**
- In addition to key economic metrics associated with cost to customer, NIPSCO's reliability analysis will assess how often NIPSCO *must* rely on external resources to meet load requirements
- Key enhancements to the process will tie net load (system load and wind and solar output) and generator availability back to weather to **capture correlated events**
- Measures of the **frequency and duration of market exposure**, along with economic impacts, will be evaluated across portfolios

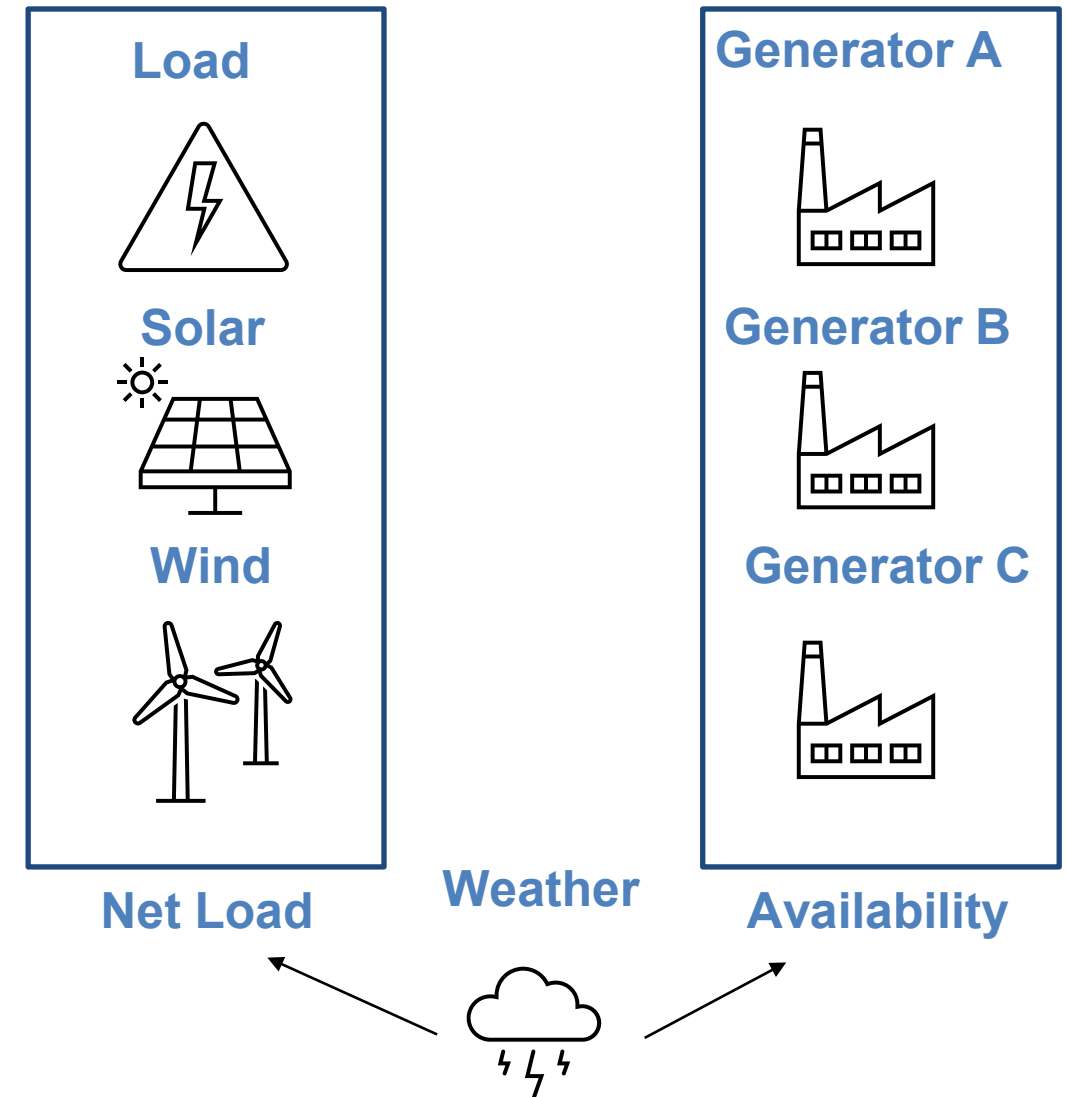

We exist to deliver safe, reliable energy that drives value to our customers

PORTFOLIO PERFORMANCE WILL BE DISTILLED INTO A PROPOSED INTEGRATED SCORECARD

Objectives	Indicators	Proposed Metrics for 2024	Notes
Affordability	Cost to Customer	<ul style="list-style-type: none"> Near-term and long-term Impact to customer bills Metric: 10-year and 30-year NPV of revenue requirement (Reference Case scenario deterministic results) 	<ul style="list-style-type: none"> Near-term and long-term perspectives
Rate Stability	Cost Certainty	<ul style="list-style-type: none"> Certainty that revenue requirement within the most likely range of outcomes Metric: Scenario range NPVRR and 75th% 	
	Cost Risk	<ul style="list-style-type: none"> Risk of unacceptable, high-cost outcomes Metric: Highest scenario NPVRR and 95th% 	
	Lower Cost Opportunity	<ul style="list-style-type: none"> Potential for lower cost outcomes Metric: Lowest scenario NPVRR and 5th% 	
Environmental Sustainability	Carbon Emissions	<ul style="list-style-type: none"> Carbon intensity of portfolio Metric: Cumulative carbon emissions (2024-40 short tons of CO₂) from the generation portfolio 	
Reliable, Flexible, and Resilient Supply	Reliability, Flexibility	<ul style="list-style-type: none"> The ability of the portfolio to provide reliable and flexible supply for NIPSCO in light of evolving market conditions and rules Metric: Loss of load expectation (LOLE) or expected unserved energy (EUE) metrics for NIPSCO system to assess market dependence risk Metric: MW black start and fast start capability 	<ul style="list-style-type: none"> New metrics from fuller reliability analysis based on MISO market rules evolution
Positive Social, & Economic Impacts	Local Investment in Economy	<ul style="list-style-type: none"> The effect on the local economy from new projects and ongoing property taxes and targeted investment Metric: NPV of property taxes from the entire portfolio Metric: NPV of potential investment in Justice40/Energy Communities 	<ul style="list-style-type: none"> New environmental justice metric considerations, particularly tied to IRA opportunities

Proposed changes from 2021 Scorecard highlighted in blue

We exist to deliver safe, reliable energy that drives value to our customers

NEXT STEPS FOR SCENARIO AND STOCHASTIC ANALYSIS

- **Developing integrated fuel, carbon, load, and power market outlooks for all five scenarios, detailed outcomes will be provided in the next stakeholder meeting:**
 - NIPSCO load scenario projections
 - Natural gas prices
 - Environmental policy drivers
 - MISO resource mix and power price range (annual, monthly, and hourly impacts)
- **Developing integrated commodity price, weather, load, renewable output, and thermal resource availability stochastic simulations for the next stakeholder meeting**
- **NIPSCO welcomes stakeholder input on proposed scenario concepts and probabilistic analysis approach**
 - NIPSCO is open to one-on-one calls with stakeholders to discuss analysis in more detail



We exist to deliver safe, reliable energy that drives value to our customers

LUNCH





We exist to deliver safe, reliable energy that drives value to our customers

REFERENCE CASE LOAD FORECAST UPDATE


Pat Augustine, Vice President, CRA

Fred Gomos, Director Strategy, NiSource



RESOURCE PLANNING APPROACH: LOAD GROWTH FORECASTS

Key Modeling and Analysis Tools

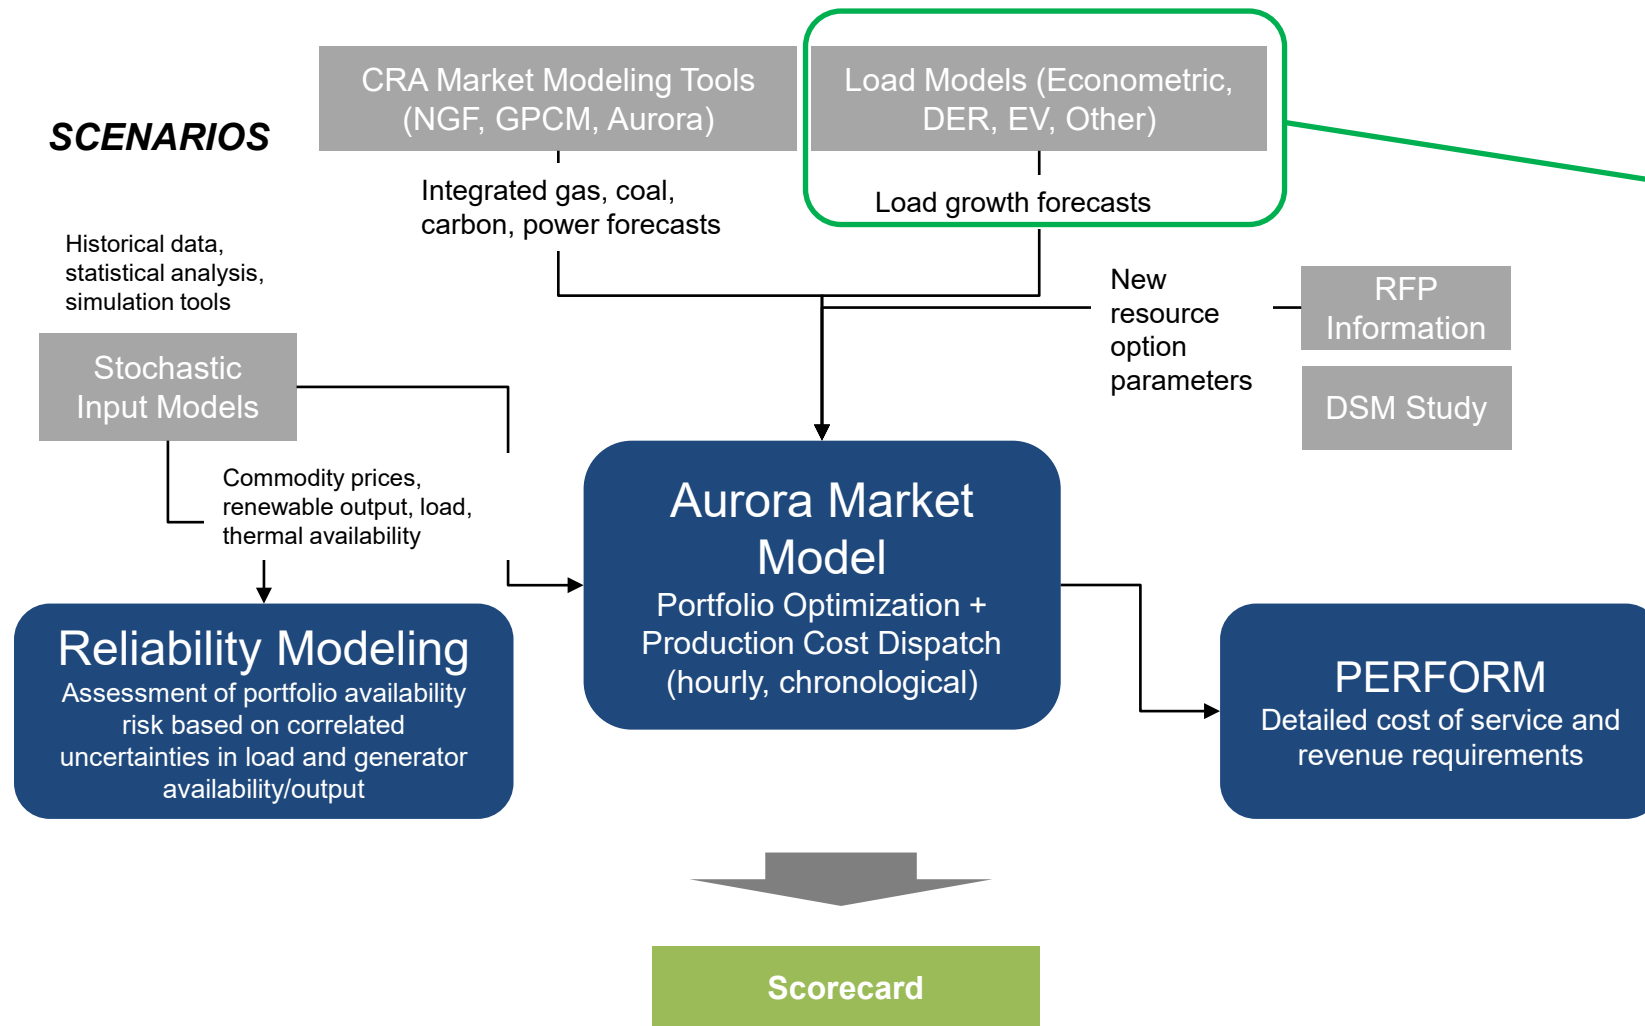

- 1 Identify key planning questions and approach
- 2 Develop market perspectives (scenarios)
- 3 Develop integrated resource strategies (NIPSCO portfolios)
- 4 Portfolio modeling and analysis
 - Detailed scenario dispatch
 - Stochastic simulations
- 5 Evaluate trade-offs and select preferred plan

We exist to deliver safe, reliable energy that drives value to our customers




We exist to deliver safe, reliable energy that drives value to our customers

LOAD FORECAST METHODOLOGY OVERVIEW




FORECASTING METHODOLOGY OVERVIEW

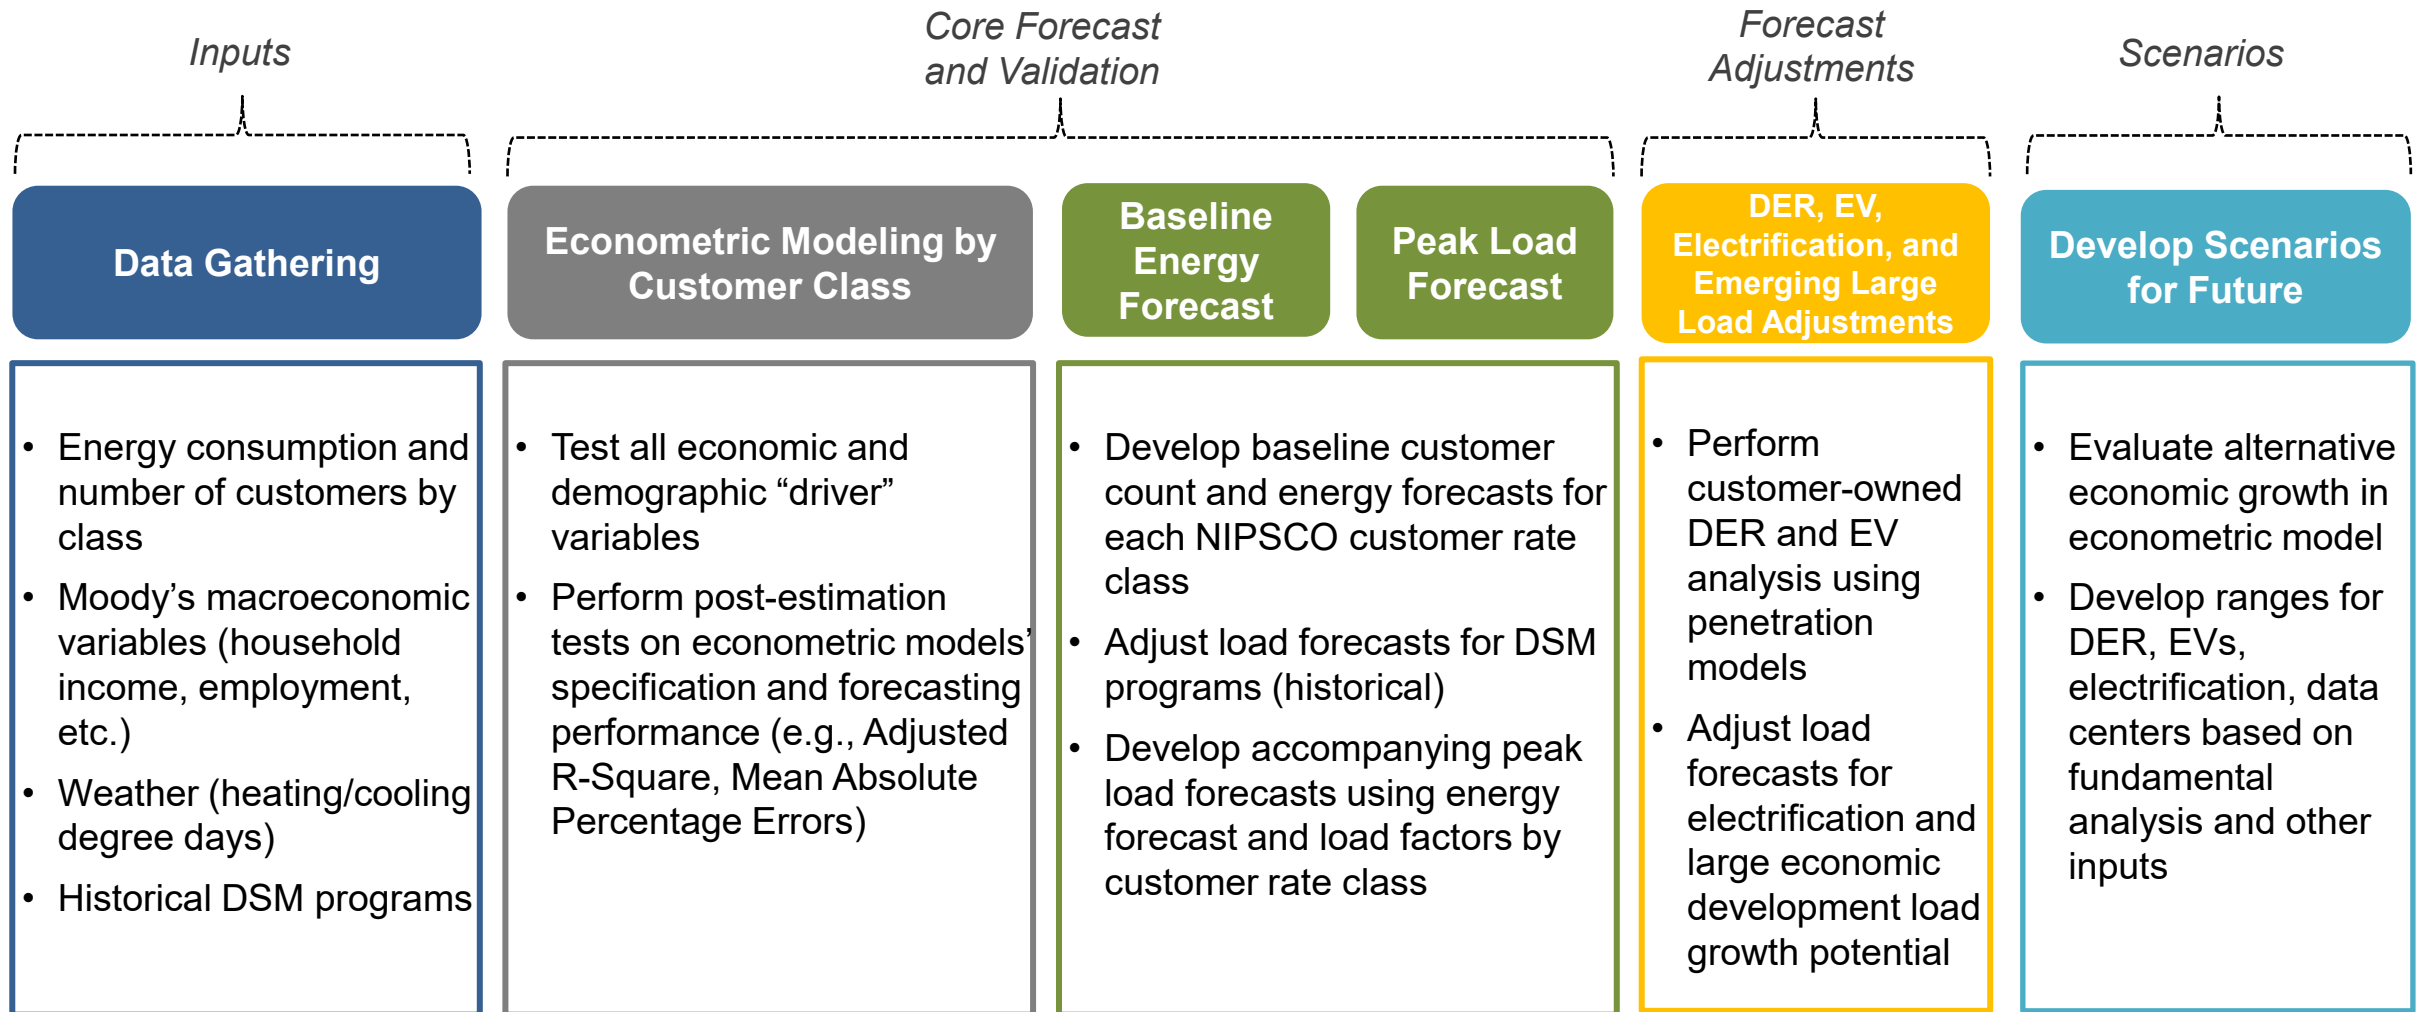

DER MODELING OVERVIEW: DER PENETRATION (PENDER) MODEL

PenDER is an Agent-based model (ABM) that considers NIPSCO customer (“agents”) characteristics, economic decision-making, and social interactions to drive projections of the adoption of DER systems by county


Agent and Network Representation

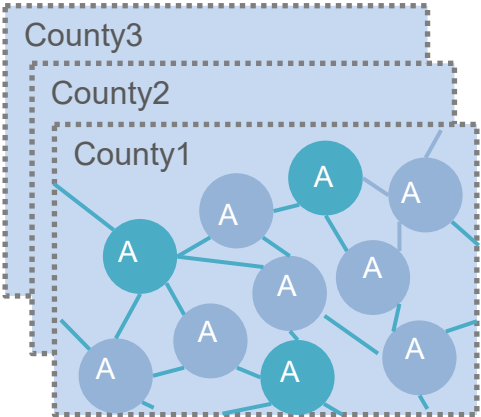

Agents defined by:

Customer Level Data	Individual customer information about DER adoption, location, and customer class (R/C/I)
Socio-Economic Data	Individual customer information on socio-economic status, business type, energy usage

Adoption Decision

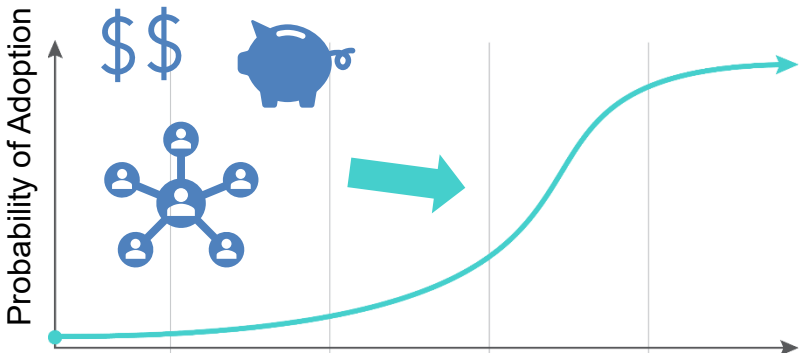

Probability of adoption threshold is met based on:

- Payback period
- Customer budget
- Social network adoption rate

Cumulative DER Adoption



EV FORECASTING OVERVIEW

Penetration Models with Local Datasets

Truck Corridor Charging Tool

Light Duty Vehicle (LDV)

<10,000 lbs

Medium Duty Vehicle (MDV)

10,001 – 26,000 lbs

Heavy Duty Vehicle (HDV)

>26,001 lbs



1. Develop growth estimates based on adoption rates applied to S-curve

2. NREL's EVI-Pro-Lite tool and other sources to develop hourly shapes

Analysis includes data from:



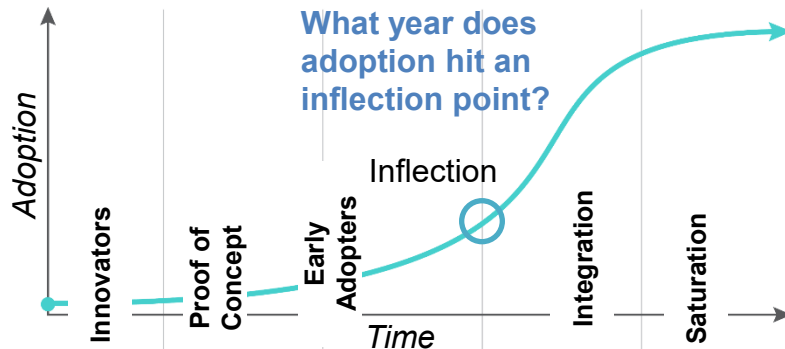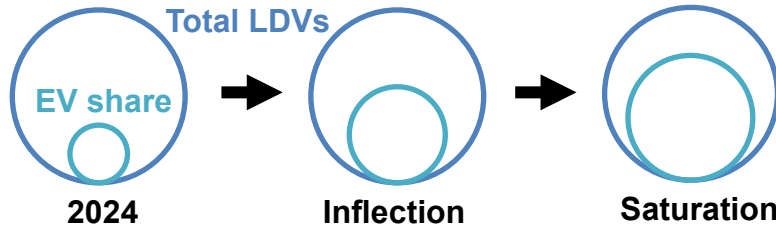


- National Performance Management Research Data Set (NPMRDS) via U.S. Dept of Transportation
- Highway traffic counts from Indiana Dept of Transportation
- Freight Analysis Framework
- Institute of Transportation Engineers Trip Generation Database

3. Develop final hourly load forecast based on adoption rates, temperature, efficiency assumptions, and other variables



We exist to deliver safe, reliable energy that drives value to our customers

DRIVERS OF LOAD UNCERTAINTY

	Scenario Name	Description	Economic Growth (C&R, I Count)	EV Penetration	DER Penetration	Electrification (MISO Futures Report)	Large Econ. Development (Data Center) Load
Today's Focus 	Reference Case	Reference Point	Base Moody's Baseline forecast	Base Rate of Adoption	Base Expected Rate of Adoption	Limited (Future 1)	Base None
	Slower Transition	Environmental policy incentives reduce; economic slowdown in region	Low Moody's Low forecast ↓	Low Rate of Adoption ↓	Lowest High capital costs, low tax credits, low wholesale prices ↓	Limited (Future 1)	Base None
	Domestic Resiliency	Influx of new economic development load (data center focus)	Base Moody's Baseline forecast	Base Rate of Adoption	Lower High capital costs ↓	Limited (Future 1)	High ↑
	Aggressive Environmental Regulation	Aggressive decarbonization policy, moderate electrification	Base Moody's Baseline forecast	High Rate of Adoption ↑	High Net metering policy change ↑	High (Future 2) ↑	Base None
	Accelerated Innovation	Faster energy transition, high electrification with additional econ. dev. (data center) load	Base Moody's High forecast	High Rate of Adoption ↑	High Low capital costs, larger installation sizes ↑	Highest (Future 3) ↑	High ↑

We exist to deliver safe, reliable energy that drives value to our customers



We exist to deliver safe, reliable energy that drives value to our customers

REFERENCE CASE LOAD FORECAST



CORE ELECTRIC SALES FORECAST – ECONOMETRIC PARAMETERS


- Baseline customer count and sales per customer energy forecasts by class are projected with best fitting variables
- CRA tested various macroeconomic variables using Moody's historical and forecast data and selected the presented model based on R-squared, adjusted R-squared, Root Mean Squared Error (RMSE), and Mean Absolute Percentage Error (MAPE)

	Residential	Commercial	Industrial
Customer Count Forecast	Household Income	Household Income, Employment	Manufacturing employment, Metals employment
Baseline Sales per Customer Forecast	Household income, HDD, CDD, seasonal monthly dummies, 2020 and after indicator function	Employment, Manufacturing, CDD, seasonal monthly dummies, 2020 and after indicator function	Seasonal average → decomposed by rate class

Note that large industrial, railroad, street lighting, public authority, and company use forecasts are based primarily on historical trends extrapolated forward

REFERENCE CASE ENERGY SALES / CONSUMPTION


Residential, Commercial, and Industrial customers comprise most energy sales in the Reference Case

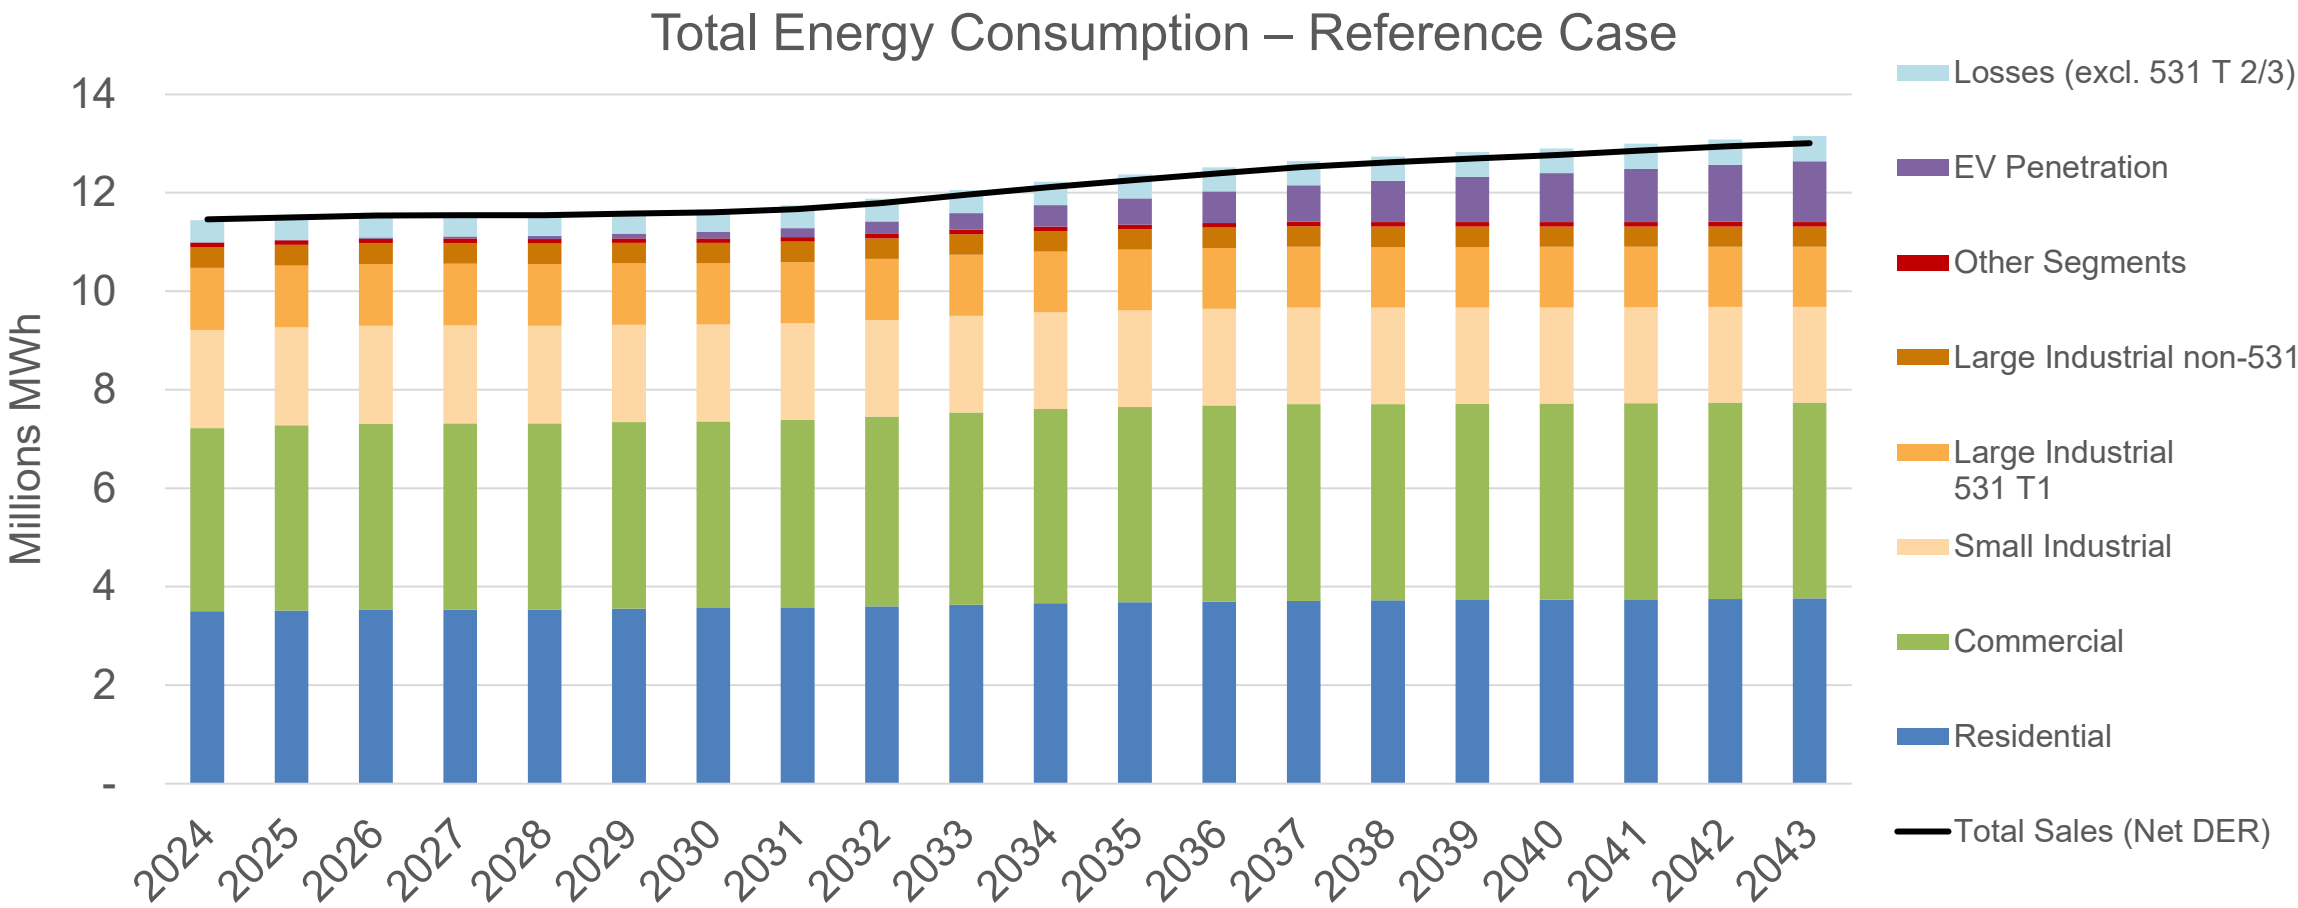

EV = electric vehicles; DER = customer-owned distributed energy resources

PEAK LOAD FORECAST – FOUR MISO PLANNING SEASONS

NIPSCO is expected to remain summer peaking in the Reference Case

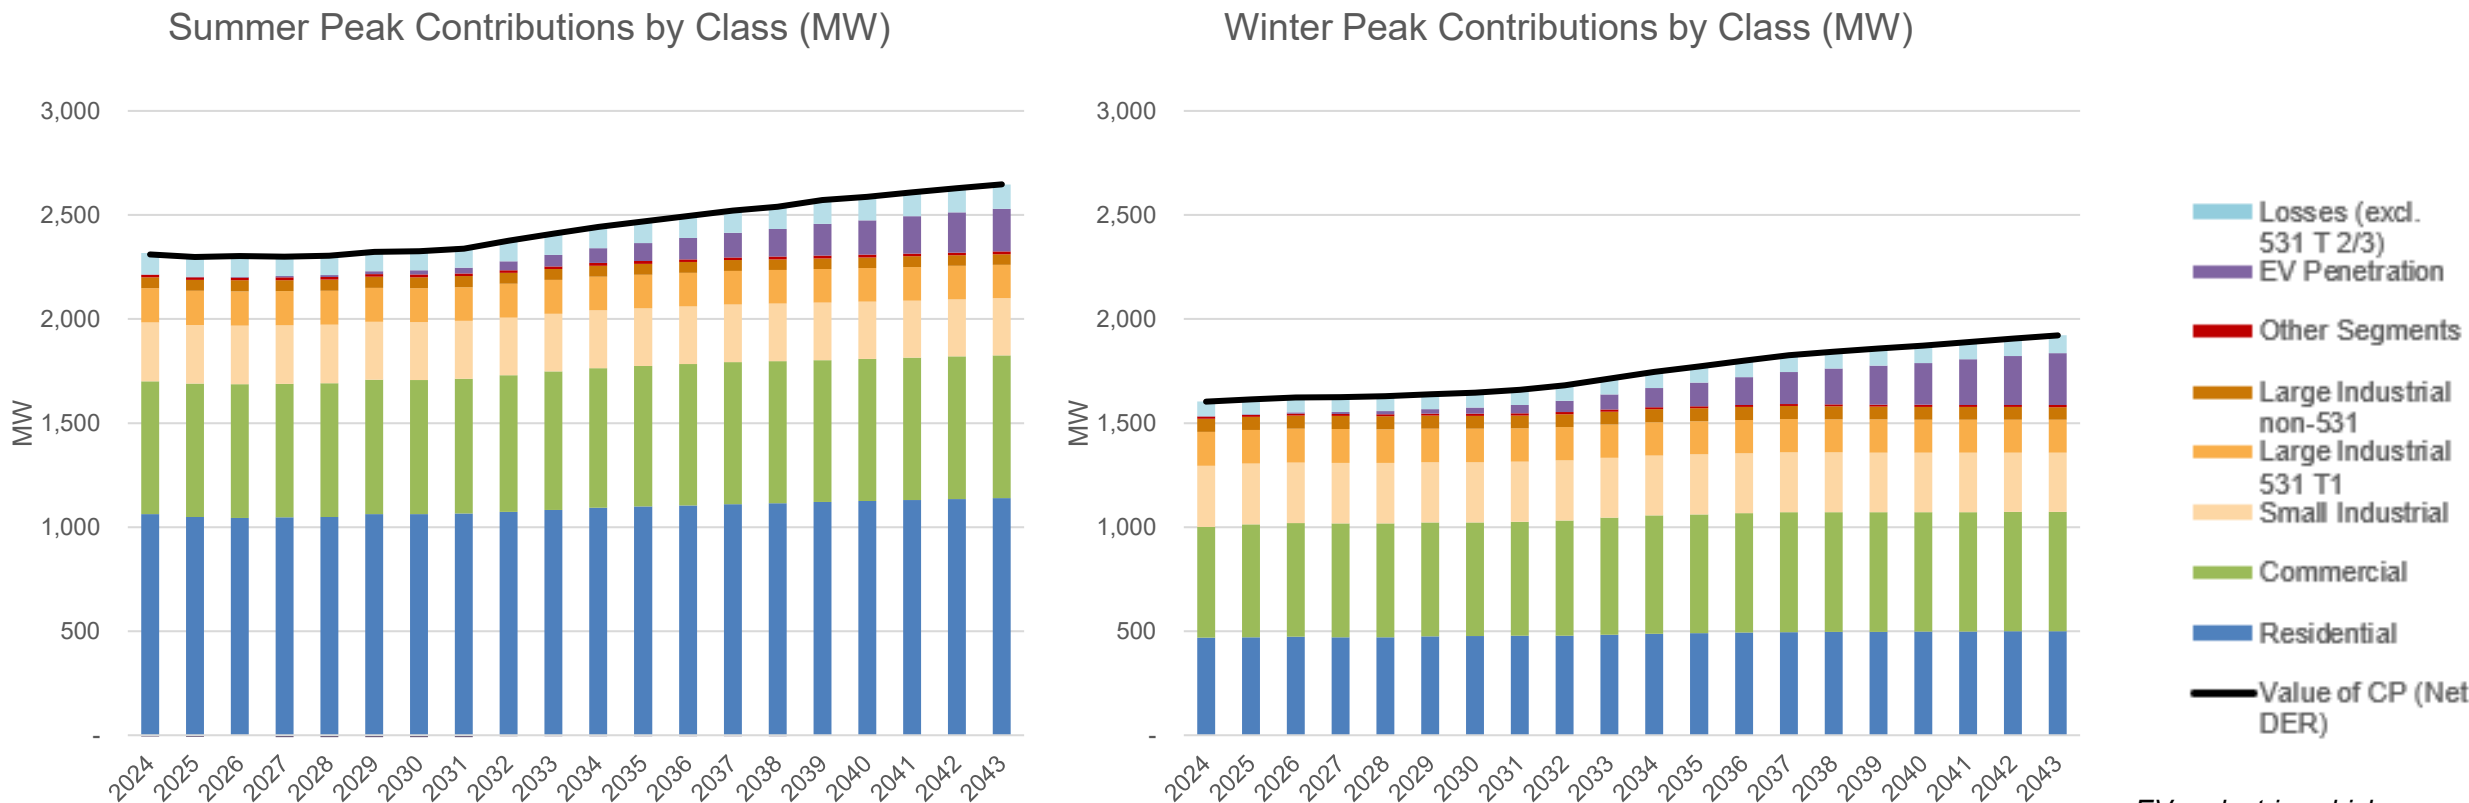


EV = electric vehicles;
DER = customer-owned distributed energy resources
CP = coincident peak for NIPSCO system

We exist to deliver safe, reliable energy that drives value to our customers

PEAK LOAD FORECAST – FOUR MISO PLANNING SEASONS

Fall loads (September) are likely to be much closer to summer peaks than those in Spring

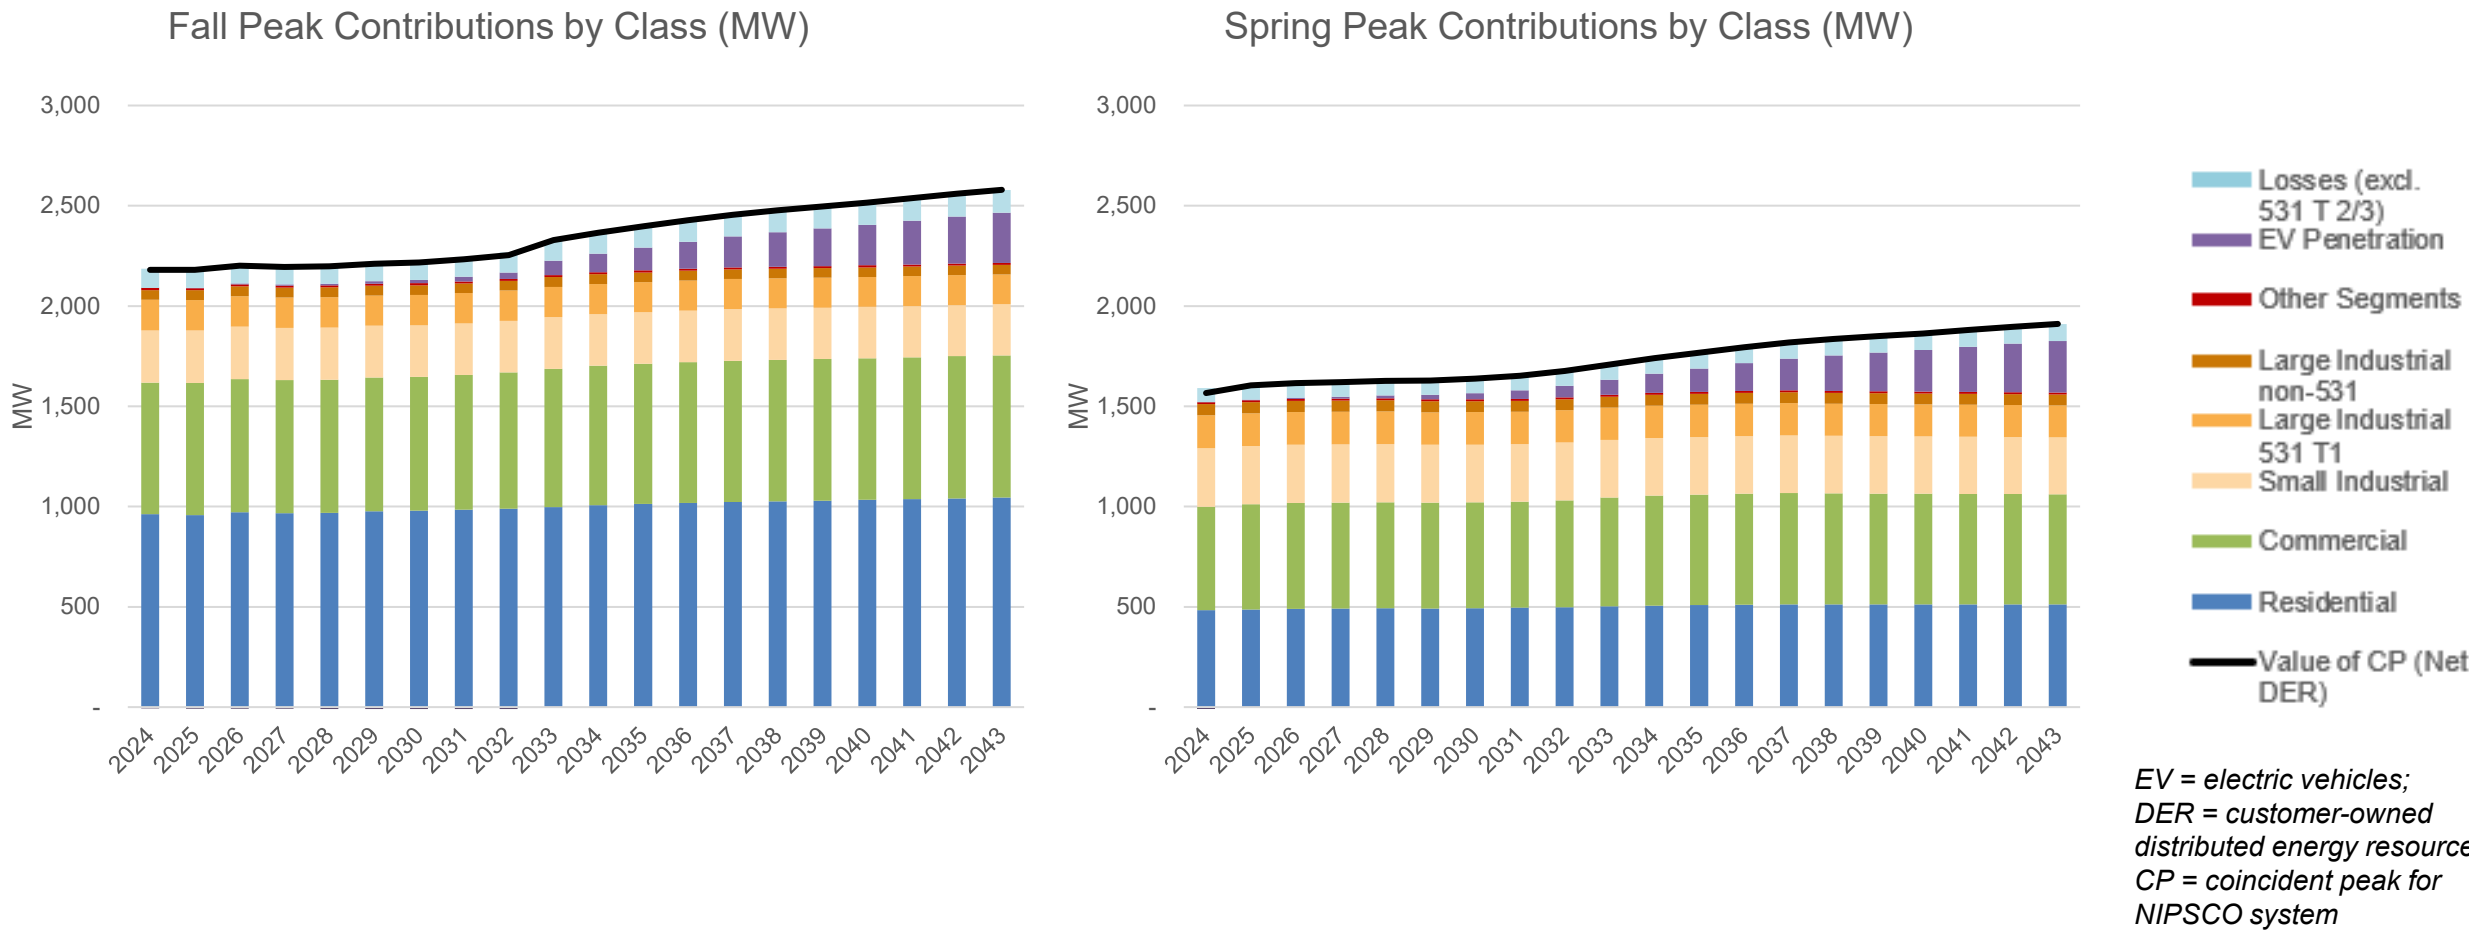

We exist to deliver safe, reliable energy that drives value to our customers



We exist to deliver safe, reliable energy that drives value to our customers

LOAD FORECAST: CUSTOMER-OWNED DER REFERENCE CASE



DER MODELING OVERVIEW: PENDER

PenDER is an Agent Based Model (ABM)

Actions (*adoption decisions*) and interactions (*via social networks*) of thousands of autonomous “agents” are simulated to study their effects on DER adoption by customer class

PenDER is designed to:

- Provide granular forecasting of *DER adoption by demographics*
 - By socioeconomic variables (income, age, etc.) that characterize customer groups
 - By technology index of DER adoption (innovators, early adopters, imitators)
 - By region (county/neighborhood or distribution system designation)
- Simulate adoption *response to DER system costs*
 - Cost of DER is a key determinant of adoption decisions
- Simulate adoption *response to utility or market pricing*
 - Expected retail or wholesale rate growth
 - Financial incentives and costs

PENDER MODEL: KEY ASSUMPTIONS

Avoided Costs / Revenues – Estimated as annual production (based on expected solar capacity factor), in kWh, multiplied by avoided retail rate consumption or the **Excess Distributed Generation (EDG)** rate for excess generation, in \$/kWh.

PV Costs – Estimates rely on National Renewable Energy Laboratory's (NREL) *Annual Technology Baseline* (ATB) capital cost assumptions for Class 5 –PV Residential and Commercial Solar technologies– and are inclusive of expected ITC benefits.

Customer Budget – Assigned to each agent via probability distribution informed by the 2022 American Community Survey (ACS) 5-year census estimates. Customer budget is omitted from commercial forecasts, as agents are assumed to act in best economic interest and can utilize loans.

Payback Time – Based on the upfront capital cost, the cash flow from renewable energy incentives (i.e. EDG rates), discount rate, and solar PV lifetime, the payback period is determined by the number of years of discounted annual revenues that are required to cover the upfront PV system cost.


PENDER MODEL: SUMMARY OF MAJOR ASSUMPTIONS

	Residential	Commercial
Solar Costs	NREL Curve w/ ITC	NREL Curve w/ ITC
Solar Capacity Factor	15.5%	15.5%
Solar Lifetime	25 years	25 years
Avg. System Size	8 kW	125 kW
Discount Rate	7.0%	6.0%
Inflation Rate	2.1%	2.1%

- Solar System Characteristics: NIPSCO-approximated capacity factor assumption for a typical DER solar system is based on NREL data and an assumed 25-year life for solar projects.
- Average Solar System Size: assumption based on average system size from NIPSCO historical solar DER adoption by customer class.
- Financial Inputs: assumes that small customers (i.e. residential) have higher financing costs than larger-scale customers with better access to capital




REFERENCE CASE PROJECTIONS

- Among residential customers, a total of 80 MW of installed Solar DER capacity is projected by 2045
- Among commercial customers, a total of 120 MW of installed Solar DER capacity is projected by 2045

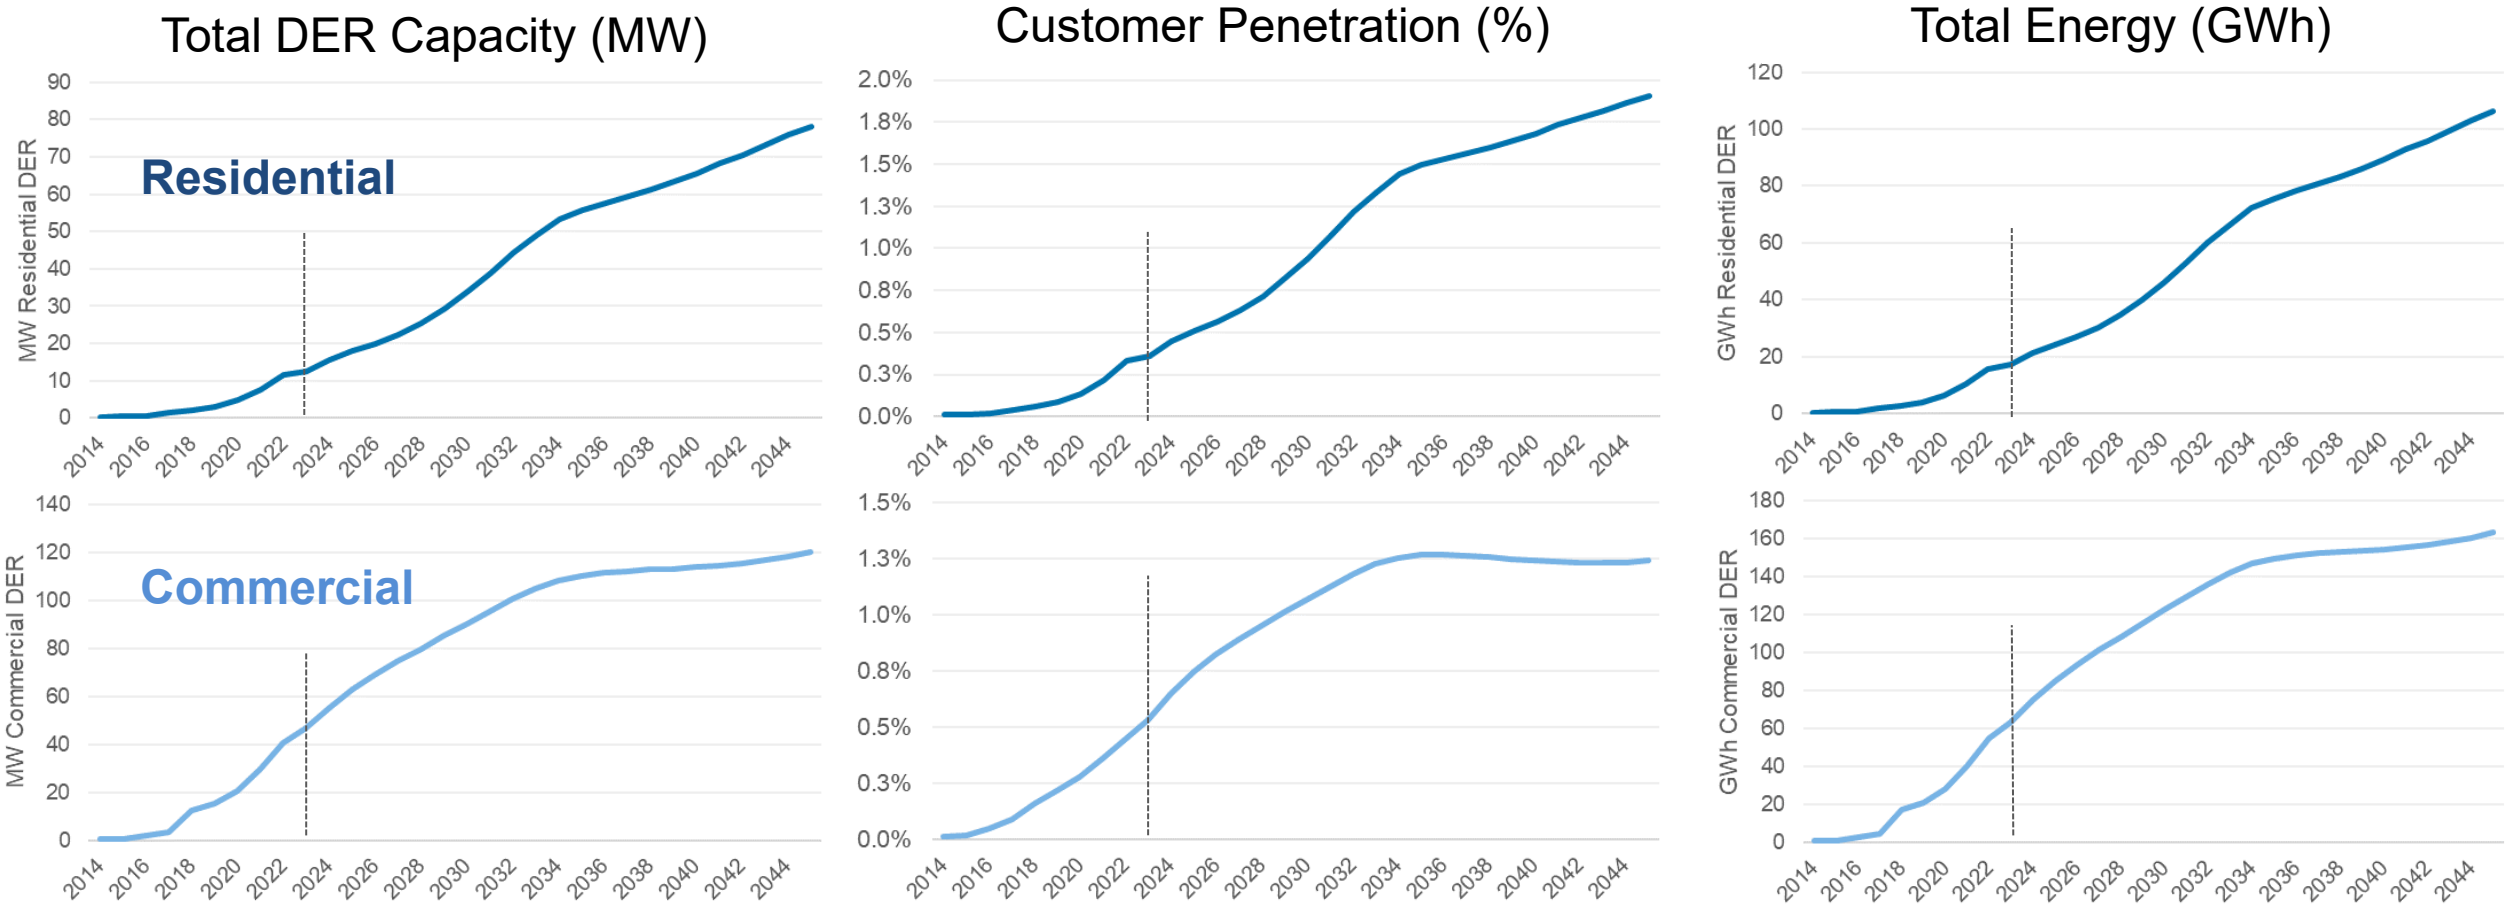



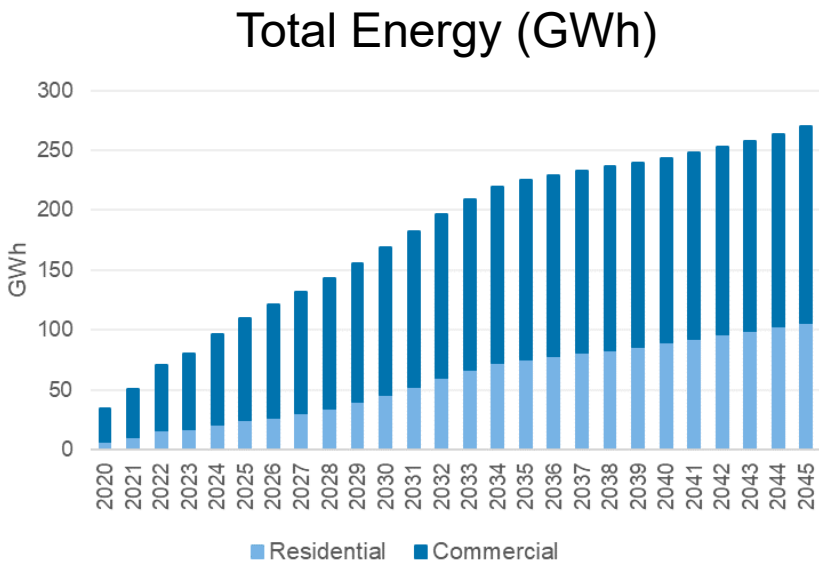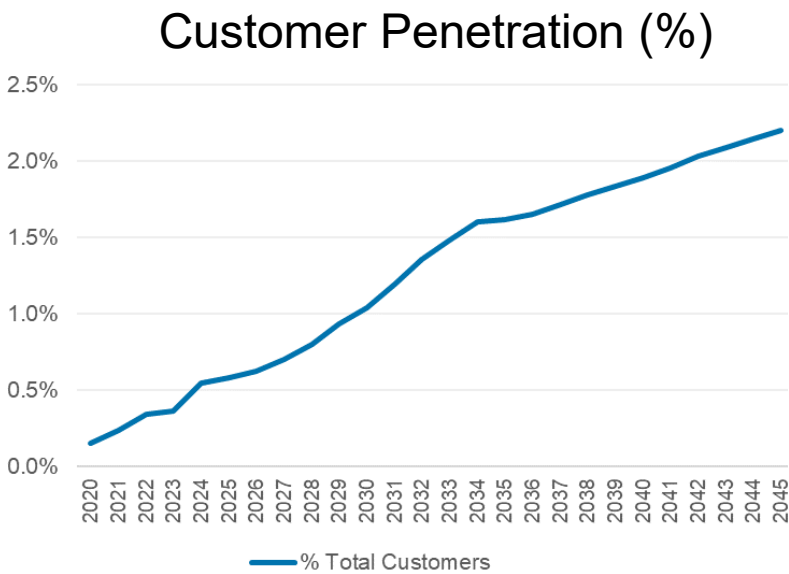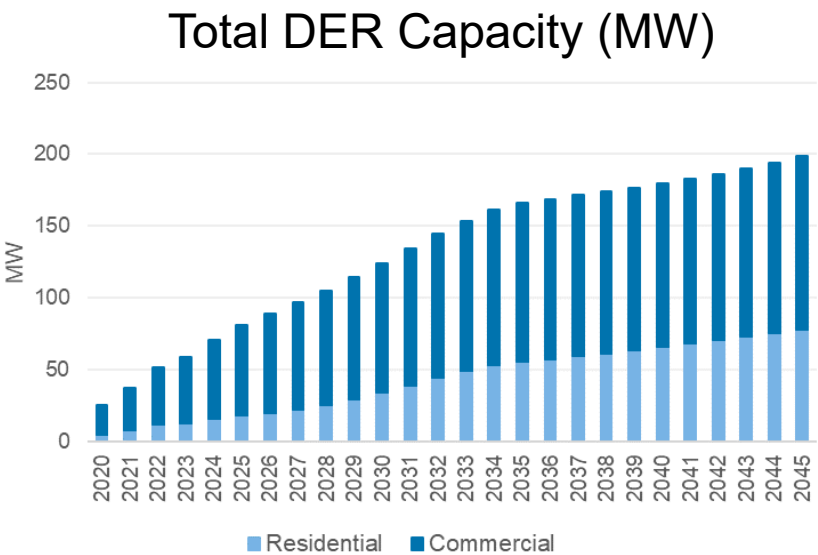


REFERENCE CASE SUMMARY

- Overall, for the Reference Case, a total of 166 MW of installed Solar DER capacity is projected by 2035, 180 MW by 2040, and 200 MW by 2045.



DER SCENARIO CONSIDERATIONS

Scenario Name	Description	Capital Cost for Solar	ITC Incentives	Wholesale Rate Growth	Incentive Structure	DER Installation Size
 Reference Case	Reference Point	Base NREL Reference	Base IRA through 2035	Base	EDG Program Program continues unchanged through the planning horizon	Base Historic socioeconomic trends continue
 Slower Transition	Environmental policy incentives reduce; economic slowdown in region	High NREL Conservative ↑	Low IRA phase-out ↓	Low Lower commodity prices ↓	EDG Program Program continues unchanged through the planning horizon	Base Historic socioeconomic trends continue
 Domestic Resiliency	Influx of new economic development load (data center focus)	High NREL Conservative ↑	Base IRA through 2035	High Higher commodity prices. ↑	EDG Program Program continues unchanged through the planning horizon	High Increasing underlying load growth ↑
 Aggressive Environmental Regulation	Aggressive decarbonization policy, moderate electrification	Base NREL Reference	Base IRA through 2035	Highest Highest gas prices; environmental regulation (high CO ₂ price) ↑	EDG → Net Metering DER adoption encouraged through net metering, or another innovative design ↑	Base Historic socioeconomic trends continue
 Accelerated Innovation	Faster energy transition, high electrification with additional econ. dev. (data center) load	Low NREL Low ↓	Base IRA through 2035	Base Close to base, but model logic transitions to Net Metering	EDG Program Program continues unchanged through the planning horizon	Highest Economy-wide electrification driving larger customer UPC ↑

We exist to deliver safe, reliable energy that drives value to our customers

NEXT STEPS FOR DER ANALYSIS

- **Evaluate DER penetration levels across four alternative scenarios (Slower Transition, Domestic Resiliency, Aggressive Environmental Regulation, Accelerated Innovation)**
- **Integrate analysis with DSM study to assess opportunities for incentives for customer-owned storage installations (i.e., to improve capacity value of DER resources)**



We exist to deliver safe, reliable energy that drives value to our customers


LOAD FORECAST: ELECTRIC VEHICLES REFERENCE CASE



LDV EV LOAD FORECASTING APPROACH

Blends econometric forecast with hourly shapes to capture long-term trends in vehicle growth and charging behavior, while accounting for weather conditions

1. Develop growth estimates based on adoption rates applied to S-curve

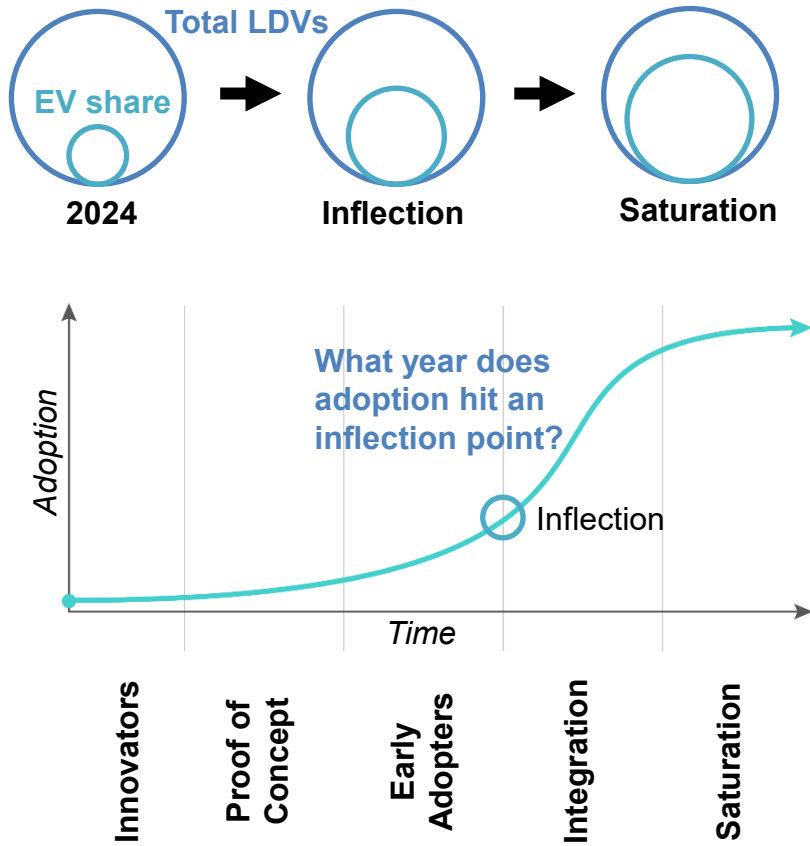

2. NREL's EVI-Pro-Lite tool to develop hourly shapes

- Utilize NREL's EVI-Pro-Lite tool to develop hourly shapes
- Develop profiles to address long-term trends in vehicle type and charger behavior


3. Develop final hourly load forecast based on EV projections and hourly shapes

- Econometric model determines total number of electric vehicles and vehicle efficiency, which will scale total EV demand over each year (Step 1)
- Take seasonal charging profiles and create 8760 shapes

We exist to deliver safe, reliable energy that drives value to our customers

LDV EV ADOPTION PROJECTIONS

Reference LDV adoption trajectory would meet New EPA targets

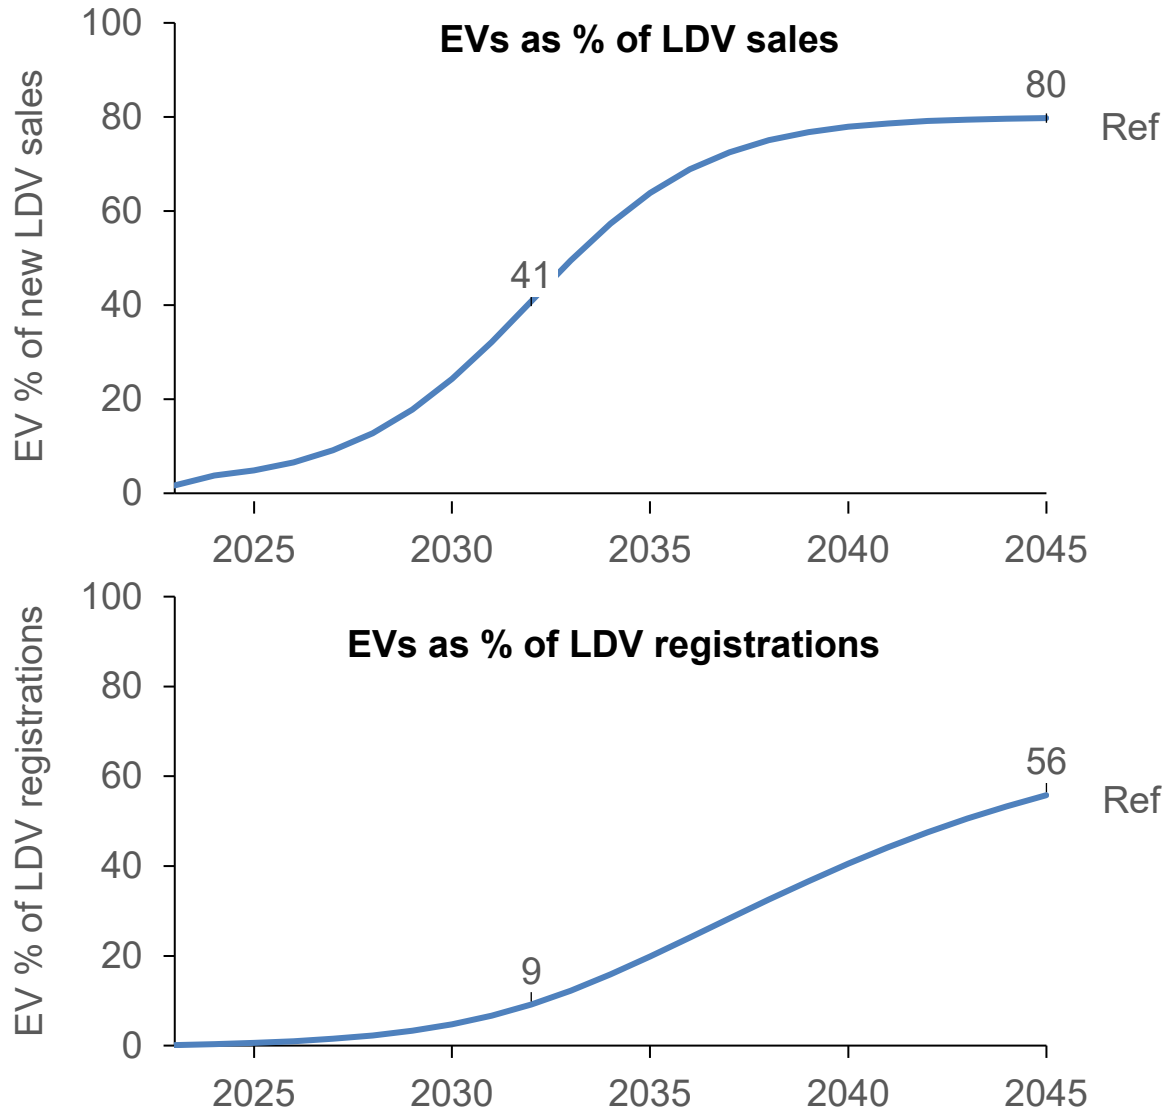

Adoption Overview

- NIPSCO has taken views on how adoption may unfold over time, leveraging current EV data and third-party projections
- Current estimated penetration of ~1.6% of new sales in NIPSCO's service territory (estimate based on analysis of IN Fuel Dashboard data from 2018-2023)
- A sigmoid function is used to create intermediate sales values by year, where the Reference Case reaches an 80% of sales target by 2045

We exist to deliver safe, reliable energy that drives value to our customers

LDV HOURLY SHAPES

Utilizes NREL's EVI-Pro-Lite tool to develop hourly shapes, blending profiles to address long-term trends in vehicle type

As EV adoption becomes more widespread, model forecasts will align with changes in charging behavior and charger / vehicle efficiencies

2024 Load Profile

- Primary home and work charging strategy: *as fast as possible*
- Home charger composition: 20% L1, 80% L2
- Uses EVI-pro default values, assuming same EV efficiency

2030 Load Profile

- Home charger composition: 50% L1, 50% L2
- Efficiency factor applied to dampen the kW per EV required

2040 Load Profile

- Home charger composition: 50% L1, 50% L2
- Continued efficiency factor applied to dampen the kW per EV even more

Other considerations:

- Distinct patterns applied for weekday versus weekend / holiday
- Hourly profile is temperature dependent (nearest 10 degree C)


PROJECTED LDV LOAD IMPACTS OVER TIME

	2024	2030	2040
Total EVs	2,006	33,016	283,967
BEV Sedan Efficiency (mi / kWh)	2.57	3.50	5.00
BEV SUV Efficiency (mi / kWh)	2.30	3.00	4.50
Annual Sales (MWh)	8,243	129,000	866,000
Annual Peak (MW)	2.15	32.3	214.5


Seasonal Coincident Peaks (MW)

	2024	2030	2040
Winter	1.93	28.8	189
Spring	1.93	29.6	194
Summer	1.34	20.2	156
Fall	1.61	28.8	189

2030 weekday profile (kW / vehicle)

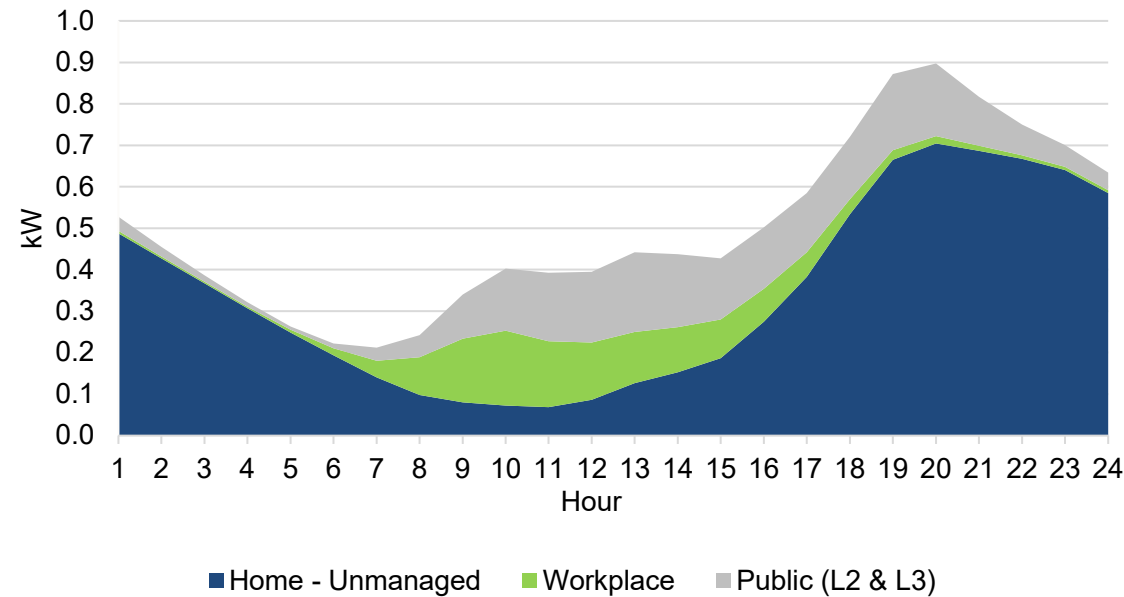

2030 weekend profile (kW / vehicle)


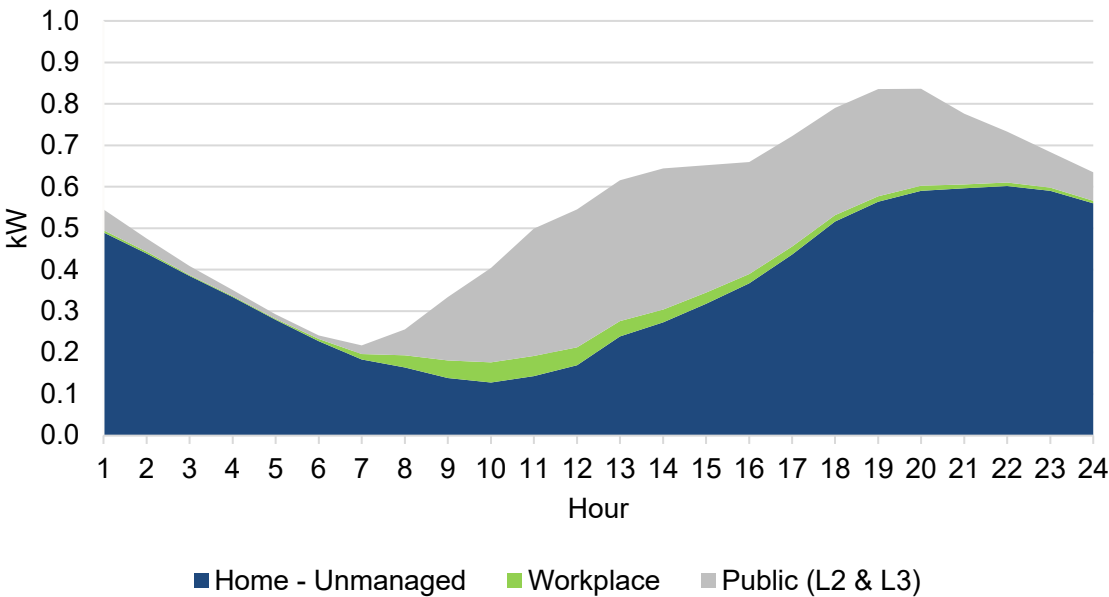


**Note that charging is assumed to be “unmanaged” for LDV segment. DSM analysis will evaluate managed charging programs*

We exist to deliver safe, reliable energy that drives value to our customers

LDV SALES AND COINCIDENT PEAK GROWTH, ASSUMING NO INTERVENTION TO ENCOURAGE MANAGED CHARGING

- A relatively modest peak load impact is expected (<20 MW) until 2030, when an inflection in EV sales heightens overall impact of LDV segment
- Steady growth expected to raise peak contributions to more than 150 MW in the reference case by 2040
- Energy sales roughly mirror peaks, with similar dampening of per vehicle kWh contribution driven by higher vehicle efficiencies

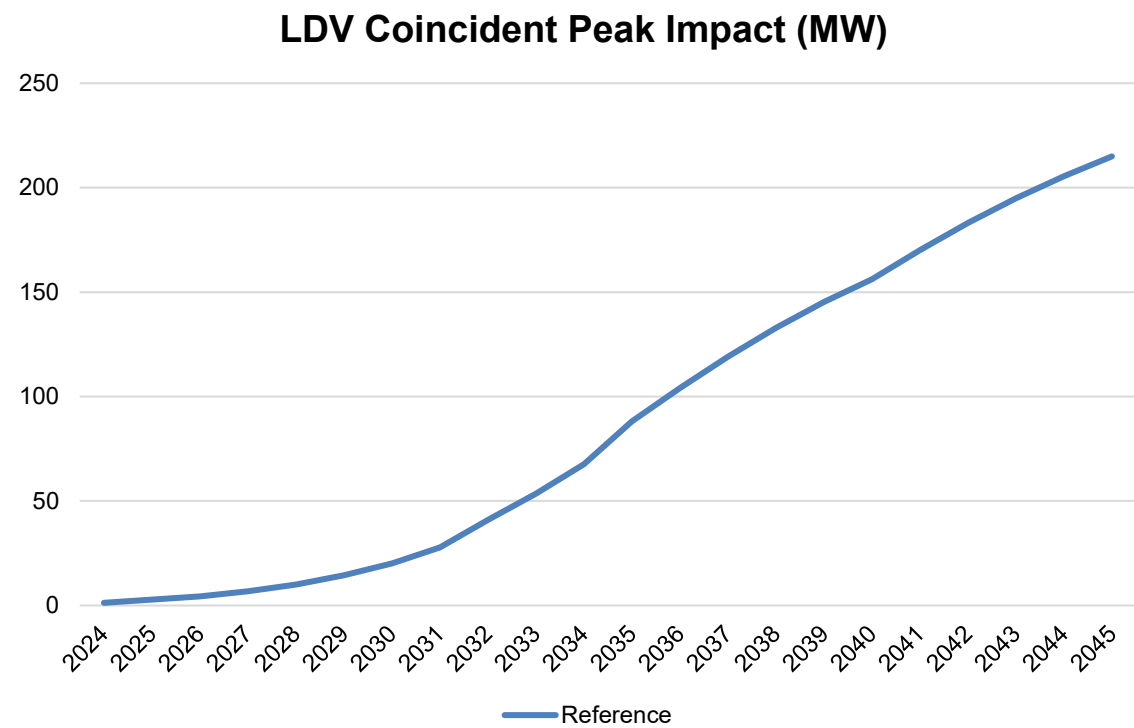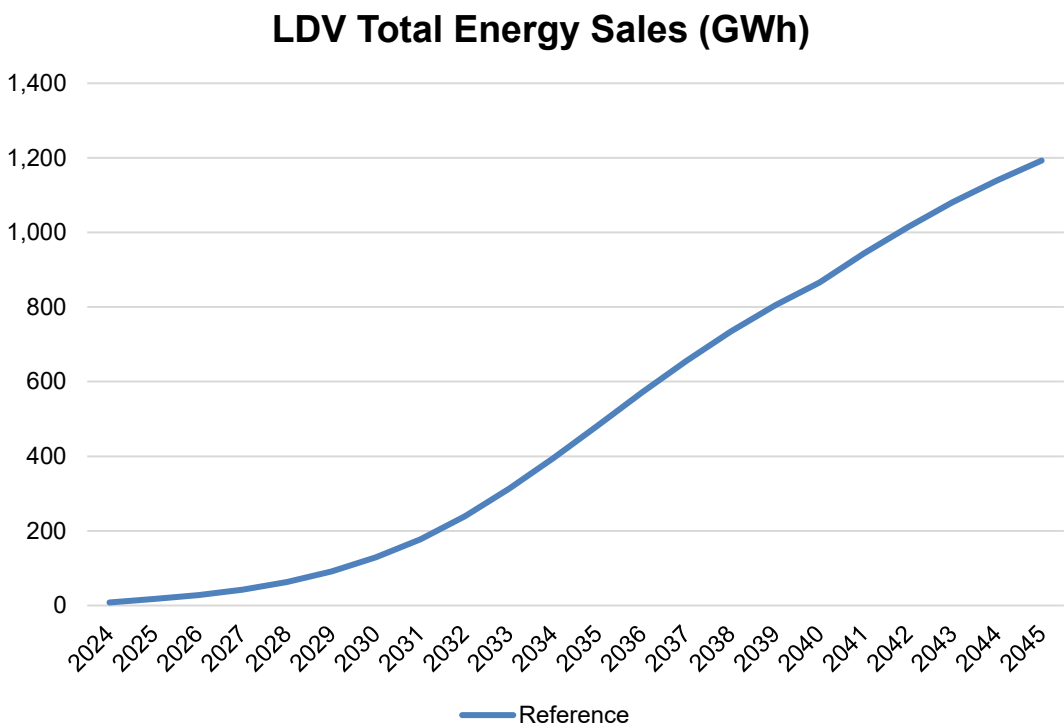


**Note that charging is assumed to be “unmanaged” for LDV segment. DSM analysis will evaluate managed charging programs*

MDV EV LOAD FORECASTING APPROACH

Blends econometric forecast with hourly shapes to capture long-term trends in vehicle growth and charging behavior, while accounting for weather conditions

1. Develop growth estimates based on adoption rates applied to S-curve

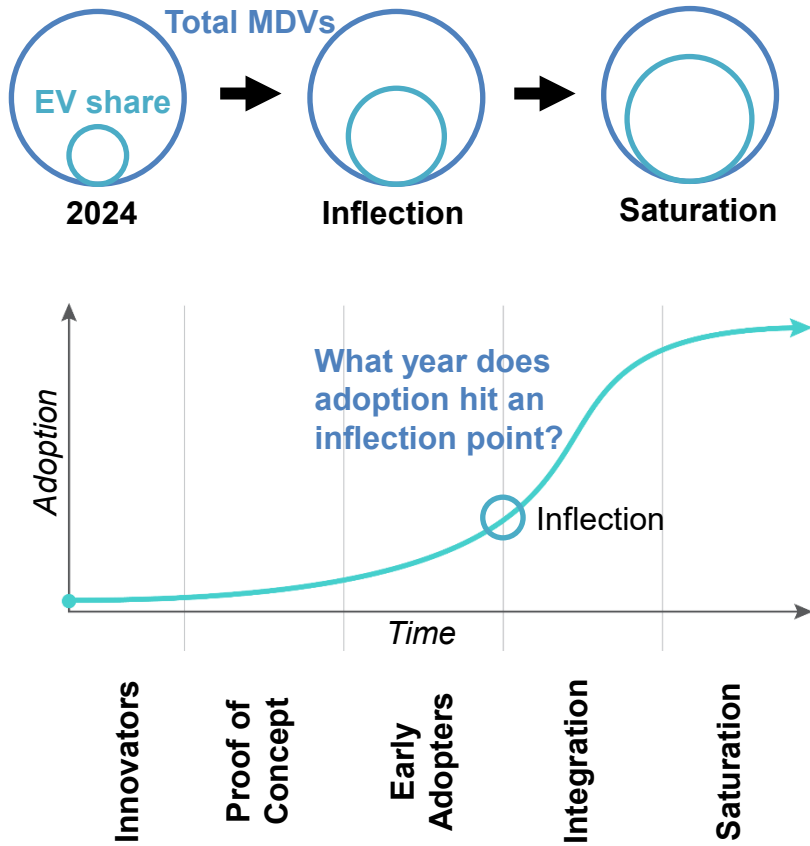

2. Generic MDV shapes to capture potential hourly dynamics


- Utilize charging shapes from existing industry / academic research
- Apply temperature and vehicle efficiency assumptions to create seasonal and long-term adjustments to shape
- Develop profiles to address long-term trends in vehicle type and charger behavior

3. Develop final hourly load forecast based on EV projections and hourly shapes

- Econometric model determines total number of electric vehicles and vehicle efficiency, which will scale total EV demand over each year (Step 1)
- Take seasonal charging profiles and create 8760 shapes

We exist to deliver safe, reliable energy that drives value to our customers

MDV EV ADOPTION PROJECTIONS AIM TO ASSESS CUSTOMER FLEET ELECTRIFICATION

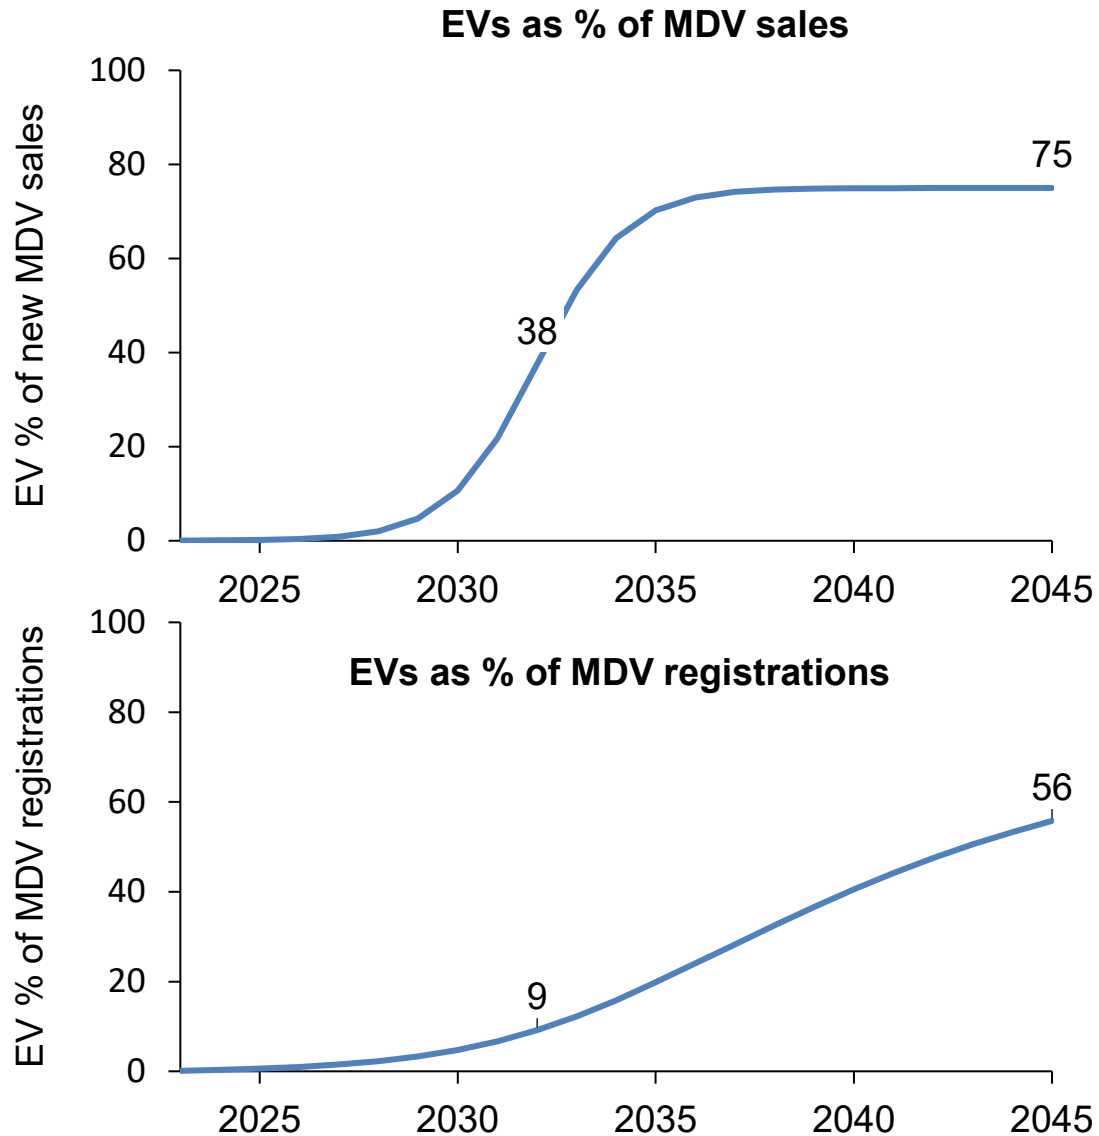

Adoption Overview

- NIPSCO has utilized IN Fuel Dashboard ICE and EV registration data to develop an estimate of the existing EV penetration and ICE fleet and has taken a view on how adoption may unfold over time, leveraging third-party studies
- Current fleet electrification is very small, based on analysis of IN Fuel Dashboard data from 2018-2023
- A sigmoid function is used to create intermediate sales values by year, where the Reference Case achieves a 75 % of sales target by 2045

We exist to deliver safe, reliable energy that drives value to our customers


PROJECTED MDV LOAD IMPACTS OVER TIME

Takeaways

- Overall impacts from MDV fleet likely to be modest until the longer-term
- Some level of managed charging is likely to lower evening peak load, distributing impacts to 12am – 2am



	2030	2040
Total Fleet/Delivery Vehicles	167	8,939
Total Transit Vehicles	4	170
Fleet/Delivery Efficiency (kWh / mi)	1.18	1.05
Transit Efficiency (kWh / mi)	0.81	0.73
Fleet/Delivery VMT / day	37	37
Transit VMT / day	55	55
Annual Sales (MWh)	2,923	130,000
Annual Peak (MW)	0.81	40.6
Coincident Peak (MW)	0.23	7.38

2030 Weekday Profile (kW / vehicle)

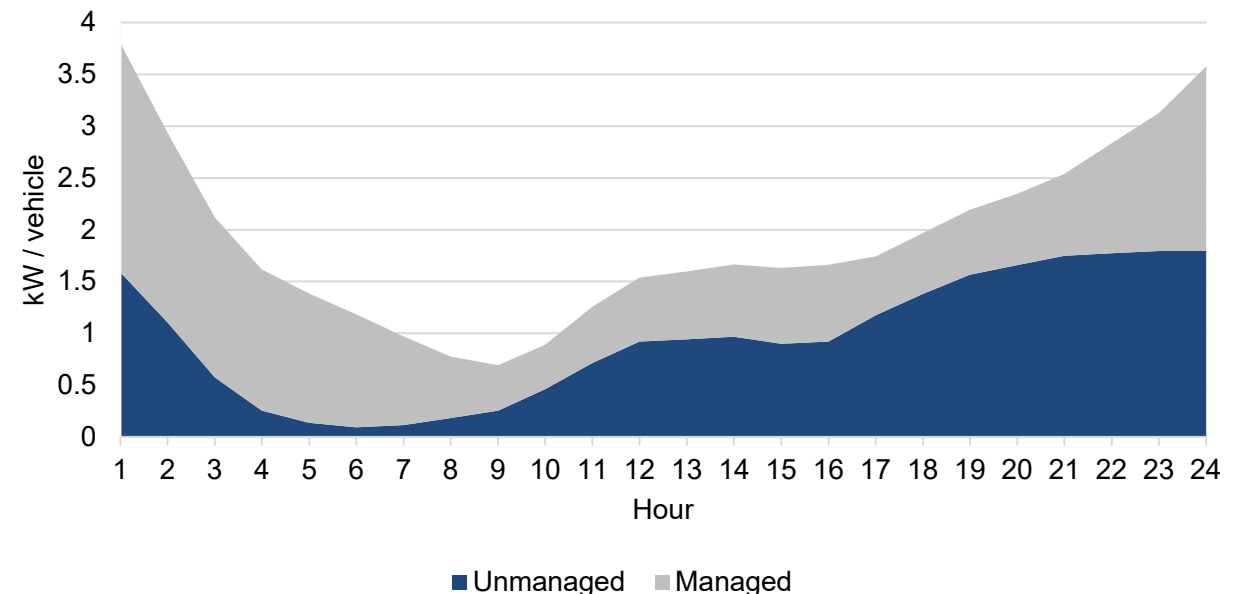



MDV FORECAST: SALES AND COINCIDENT PEAK GROWTH

- MDV are expected to have modest energy sales and load impacts, with roughly 10% of the demand seen in the LDV segment
- Energy sales roughly mirror peaks, with similar dampening of per vehicle kWh contribution driven by higher vehicle efficiencies

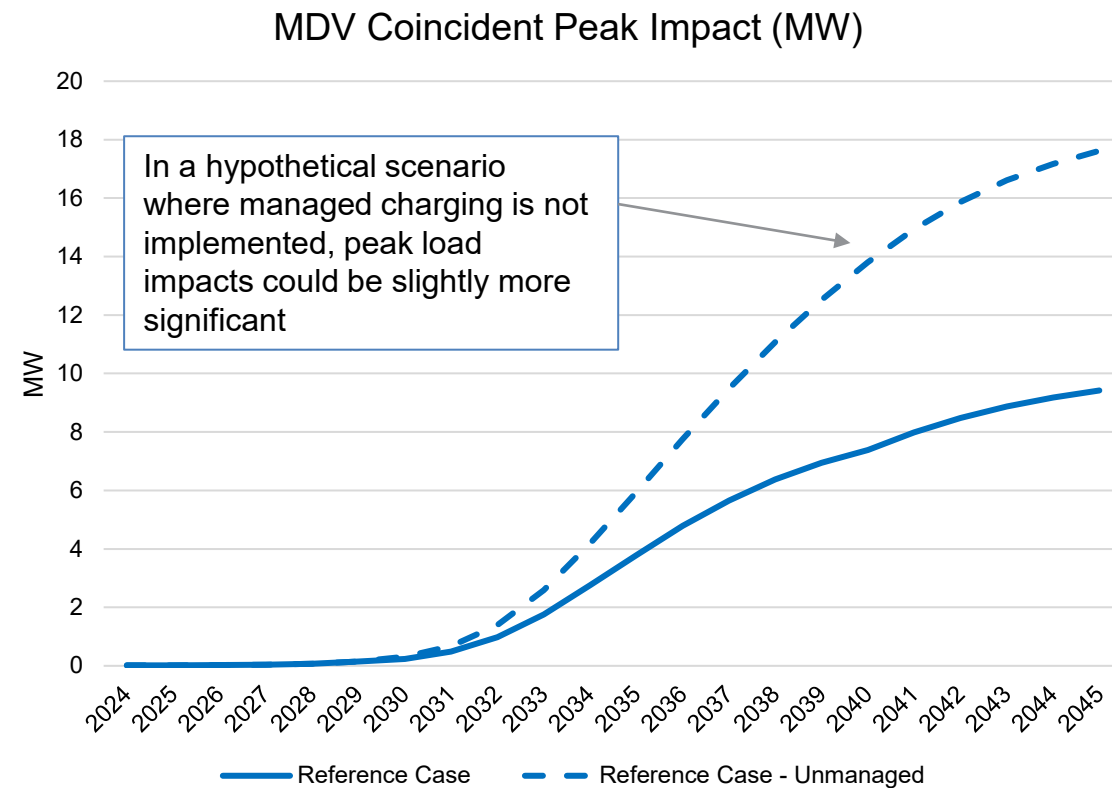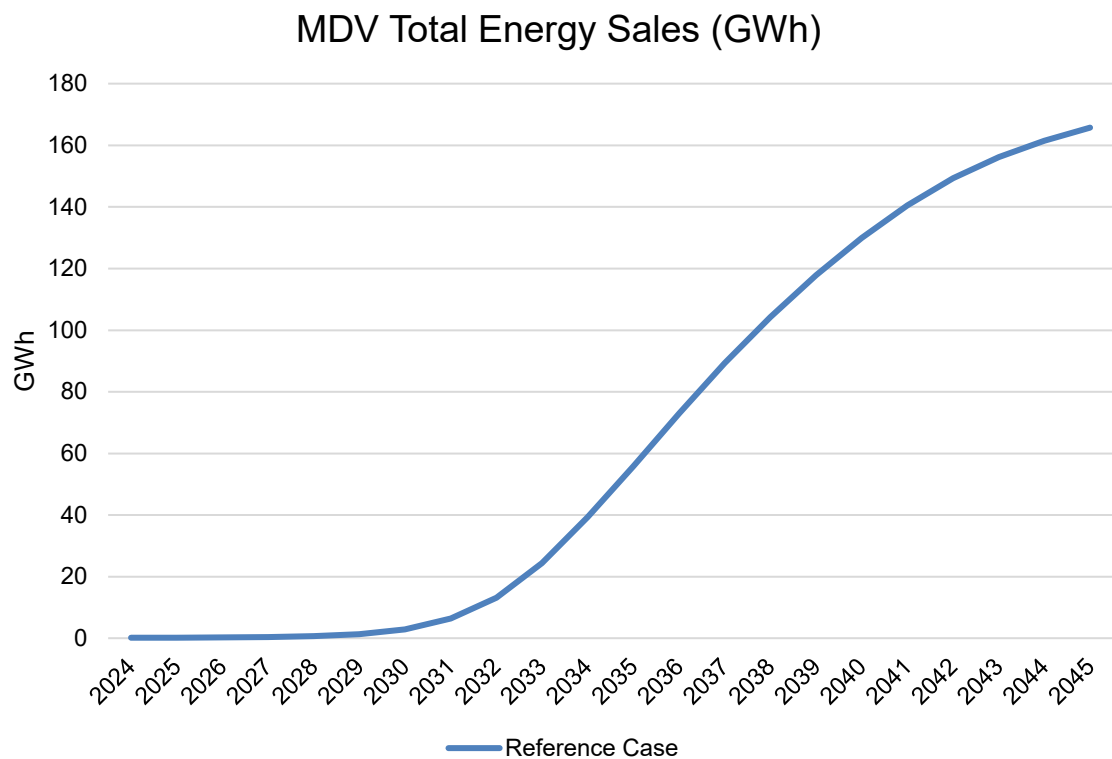

WHILE EV ADOPTION IS EXPECTED TO MEET EPA TARGETS IN THE REFERENCE CASE, EV'S HAVE A RELATIVELY MODEST IMPACT ON ENERGY AND PEAKS

- EV energy demand is expected to grow modestly through the mid-2020s, taking off more significantly in the 2030s as EV options and charging infrastructure proliferate
- While EV adoption is expected to reach 80% of LDV sales and 75% of MDV sales by 2045, they are only expected to contribute to ~7% of coincident peak by 2045 in the Reference Case

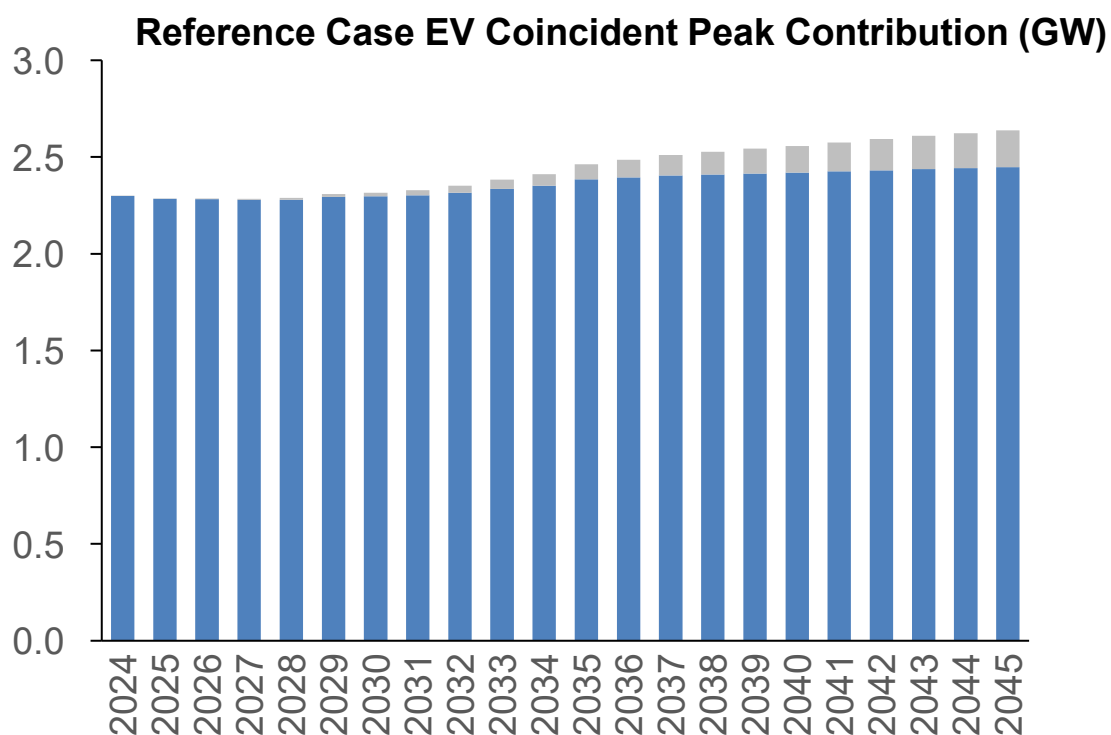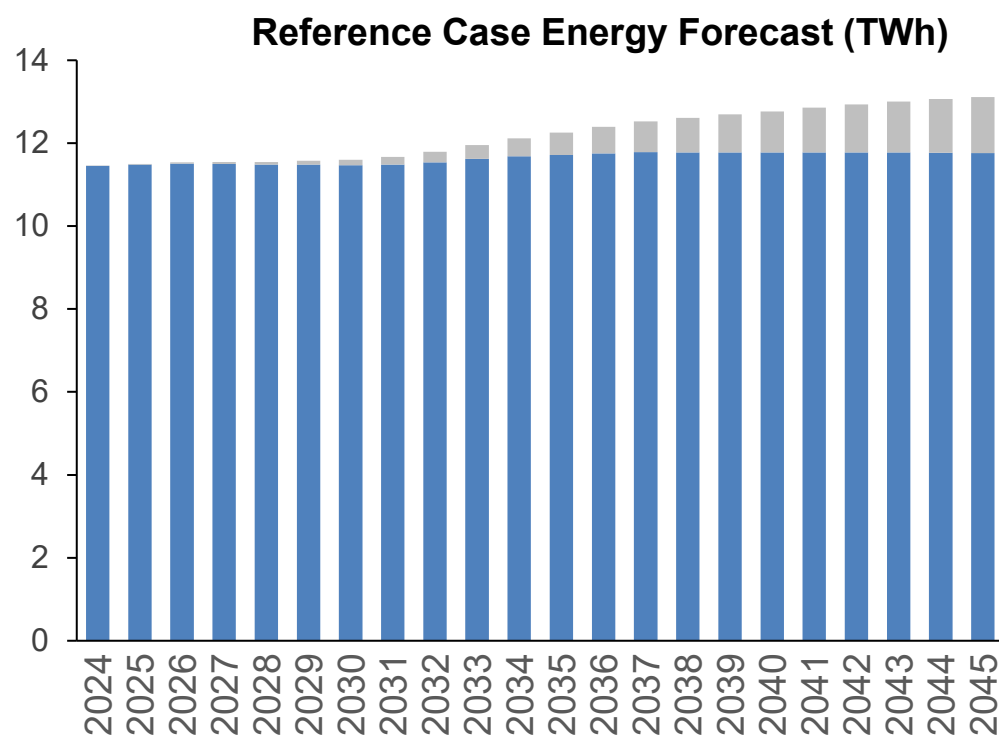

EV Demand Other Energy

We exist to deliver safe, reliable energy that drives value to our customers

NEXT STEPS FOR EV FORECAST

- Evaluate higher and lower EV penetration levels to map to four alternative scenarios (Slower Transition, Domestic Resiliency, Aggressive Environmental Regulation, Accelerated Innovation)
- Perform study on heavy duty vehicle charging in major transit corridors
- Integrate analysis with DSM study to assess opportunities for managed charging incentives in the LDV segment

NEXT STEPS FOR LOAD FORECAST

- Investigate various levels of DER and EV penetration
- Evaluate transitory charging in the NIPSCO service territory associated with heavy duty vehicles on major highways
- Investigate new load growth driven by new manufacturing and economic development opportunities
- Develop full load forecast scenario range for all key drivers
- Coordinate with DSM team so that evaluations of managed EV charging and customer-owned storage incentives can be studied as part of the portfolio analysis
- NIPSCO welcomes stakeholder input on analysis approach and scenario considerations
 - NIPSCO is open to one-on-one calls with stakeholders to discuss analysis in more detail



We exist to deliver safe, reliable energy that drives value to our customers

BREAK





We exist to deliver safe, reliable energy that drives value to our customers

2024 REQUEST FOR PROPOSALS (RFP) UPDATE


Patrick d'Entremont, Manager Planning Commercial Support, NIPSCO

Bob Lee, Vice President, CRA



RESOURCE PLANNING APPROACH: RFP INFORMATION

Key Modeling and Analysis Tools

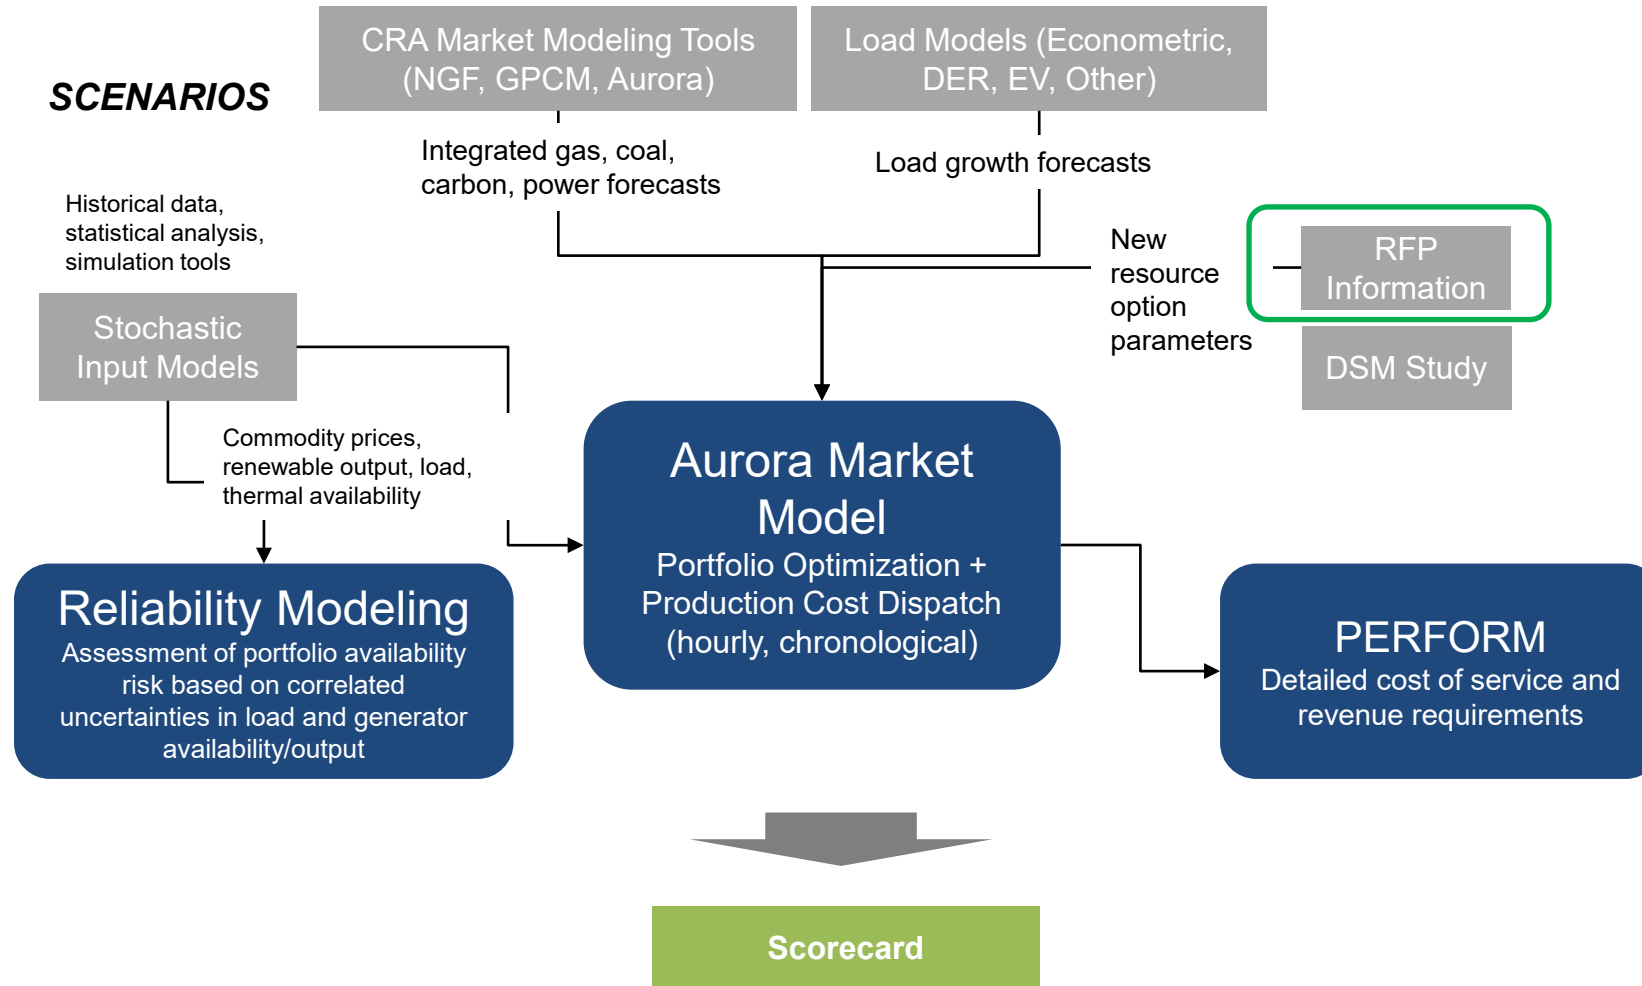


- 1 Identify key planning questions and approach
- 2 Develop market perspectives (scenarios)
- 3 Develop integrated resource strategies (NIPSCO portfolios)
- 4 Portfolio modeling and analysis
 - Detailed scenario dispatch
 - Stochastic simulations
- 5 Evaluate trade-offs and select preferred plan

We exist to deliver safe, reliable energy that drives value to our customers

RFP PROCESS: CONSISTENT WITH 2018 AND 2021, NIPSCO PLANS TO RUN AN RFP AS A PART OF THE 2024 IRP

Integrated IRP to RFP structure

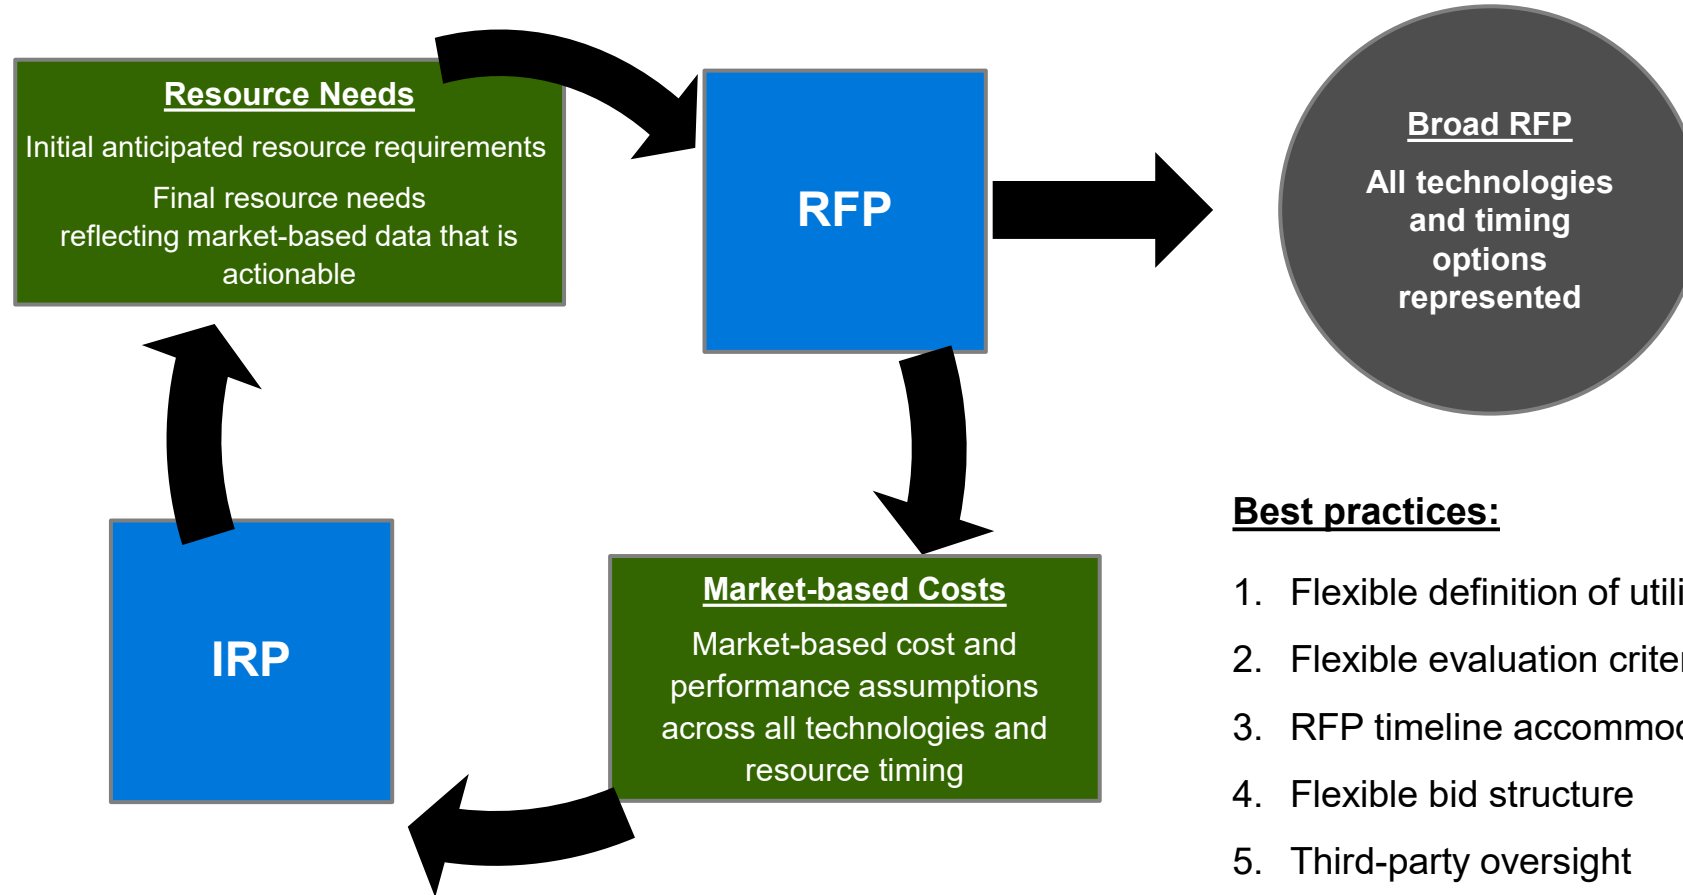

Best practices:

1. Flexible definition of utility needs
2. Flexible evaluation criteria
3. RFP timeline accommodates IRP modeling requirements
4. Flexible bid structure
5. Third-party oversight

OVERVIEW OF NIPSCO'S 2024 RFP PROCESS

- During Q2 2024 NIPSCO intends to issue a series of RFP solicitations designed to identify resources positioned to support the Company's near and long-term resource requirements
- Each individual solicitation will be executed in parallel as part of the RFP and will target specific technologies and resource categories
- As has been done in the past, the asset cost data, and performance and resource availability data derived from RFP bids will be used as inputs into the Company's resource planning process to create a "Preferred Plan" informed by actual market data

PRELIMINARY RFP PLAN

----- All-Source RFP -----

Element	RFP1 – Intermittent	RFP2 – Dispatchable	RFP3 – Bridge Resources	RFP4 – DER
Technology	Renewables and hybrid resources	Thermal, standalone storage, emerging technologies and other (including long-duration storage and NIPSCO site-specific storage options)	Near-term bridge resources that provide both energy and capacity solutions designed to respond to large-scale, new customer activity	Distributed energy resources that qualify for IRA incentives and/or provide MISO capacity credit
Event Size	Up to 400 MW	Up to 600 MW	Between 600-1,000 MW	Up to 10 MW
Ownership Structure	Unit contingent PPA, BTA, existing asset sales	Unit contingent PPA, system power, BTA, existing asset sales, shaped products. Site-specific storage solutions must be for NIPSCO ownership per MISO generator replacement rules	ZRC, PPA, shaped or financial products, unit contingent PPA, BTA, existing asset sales	Unit contingent PPA, existing asset sales
Duration	Targeting resources in 36-60 months with 5+ years duration	Targeting resources in 36-60 months with 5+ years duration	Targeting resources in 18-36 months with 3 to 5+ years duration, and long-term resources in the 5+ year horizon	Targeting resources in 36-60 months with 5+ years duration
Deliverability	LRZ6, NRIS, (N-1-1)	LRZ6, NRIS, (N-1-1)	Flexible	Distribution resources
Qualification Requirements	Credit worthy counterparties	Credit worthy counterparties	Credit worthy counterparties	Credit worthy counterparties

We exist to deliver safe, reliable energy that drives value to our customers

RFP: PRELIMINARY EVALUATION CRITERIA



Project Economics LCOE / LCOC

The economic analysis will be conducted over a fixed planning horizon and a bid-specific planning horizon for all assets. The analysis will reflect all expected costs related to the bid. The project-level analysis will be based on data submitted with the bids, standard assumptions for key commodity considerations, and may reflect adjustments for material uncertainties associated with a bid



Reliability and Deliverability

The asset reliability and deliverability evaluation will include an assessment of transmission reliability, facility age and performance, and fuel risk and fuel security. Transmission reliability scoring will be based on transmission infrastructure and location. Facility performance will be based on the EFORD performance or other accreditation expectations. Fuel reliability will consider fuel availability risk and price volatility



Development

Development risk will consider how many key development milestones have been met to date, as well as the development experience of the potential counterparty



Asset Specific Benefits / Risks

Asset-specific benefits and risks will consider individual, unique, and project-level risks associated with an individual project or counterparty. CRA will evaluate projects based on community benefits, certain social justice goals, minority and women owned business considerations, unique environmental considerations, specific regulatory risks or other considerations

We exist to deliver safe, reliable energy that drives value to our customers

PRELIMINARY RFP TIMELINE

----- All-Source RFP -----

Element	RFP1 – Intermittent	RFP2 – Dispatchable	RFP3 – Bridge Resource	RFP4 – DER
Issue RFP	May 1, 2024	May 1, 2024	May 1, 2024	May 1, 2024
Bidder Information Session	May 6, 2024	May 6, 2024	May 6, 2024	May 6, 2024
Pre-Qualification Deadline	May 15, 2024	May 15, 2024	May 15, 2024	May 15, 2024
Notification of Pre-Qualification	May 20, 2024	May 20, 2024	May 20, 2024	May 20, 2024
Proposals Due	June 7, 2024	June 7, 2024	June 7, 2024	June 20, 2024



We exist to deliver safe, reliable energy that drives value to our customers

2024 STAKEHOLDER ADVISORY PROCESS

Fred Gomos, Director Strategy, NiSource



Tentative 2024 STAKEHOLDER ADVISORY MEETING ROADMAP

Meeting	Meeting 1 April 23rd	Meeting 2 June 24 th	Meeting 3 August 21 st	Meeting 4 September 19 th	Meeting 5 October 8 th
Content	<ul style="list-style-type: none"> • 2021 Short Term Action Plan Update • Resource Planning and 2024 Continuous Improvements • 2024 Public Advisory Process • 2024 Policy Update (incl. IRA and EPA) • Core demand forecast, new considerations for demand • Scenario Themes – Introduction • RFP Overview 	<ul style="list-style-type: none"> • MISO Regulatory Developments and Initiatives • Update on Key Inputs/Assumptions (commodity prices) • Scenarios and Stochastic Analysis Inputs • Preliminary RFP Results 	<ul style="list-style-type: none"> • DSM Modeling and Methodology • DER Inputs 	<ul style="list-style-type: none"> • Modeling Results, Scorecard • DER and Storage Modeling Results, Scorecard 	<ul style="list-style-type: none"> • Preferred replacement path and logic relative to alternatives • 2024 NIPSCO Short Term Action Plan
Meeting Goals	<ul style="list-style-type: none"> • Communicate what has changed since the 2021 IRP (incl. IRA changes) • Communicate environmental policy considerations • Communicate updates to key inputs/assumptions • Provide RFP Overview • Communicate the 2024 public advisory process, timing, and input sought from stakeholders 	<ul style="list-style-type: none"> • Common understanding of MISO regulatory updates • Communicate commodity price impacts • Communicate scenario themes and stochastic analysis approach, along with major input details and assumptions • Communicate preliminary RFP results 	<ul style="list-style-type: none"> • Common understanding of DSM modeling methodology • Explain next steps for portfolio modeling 	<ul style="list-style-type: none"> • Develop a shared understanding of economic modeling outcomes and preliminary results to facilitate stakeholder feedback 	<ul style="list-style-type: none"> • Respond to key stakeholder comments and requests • Communicate NIPSCO's preferred resource plan and short-term action plan • Obtain feedback from stakeholders on preferred plan

We exist to deliver safe, reliable energy that drives value to our customers

AURORA MODELING LICENSE GUIDELINES

- Any interested stakeholder will need to declare their interest in a special use stakeholder Aurora license by May 15th
- Stakeholders will be able to sign a limited license agreement with Energy Exemplar for the Aurora software
- Stakeholders will be given access to relevant data sets for NIPSCO portfolio modeling as it becomes available



We exist to deliver safe, reliable energy that drives value to our customers

CLOSING





We exist to deliver safe, reliable energy that drives value to our customers

APPENDIX



NIPSCO'S CURRENT ENVIRONMENTAL CONTROL OVERVIEW

NIPSCO has invested in environmental controls across the fleet and continues a transition to low- and zero-emitting resources

Unit	Year In Service	Fuel Source	Generating Capacity (MW) ⁽¹⁾	Particulate Matter (PM) Control	Sulfur Dioxide (SO ₂) Control	Nitrogen Oxide (NO _x) Control	Mercury (Hg) Control	Coal Ash	Planned Retirement ⁽⁴⁾
MCGS U12	1974	Coal	455	Baghouse	Dry FGD	OFA & SCR	ACI & FA	SFC	2028
RMS U16A	1979	Natural Gas	78	--	--	Water Injection	--	--	2026-2028
RMS U16B	1979	Natural Gas	77	--	--	Water Injection	--	--	2026-2028
RMS U17	1983	Coal	361	ESP	Wet FGD	Advanced LNB w/ OFA & SNCR	--	--	2025
RMS U18	1986	Coal	361	ESP	Wet FGD	Advanced LNB w/ OFA & SNCR	--	--	2025
Sugar Creek ⁽²⁾	2002	Natural Gas	563	--	--	SCR	--	--	--
Norway	1923	Hydro	7	--	--	--	--	--	--
Oakdale	1925	Hydro	9	--	--	--	--	--	--
Rosewater ⁽³⁾	2020	Wind	102	--	--	--	--	--	--
Indiana Crossroads Wind ⁽³⁾	2021	Wind	302	--	--	--	--	--	--
Dunns Bridge I ⁽³⁾	2023	Solar	265	--	--	--	--	--	--
Indiana Crossroads Solar ⁽³⁾	2023	Solar	200	--	--	--	--	--	--

ESP = Electrostatic Precipitator
SCR = Selective Catalytic Reduction
ACI = Activated Carbon Injection

FGD = Flue Gas Desulfurization
LNB = Low NO_x Burners
FA = Fuel Additives


OFA = Over-Fire Air System
SNCR = Selective Non-Catalytic Reduction
SFC = Submerged Flight Conveyor

We exist to deliver safe, reliable energy that drives value to our customers

NIPSCO | NIPSCO.com |   

(1) Represents current net generating capability of each fossil fuel and hydro generating facility. Nameplate capacity is listed for wind and solar generating facilities.
(2) Sugar Creek added additional generating capacity in January 2024.
(3) NIPSCO is the managing partner of these Joint Ventures.
(4) As of April 2024.

MISO'S PROPOSED D-LOL APPROACH USES SAMPLE WEATHER YEARS TO EVALUATE GENERATOR AVAILABILITY DURING PERIODS OF LOSS OF LOAD RISK

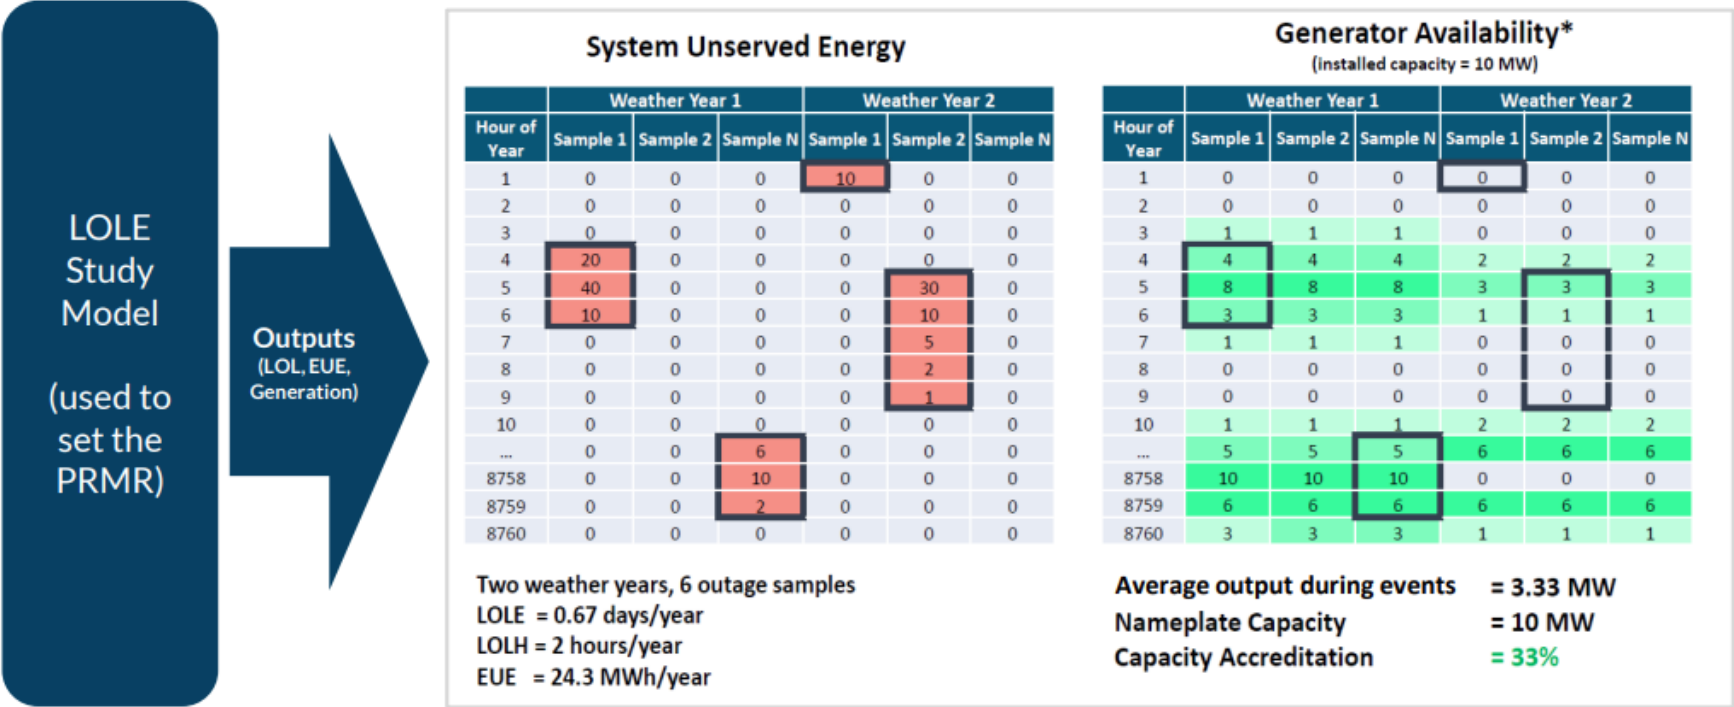


10 Adapted from: <https://www.esig.energy/download/session-5-redefining-capacity-accreditation-derek-stenclik/>
LOLH = Loss of Load Hour EUE = Expected Unserved Energy LOLE = Loss of Load Expectation PRMR = Planning Reserve Margin Requirement



Source:
MISO Accreditation Reform: [https://cdn.misoenergy.org/20230117-18%20RASC%20Item%2014b%20Non-Thermal%20Resource%20Accreditation%20\(RASC-2020-4,%20RASC-2019-2\)%20Presentation627472.pdf](https://cdn.misoenergy.org/20230117-18%20RASC%20Item%2014b%20Non-Thermal%20Resource%20Accreditation%20(RASC-2020-4,%20RASC-2019-2)%20Presentation627472.pdf)

ALTHOUGH CAPACITY ACCREDITATIONS WILL DECLINE, THE PLANNING OBLIGATION WILL ALSO LIKELY GO DOWN IN MISO'S D-LOL APPROACH

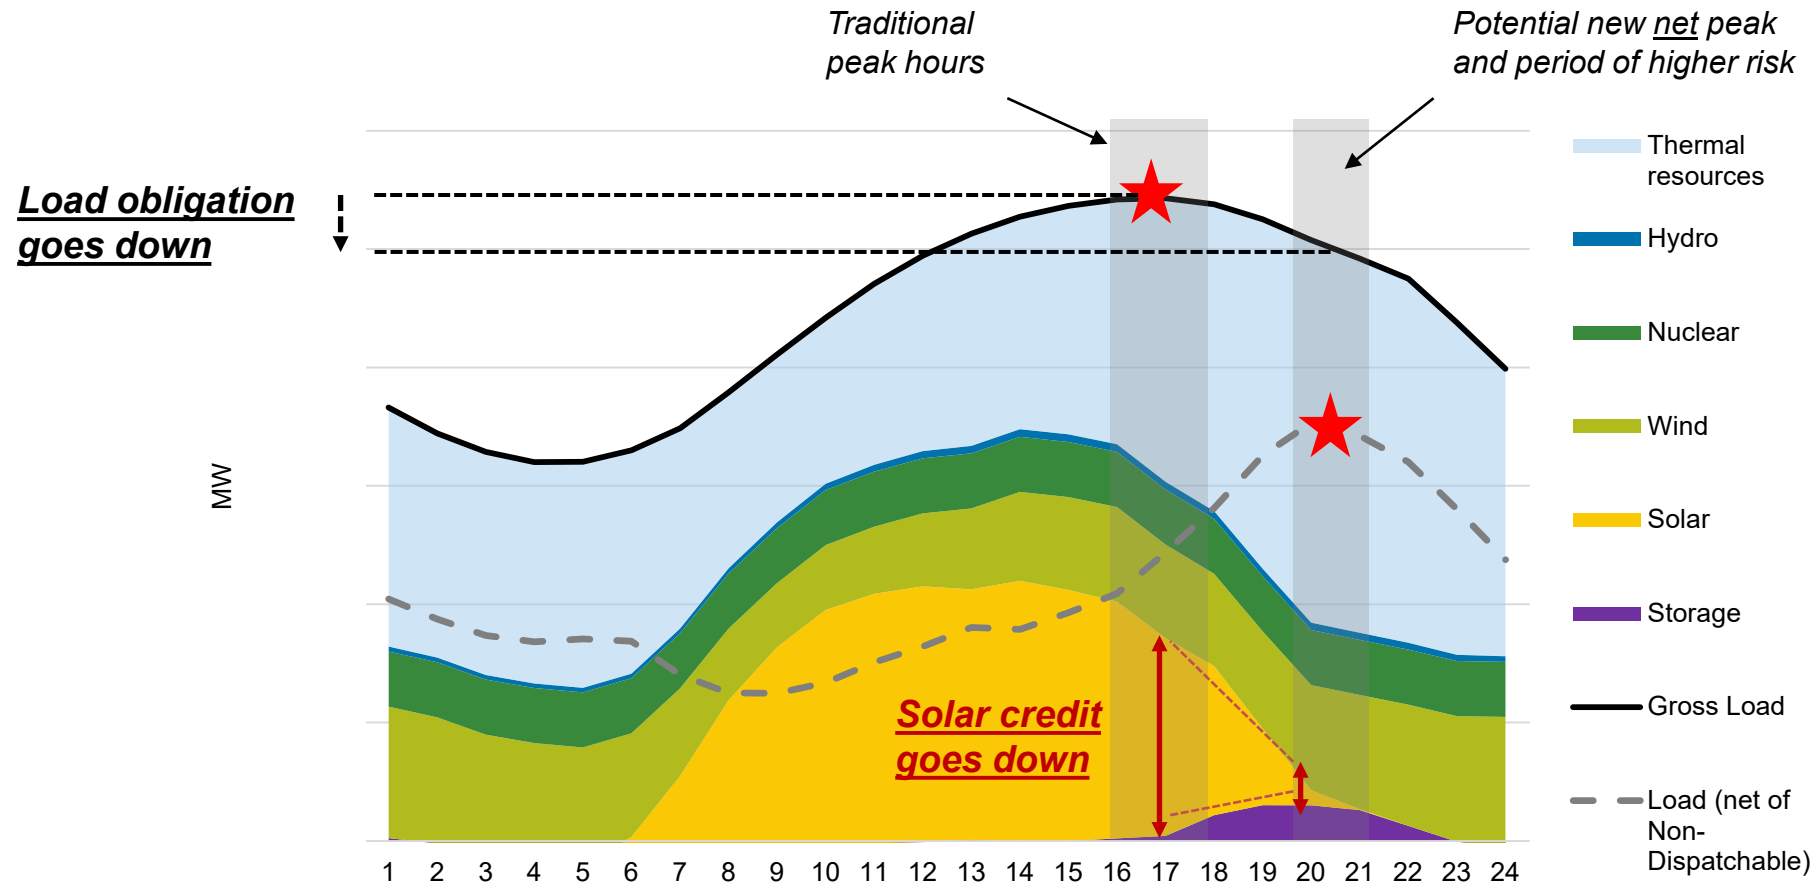


Representative – For Illustration Purposes

We exist to deliver safe, reliable energy that drives value to our customers

A TRANSITION PERIOD IS CONTEMPLATED IN MISO'S D-LOL FILING

- MISO filed its Direct Loss of Load (D-LOL) market design on March 28, 2024 with the FERC
- Stakeholder feedback could still impact final design, and FERC approval is necessary
- MISO would implement a three-year transition period to provide initial market signals before actual market changes are made

A three-year transition allows time for stakeholders to better understand and plan for the accreditation and reserve margin calculations based on DLOL approach

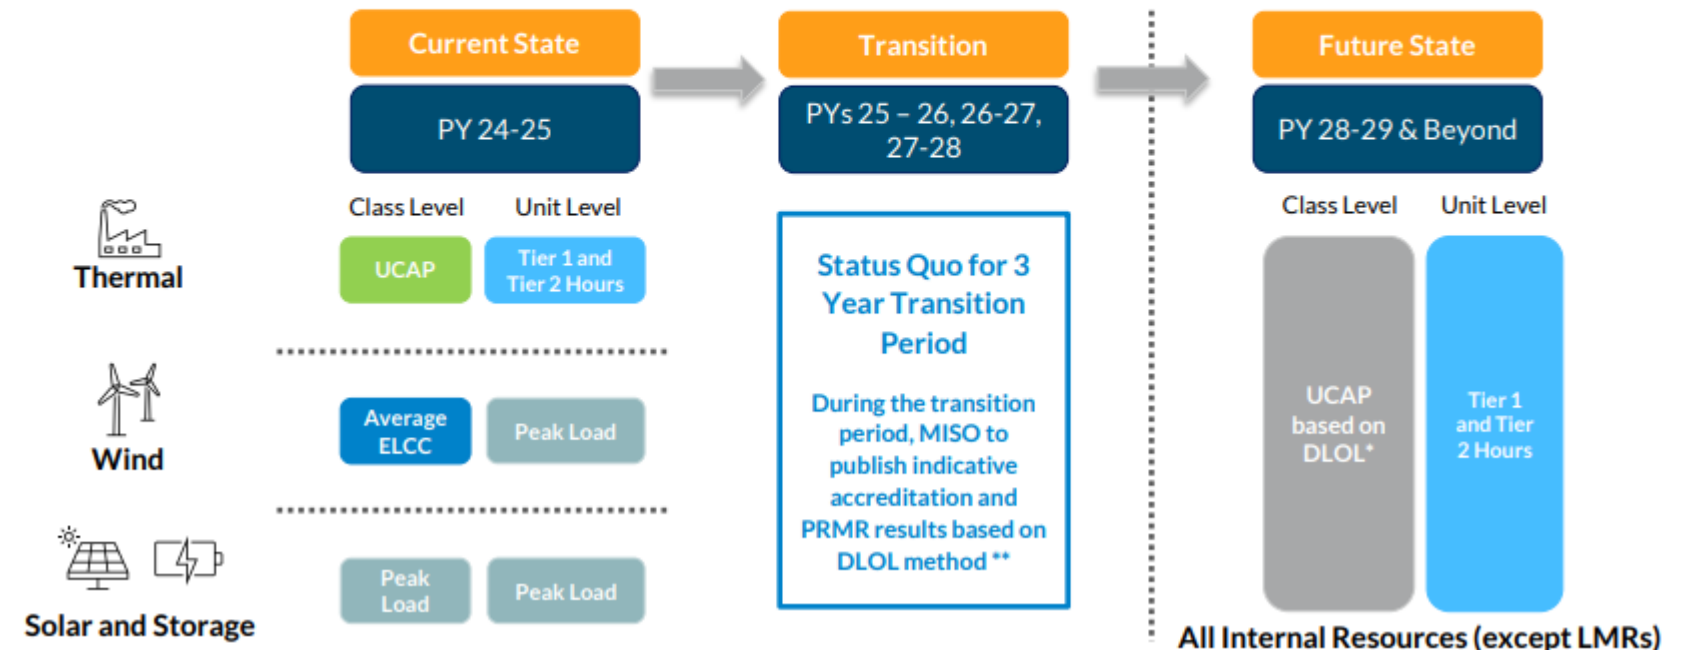


LOAD FORECAST: ACCOUNTING FOR LOSSES


- Although core historical load data is recorded at the meter, IRP modeling must include “gross-ups”
- From an energy perspective, IRP modeling must incorporate the amount of energy that needs to be generated by resources prior to facing losses associated with transmission and distribution to customers
- For MISO peak planning purposes, peak demand needs to be:
 - Inclusive of distribution losses when reporting coincident peaks
 - Grossed up for transmission losses when calculating the planning reserve margin
- Therefore, projected retail sales totals were grossed up by a factor of 4.62%.

RESIDENTIAL FORECAST


Residential Customer Count

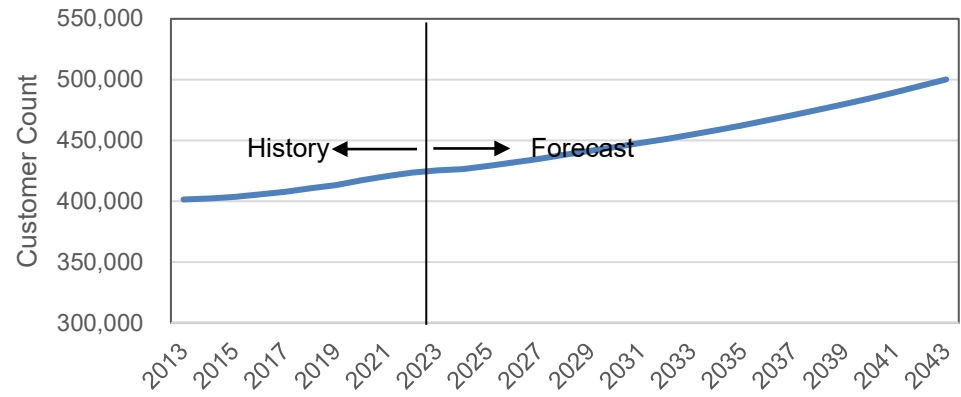

Residential UPC* (MWh/Customer)

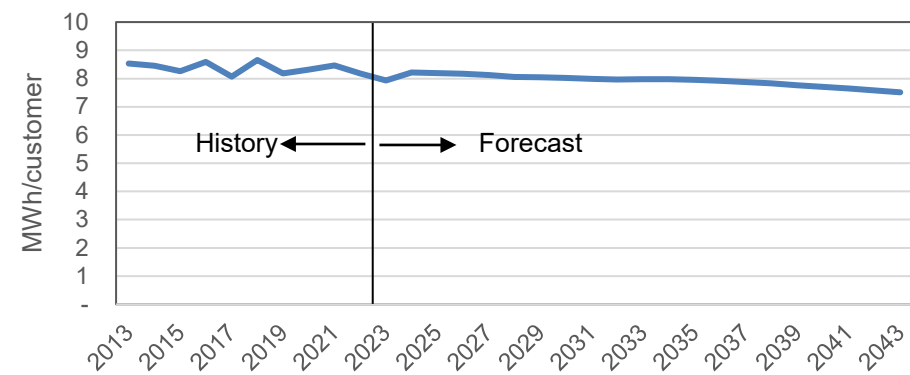


Residential Volume (MWh)

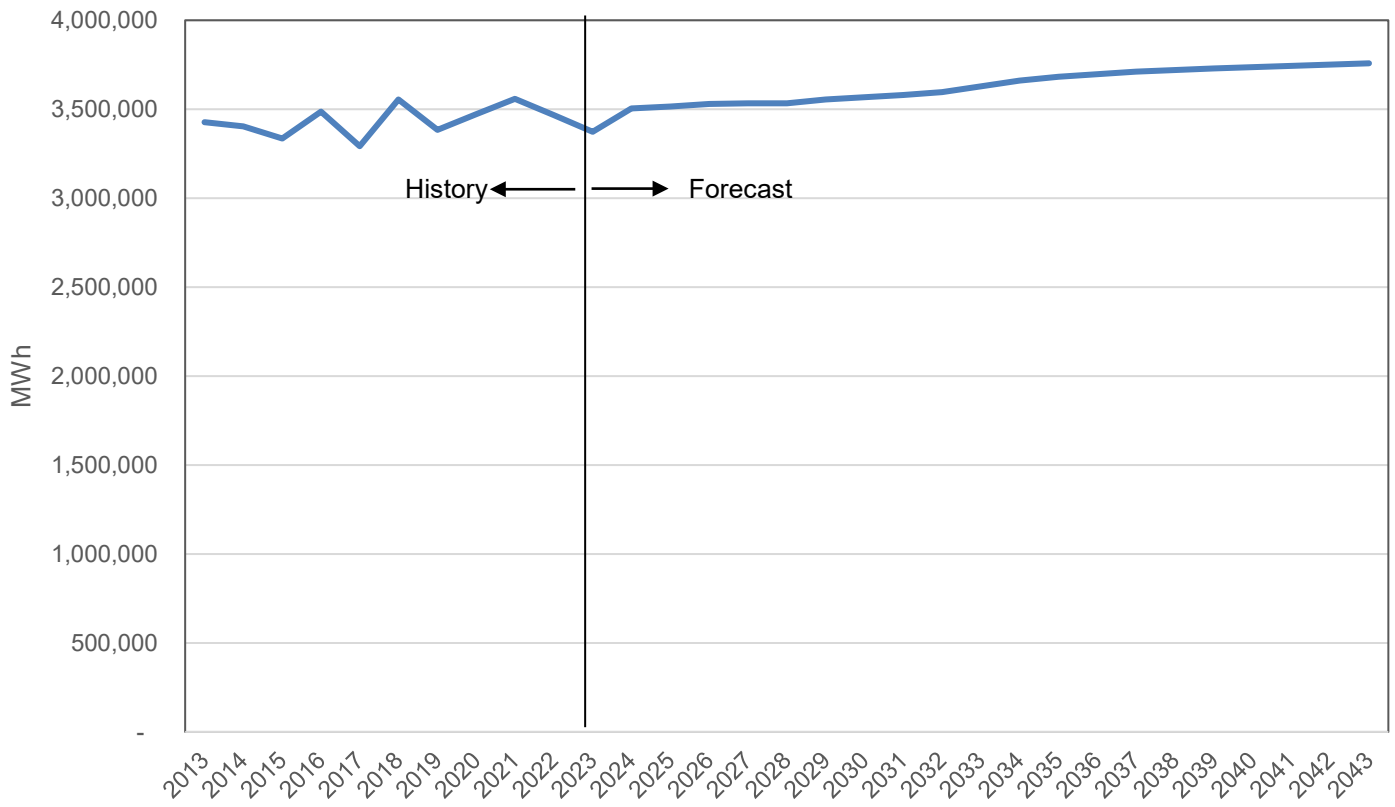


* Annual UPC is calculated as total volume / average monthly customer count

COMMERCIAL FORECAST


Commercial Customer Count

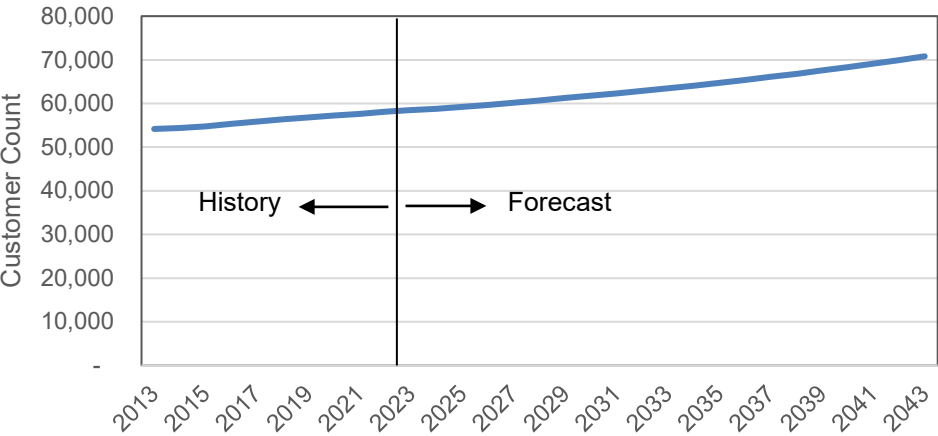

Commercial UPC* (MWh/Customer)

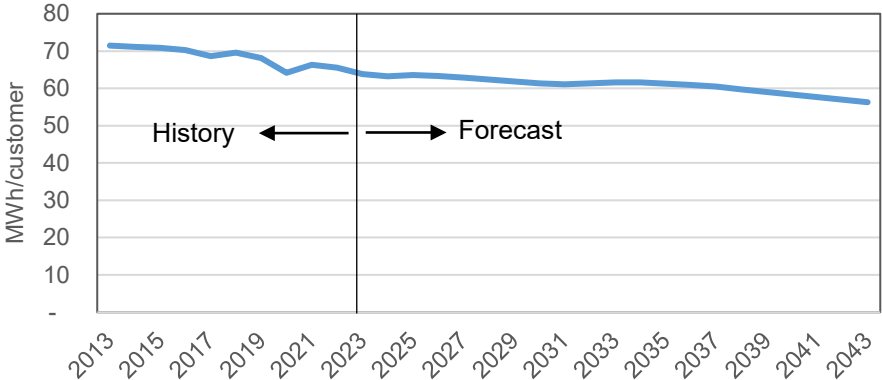



Commercial Volume (MWh)

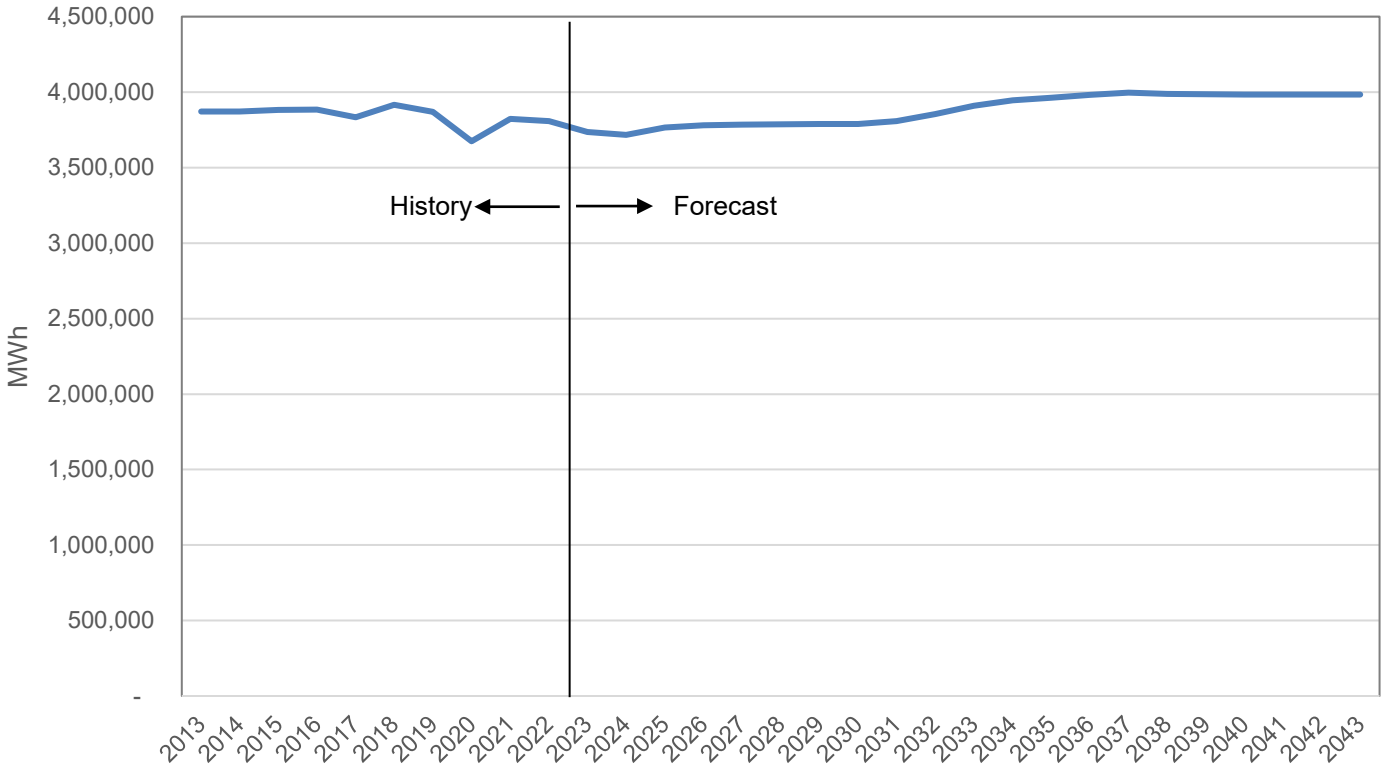

* Annual UPC is calculated as total volume / average monthly customer count

We exist to deliver safe, reliable energy that drives value to our customers

INDUSTRIAL FORECAST

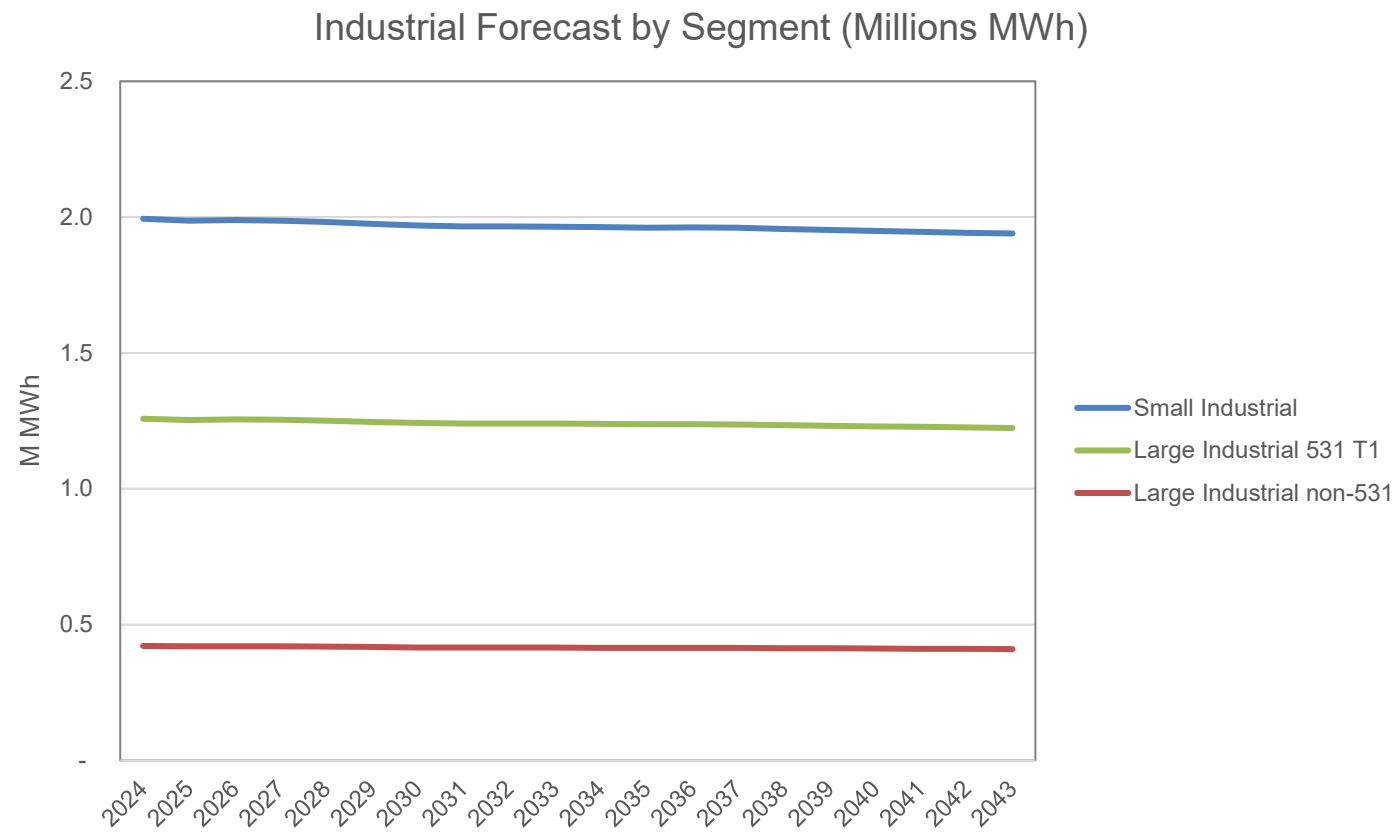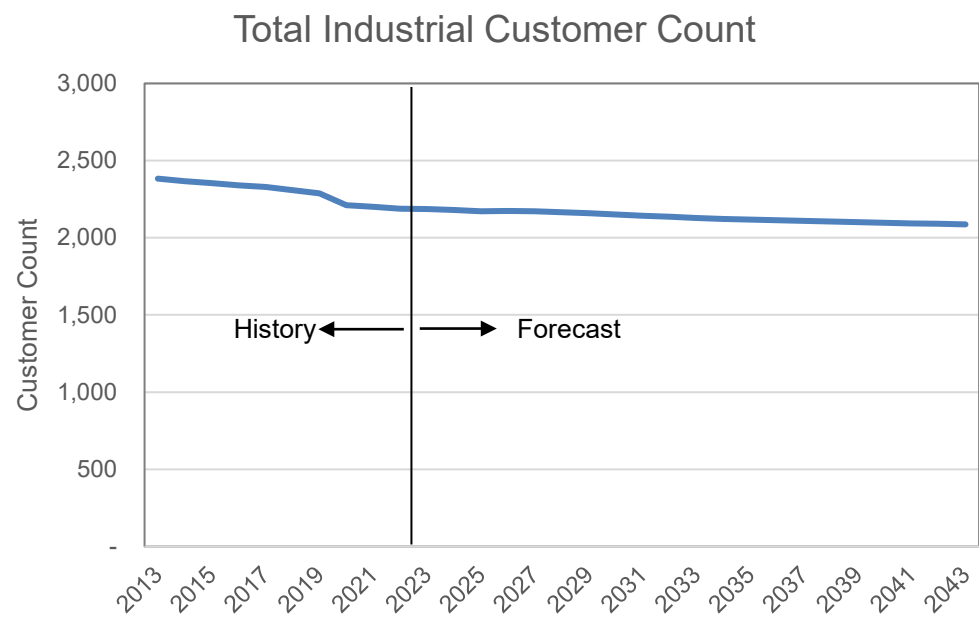

FORECASTING COINCIDENT PEAK – CLASS LOAD FACTORS

- Historical sample meter data provides monthly load factor data by customer class, which was used to develop monthly peak forecasts
- Customer-level load factor data for the 15 largest customers was used for large industrial classes

Class	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Residential	88.80%	88.80%	88.80%	66.90%	66.90%	51.60%	51.60%	51.60%	51.60%	66.90%	88.80%	88.80%
Commercial	81.60%	81.60%	81.60%	75.30%	75.30%	75.40%	75.40%	75.40%	75.40%	75.30%	81.60%	81.60%
Small Industrial	83.60%	83.60%	83.60%	80.80%	80.80%	83.00%	83.00%	83.00%	83.00%	80.80%	83.60%	83.60%

Equation:

$$\text{Peak Demand kW} = \text{Usage}^{\text{kWh}} / (\text{LF} * \text{CPF} * 24^{\text{hr/day}} * X^{\text{days/mo}})$$

- As an enhancement to NIPSCO's process, new sources of load (EVs, other electrification, data centers) are evaluated with their own independent load shapes, allowing for modeling of potential changing load factors over time

PENDER MODEL: METHODOLOGY

Agent Development

- “Agents” are modeled as representative of NIPSCO’s customers, and each agent is randomly assigned a household income level based on the American Community Survey (ACS) 2022 income distribution across NIPSCO counties;
- Each agent is assigned a propensity to adopt new technology (bass innovation index);
- Relationships between agents are modeled through “social networks,” with an average size of 13 agents belonging to one network

An agent will adopt DER if:

- the agent’s probability of adoption is sufficiently high (*according to the economics and probability assessment*)
- the agent is an innovator type (if its innovation index surpasses a specified threshold), or a significant portion of the agent’s network has adopted the technology

NIPSCO DER PROGRAMS

DER programs/policies

Excess Distributed Generation (EDG) program: extra generation receives utility bill credits in the amount of 125% of market priced power*.

- **Commercial:** Started on October 2, 2021
- **Residential:** Started on July 1, 2022



Net Metering: *extra generation received energy credits that can be applied to future usage (no longer applicable to res. or comm. customers in 2024+ beyond)*

Feed-in Tariff (FIT) program: *customer can sell power back to NIPSCO (no longer applicable to res. or comm. customers in 2024+ beyond)*

* Defined in Rider 589 as the Marginal DG Price, the average hourly real-time price of energy paid by the Company in the MISO market at the NIPS.NIPS commercial pricing node during the most recent calendar year, multiplied by one and twenty-five hundredths (1.25).

We exist to deliver safe, reliable energy that drives value to our customers



PENDER MODEL: SOLAR PV DER COSTS

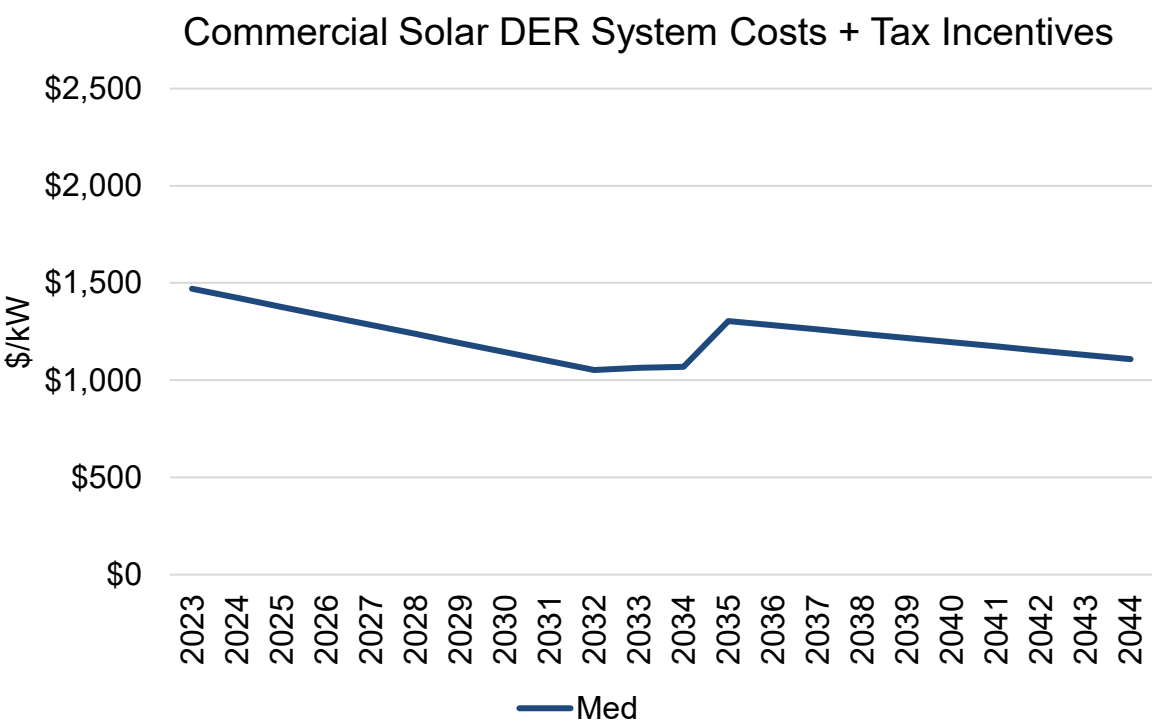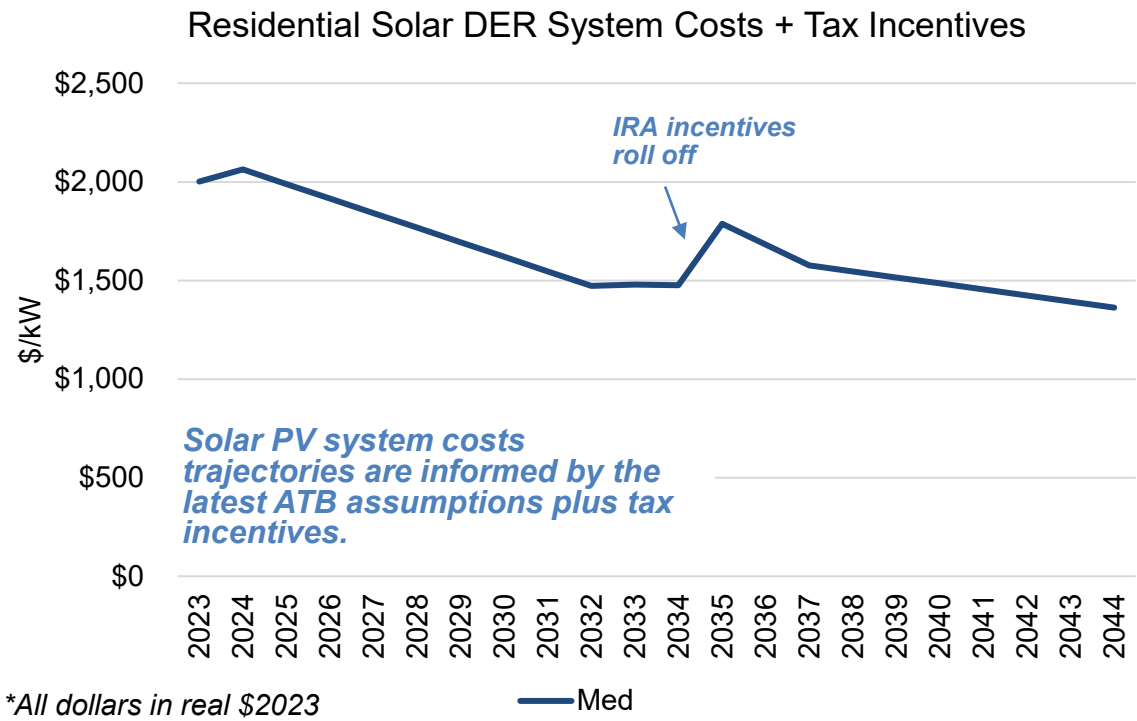

- Assumptions regarding capital cost projections, capacity factor, and system life for solar PV were taken from NREL’s 2023 Annual Technology Baseline for both residential and commercial solar PV technologies.

Reference Scenario	
DER System Capex	NREL ATB Moderate (Med) - Class 5
ITC	Current IRA incentives
DER Program	EDG ext. through 2040s

HISTORICAL DER ADOPTION IN NIPSCO TERRITORY

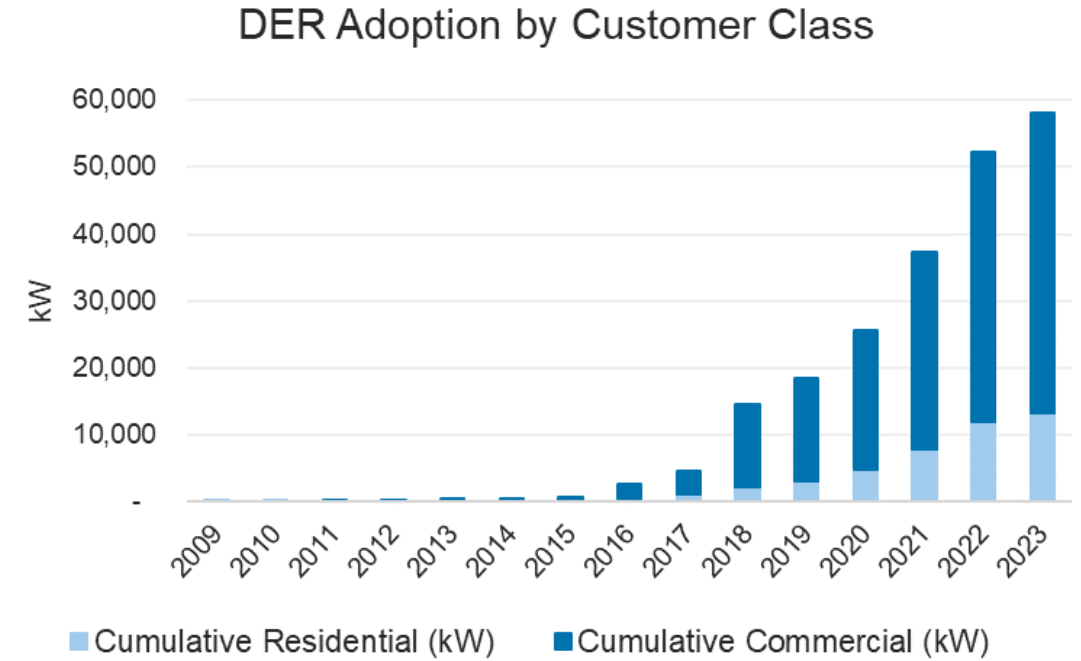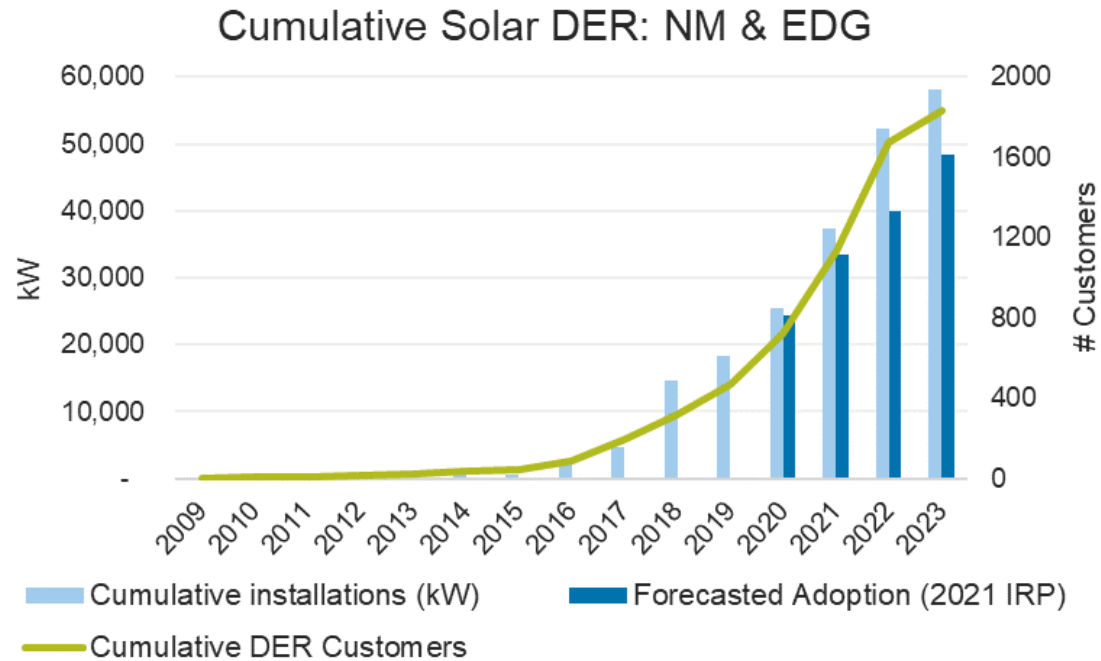




- Since 2020, Solar DER adoption has increased 32% annually.
- After phasing out Net Metering in 2022, growth slowed down.
- To date, 16 customers have adopted battery systems, totaling 98 kW, with an average 2-hour duration.

- Since 2020, residential Solar DER adoption has increased 40% annually; the growth for commercial customers has been 30%.
- Most storage systems have been installed by residential customers, with an average solar to storage ratio of 1.5:1

We exist to deliver safe, reliable energy that drives value to our customers

HISTORICAL SOLAR DER SYSTEM SIZE

- For residential customers, the historical average system size is 8.6 kW (median of 7.6 kW), and around 80% of installed systems are below 10kW
- For commercial customers, the historical system average is 178 kW (median of 40 kW), and around 60% of installed systems are below 100 kW. However, in recent years following the EDG rate program, system sizes have averaged 125 kW (median of 35 kW)

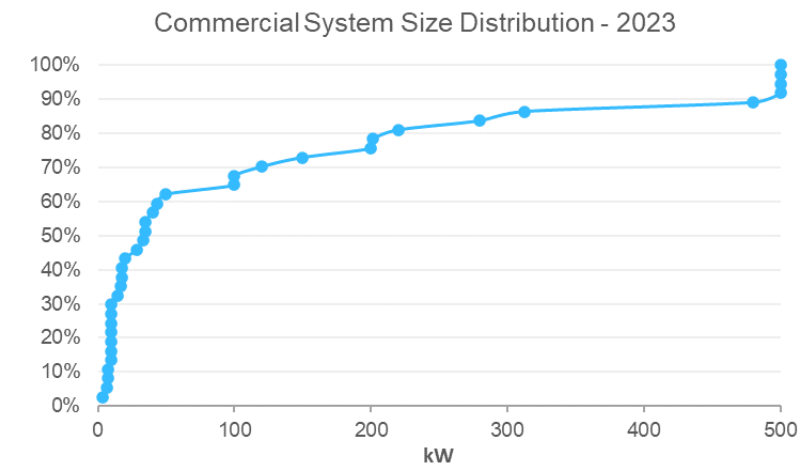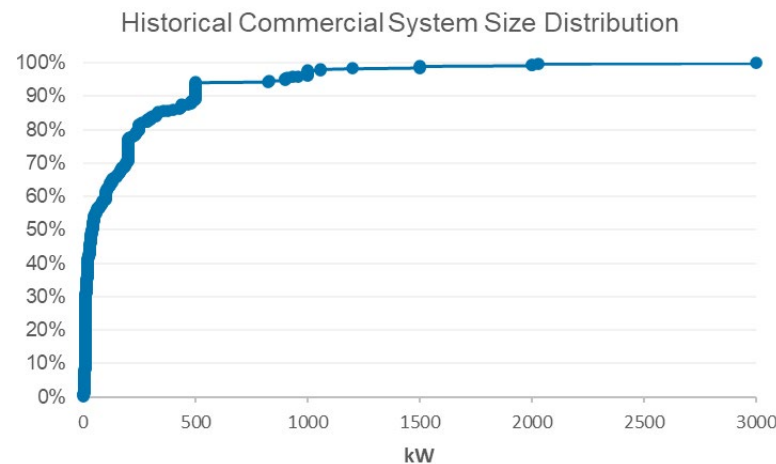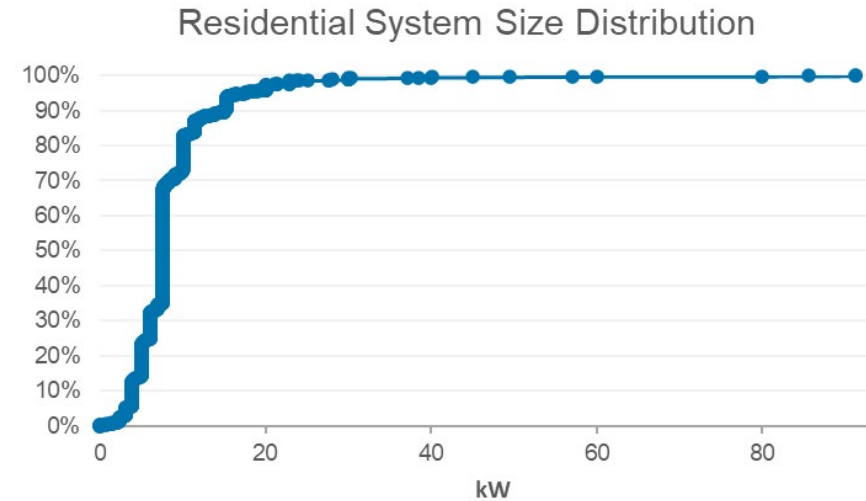

We exist to deliver safe, reliable energy that drives value to our customers

PENDER MODEL: INPUTS

Availability of customer data...

County DER Adoption by total kW...

NIPSCO customer-level DER adoption data (D), and average SES* data (S) by county is used to develop *linear regression model for likelihood of adoption*

Customer Level Data



Individual customer information about DER adoption, DER programs, location, and customer class (R/C/I)

Socio-Economic Data

Individual customer information on socio-economic status, business type, energy usage

Aggregate NIPSCO Data


Total number of R/C/I customers by geographical grouping

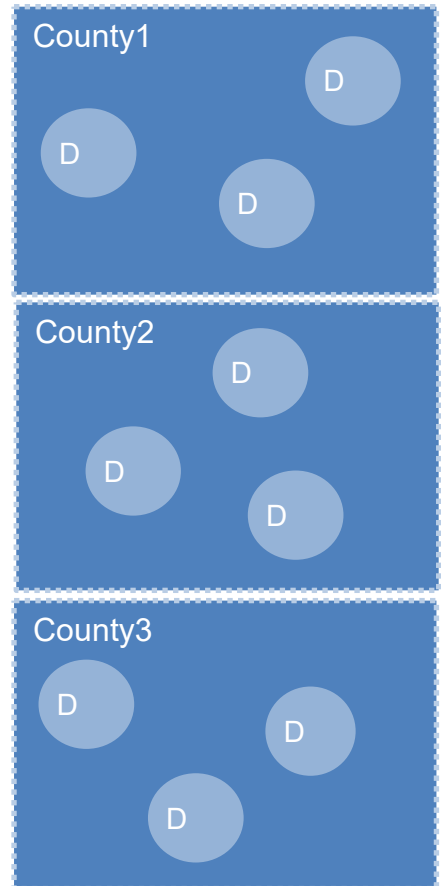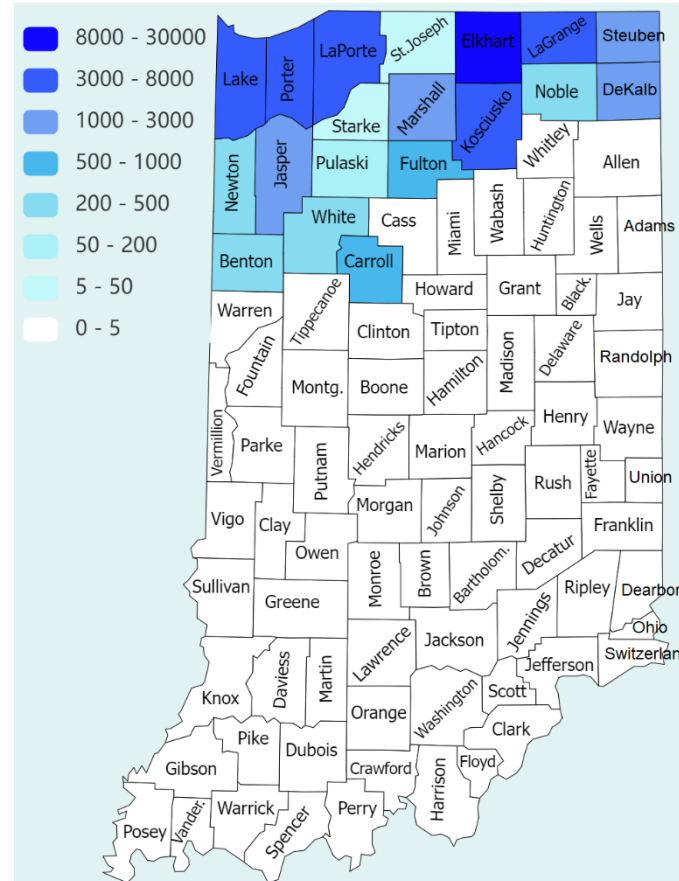

* SES = Socioeconomic Status

We exist to deliver safe, reliable energy that drives value to our customers

PENDER MODEL: INCOME DISTRIBUTION

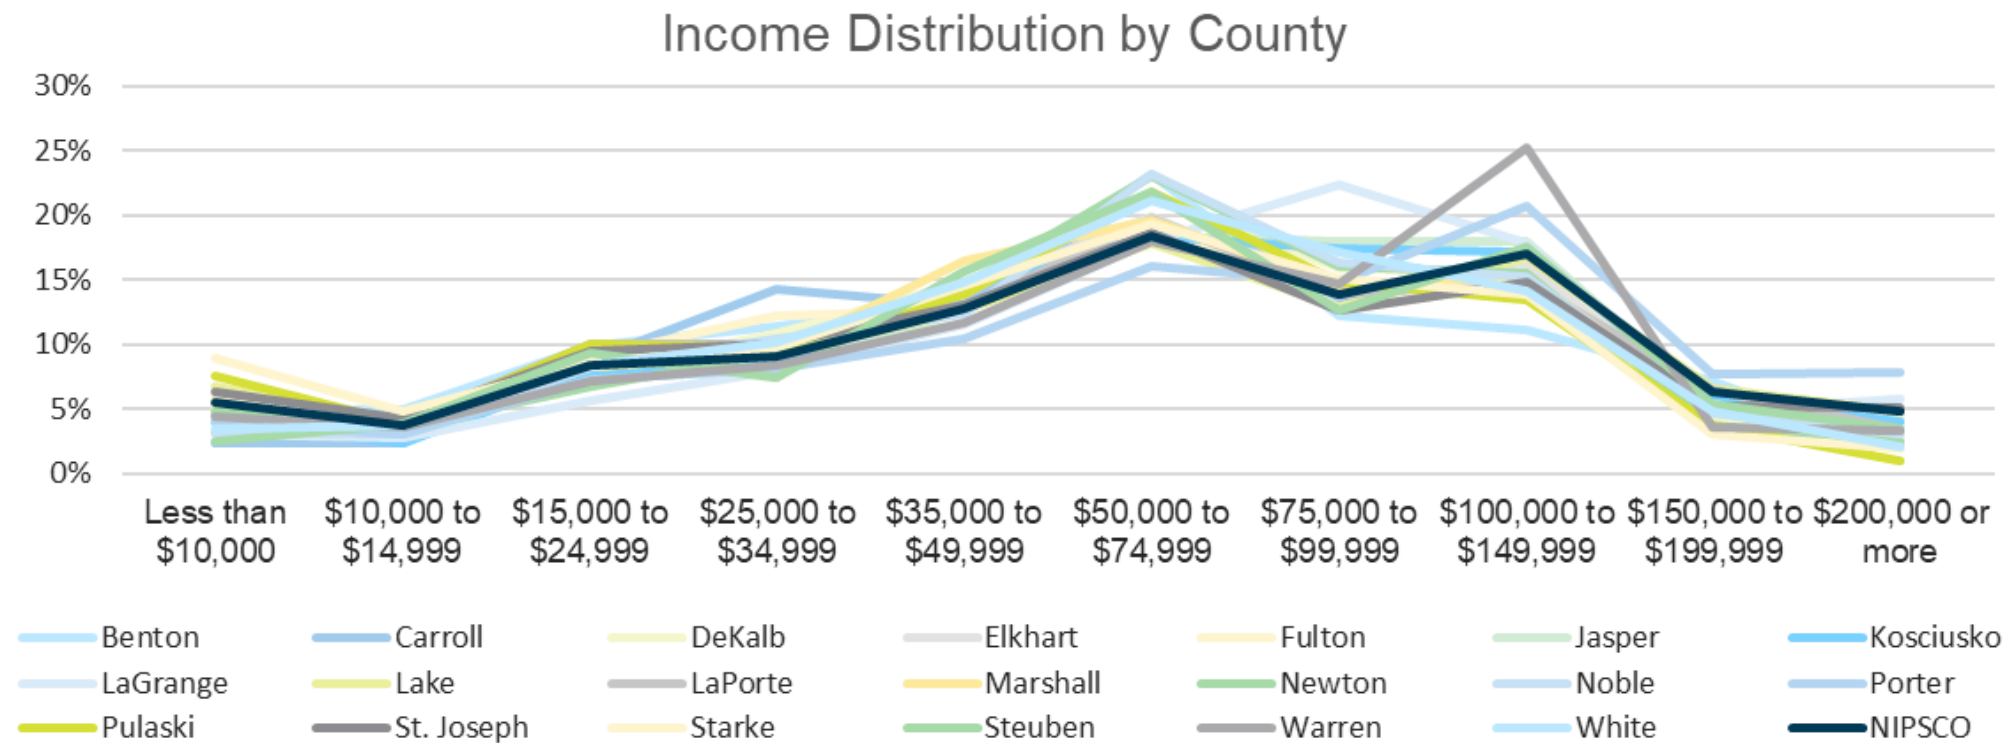


- On average, 42% of residential customers, across counties, report a median income above \$75k, with a range between 32% - 51%.

EV FORECASTING APPROACH

Penetration Models with Local Datasets

Truck Corridor Charging Tool

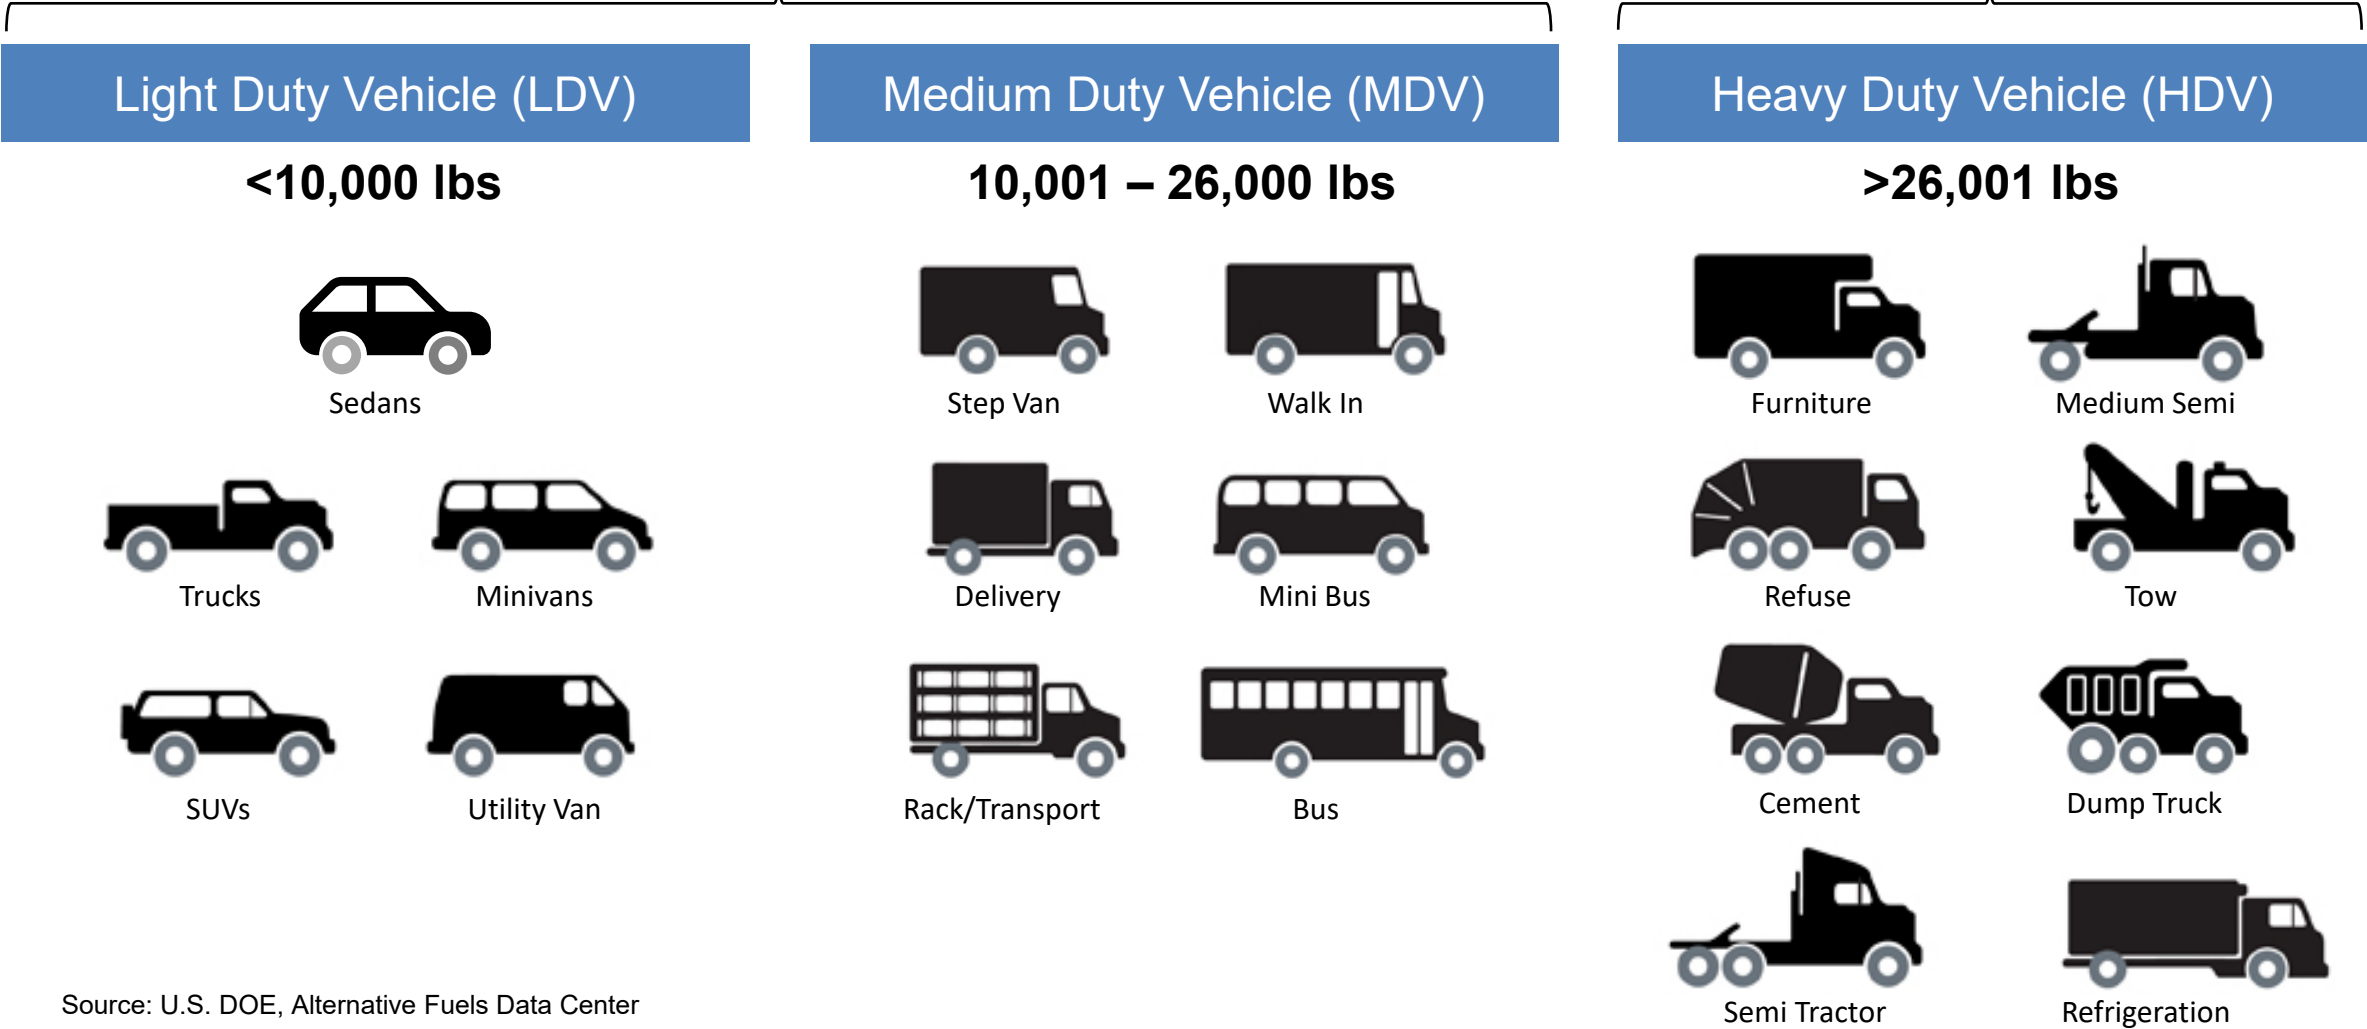

Source: U.S. DOE, Alternative Fuels Data Center

We exist to deliver safe, reliable energy that drives value to our customers

LDV EV GROWTH: UTILIZE NIPSCO DATA FOR ICE AND EV REGISTRATIONS TO DEVELOP VIEW OF TOTAL LIKELY LDV EV'S, APPLY TO ADOPTION S-CURVE BASED ON PUBLIC STUDIES OF LIKELY INFLECTION POINTS

Econometric model determines total number of electric vehicles, which will scale total EV demand over each year

2024/Today

- Historical EV registration data will give a view of EV adoption in recent years and expected 2024 adoption
- Historical ICE registration data will give a view of total vehicle registrations
 - In all scenarios, we expect that the number of total vehicles will remain constant over time
 - Assumption can be flexed in scenarios

Inflection year

- Determine the year(s) that system integration will begin and how long this will last (based on public studies)
 - Assumption is varied across scenarios

Saturation year

- Determine the year(s) that system saturation will begin (based on public studies)
 - Assumption can be flexed in scenarios
 - Metric: EVs as % of new registrations

MDV EV GROWTH: UTILIZE NIPSCO DATA FOR ICE AND EV REGISTRATIONS TO DEVELOP VIEW OF TOTAL LIKELY MDV EV'S, APPLY TO ADOPTION S-CURVE BASED ON PUBLIC STUDIES OF LIKELY INFLECTION POINTS

Econometric model determines total number of electric vehicles, which will scale total EV demand over each year

2024/Today

- Historical EV registration data will give a view of EV adoption in recent years and expected 2024 adoption
- Historical ICE registration data will give a view of total vehicle registrations
- Transit vehicle counts from 2022 National Transportation Database update
 - In all scenarios, we expect that the number of total vehicles will remain constant over time
 - There may be a case to make that the number increases over time as demand for delivery services rise

Inflection year


- Determine the year(s) that system integration will begin and how long this will last (based on public studies)
 - Inflection will be steeper in MDV forecast compared to LDV as individual fleets are likely to change over in larger groups

Saturation year


- Determine the year(s) that system saturation will begin (based on public studies)
 - Assumption can be flexed in scenarios
 - Metric: EVs as % of new registrations

REFERENCE LDV ADOPTION TRAJECTORY WOULD MEET NEW EPA TARGETS

Number of EVs registered
'24-'30 timeframe detail

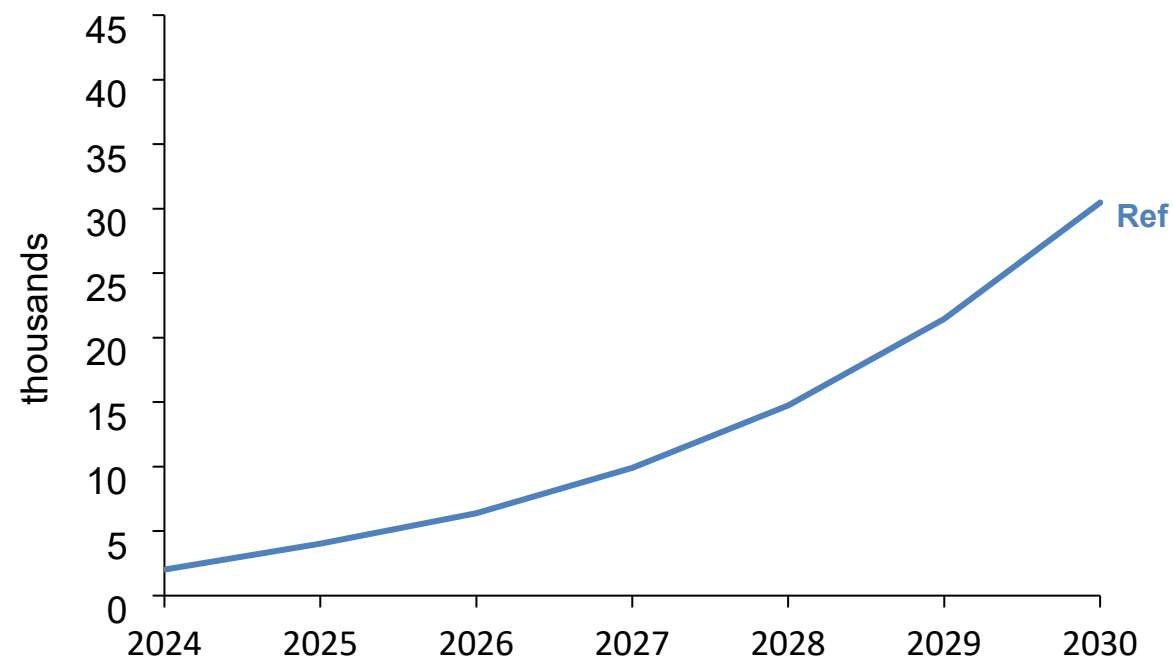


Number of EVs registered
Full forecast period

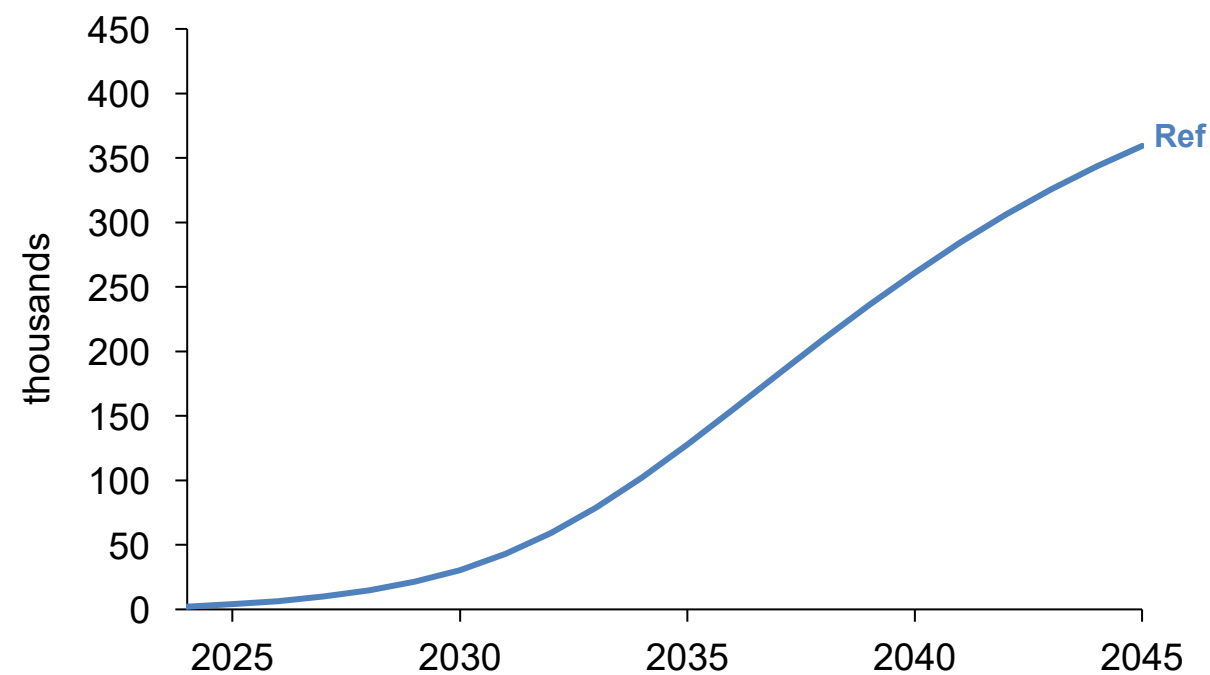

LDV PEAK IMPACTS AND VEHICLE EFFICIENCY


Peak Impacts

- With the increase in vehicle efficiency, each vehicle's contribution to coincident peak loads is expected to decrease over time
- Coincident peaks are expected to shift towards evenings in future years, limiting the impact of vehicle efficiency gains on peak reduction

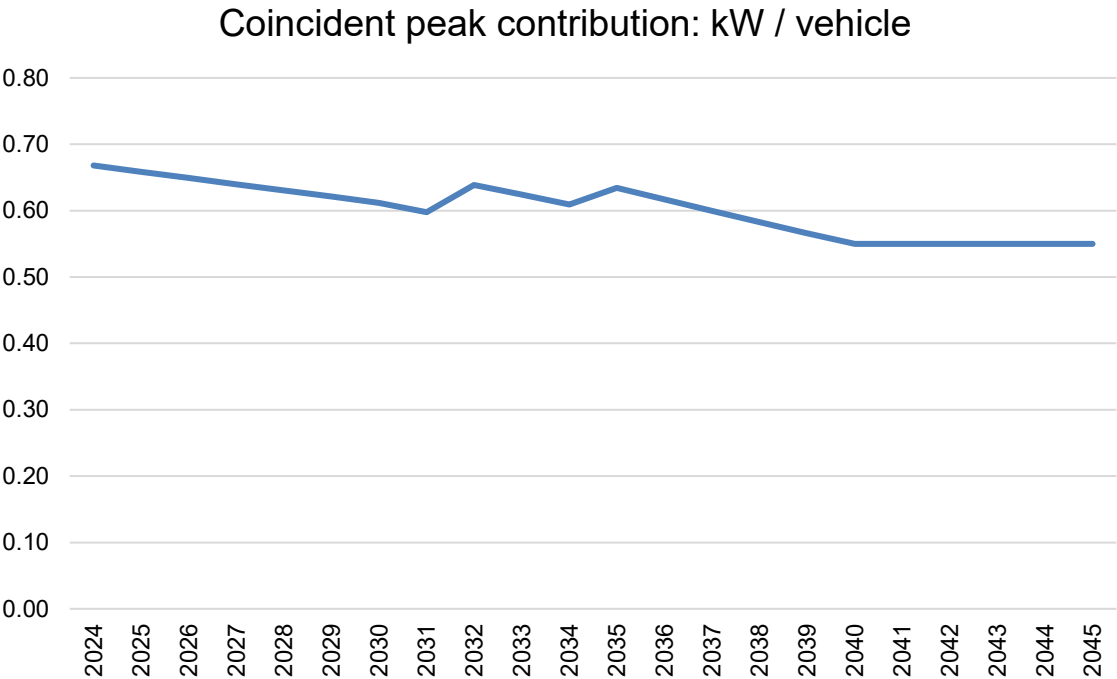

Vehicle Efficiency

- Vehicle efficiency in BEV and PHEVs is forecasted to double by 2040, significantly reducing the per-vehicle impact on total sales
- NIPSCO relied on EV market data and NREL projections to forecast efficiency learning curves
- Despite higher efficiencies, total vehicle miles driven per day is forecasted to increase from 27.5 in 2024 to 40 by 2040

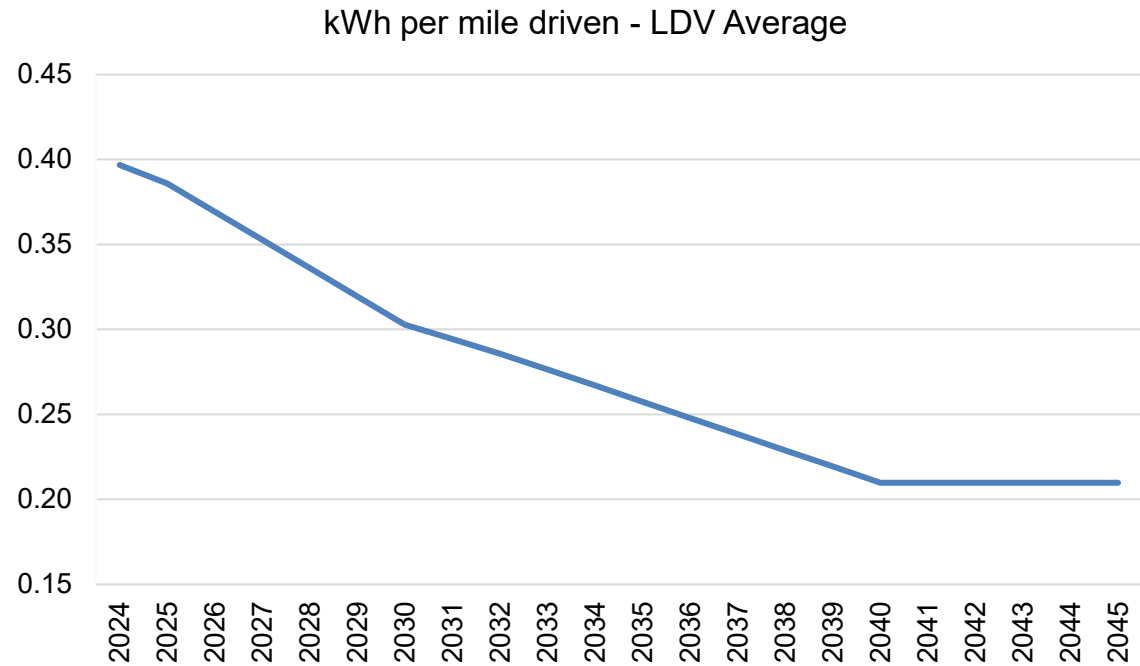

We exist to deliver safe, reliable energy that drives value to our customers

REFERENCE CASE LDV LOAD SHAPES 2024

Total registered EVs: 2,006

EV Type	Count	mi / kWh
BEV Sedan	882	2.57
BEV SUV	721	2.30
PHEV Sedan	281	2.95
PHEV SUV	120	2.40


Grid Impacts

Coincident Peak (MW)	1.34
Coincident Peak Time	August, 3pm
Annual Sales (MWh)	8,243
LDV Annual Peak (MW)	2.15
LDV Annual Peak Date	Jan 4, 8pm


Seasonal Coincident Peaks (MW)

Winter	1.93
Spring	1.93
Summer	1.34
Fall	1.61

2024 weekday profile (kW / vehicle)

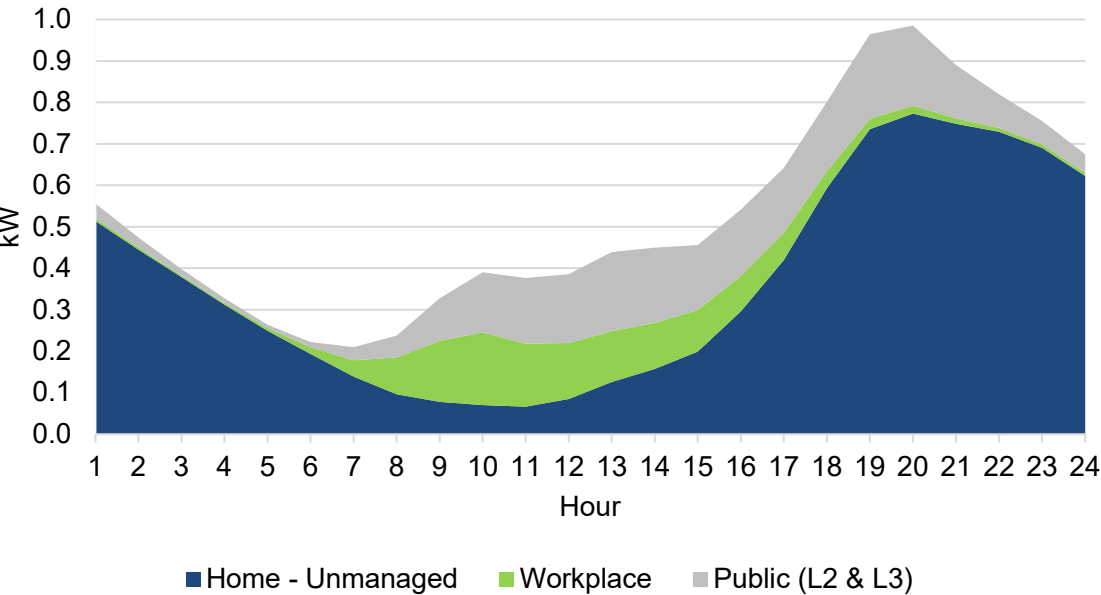

2024 weekend profile (kW / vehicle)

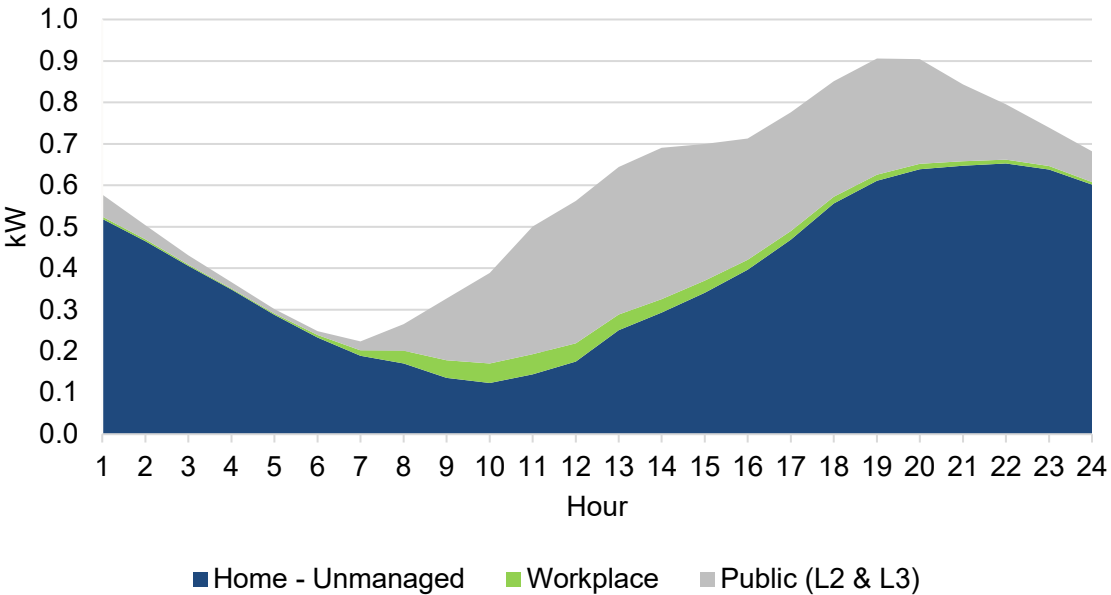

REFERENCE CASE LDV LOAD SHAPES 2030

Total registered EVs: 33,016

EV Type	Count	mi / kWh
BEV Sedan	16,342	3.50
BEV SUV	13,371	3.00
PHEV Sedan	2,311	4.00
PHEV SUV	990	3.25


Grid Impacts

Coincident Peak (MW)	20.2
Coincident Peak Time	August, 3pm
Annual Sales (MWh)	129,000
LDV Annual Peak (MW)	32.3
LDV Annual Peak Date	Jan 4, 8pm


Seasonal Coincident Peaks (MW)

Winter	28.8
Spring	29.6
Summer	20.2
Fall	28.8

2030 weekday profile (kW / vehicle)

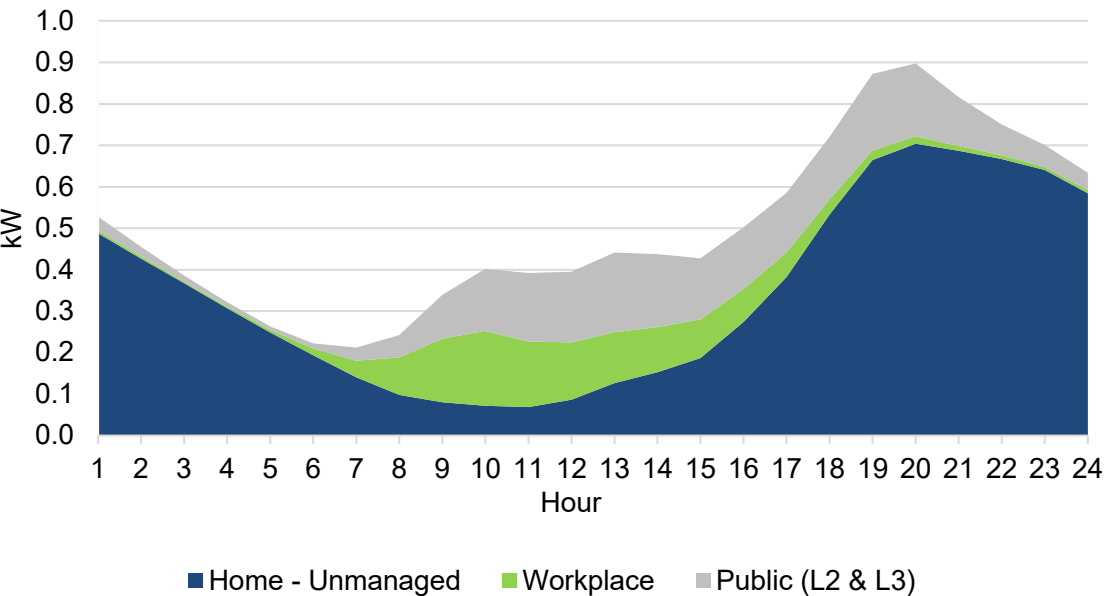

2030 weekend profile (kW / vehicle)

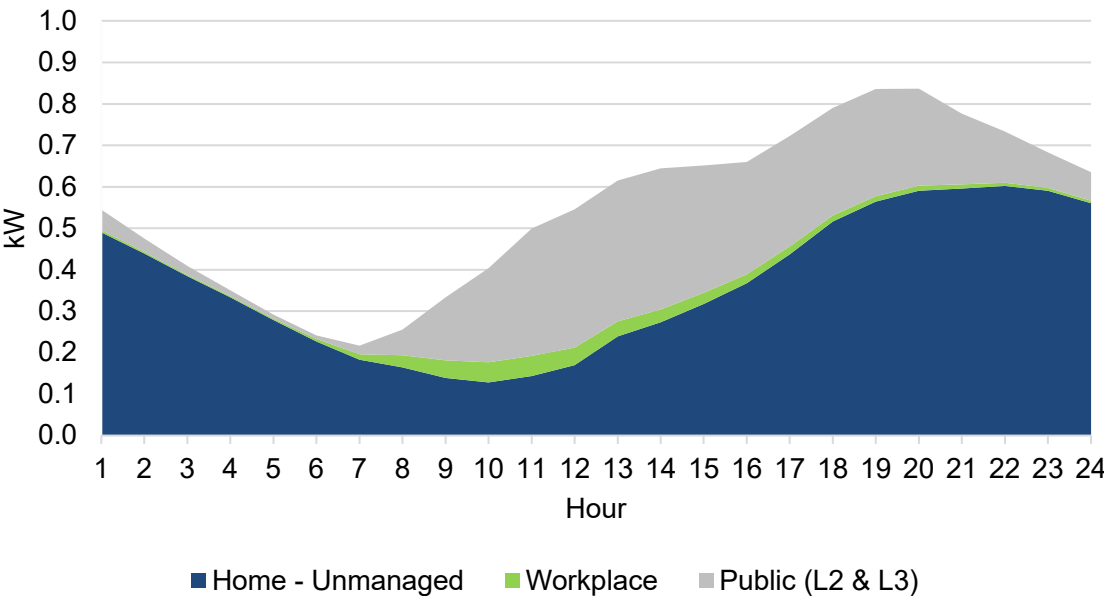

REFERENCE CASE LDV LOAD SHAPES 2040

Total registered EVs: 283,967 Grid Impacts


EV Type	Count	mi / kWh
BEV Sedan	148,373	5.0
BEV SUV	121,396	4.5
PHEV Sedan	9,939	5.0
PHEV SUV	4,259	4.5

Coincident Peak (MW)	156
Coincident Peak Time	August, 5pm
Annual Sales (MWh)	866,000
LDV Annual Peak (MW)	214.5
LDV Annual Peak Date	Jan 4, 8pm


Seasonal Coincident Peaks (MW)

Winter	189
Spring	194
Summer	156
Fall	189

2040 weekday profile (kW / vehicle)

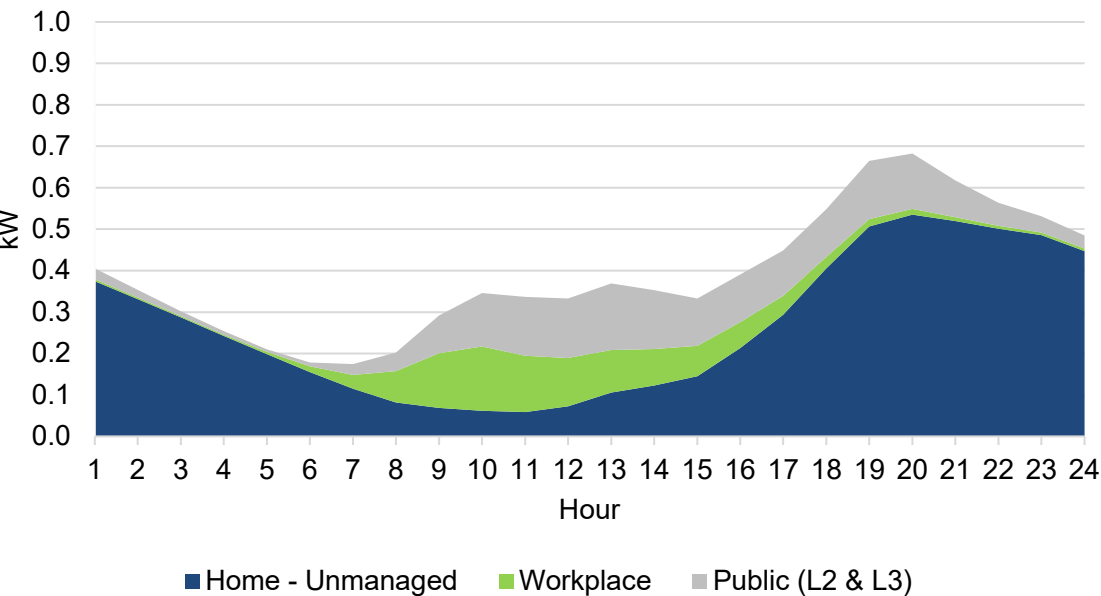


2040 weekend profile (kW / vehicle)

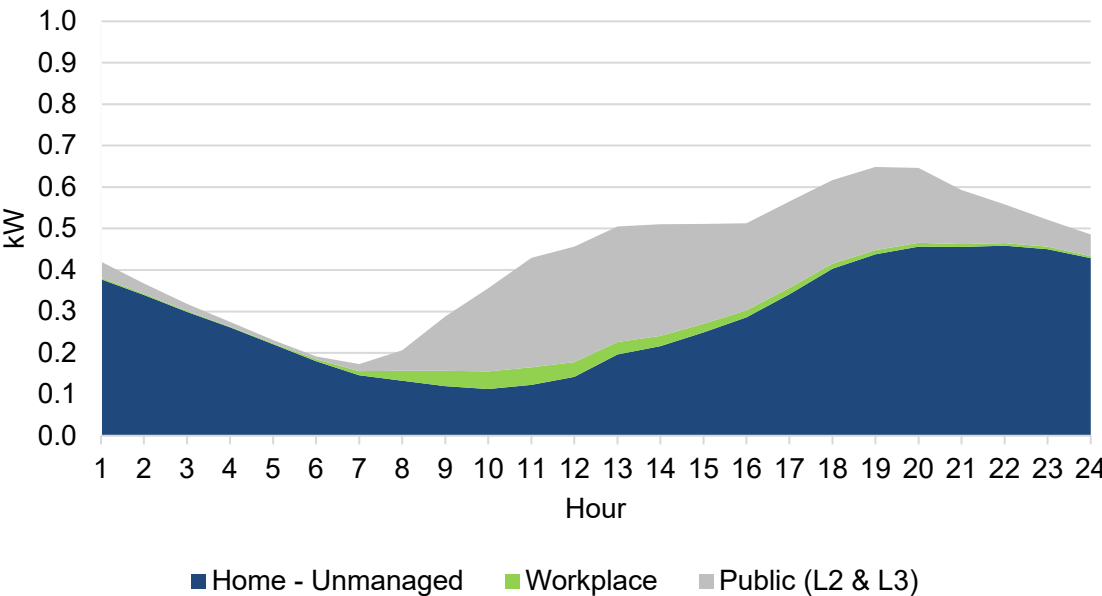

MDV CHARGING EFFICIENCY: TEMPERATURE AND TECHNOLOGY IMPROVEMENT


Technology Improvements – Vehicle Efficiency

- Adapted from NREL transportation baseline technology analysis, CRA determined that a range of MDVs will likely see a ~30% improvement in vehicle efficiency over the forecast period, reducing grid impacts over time

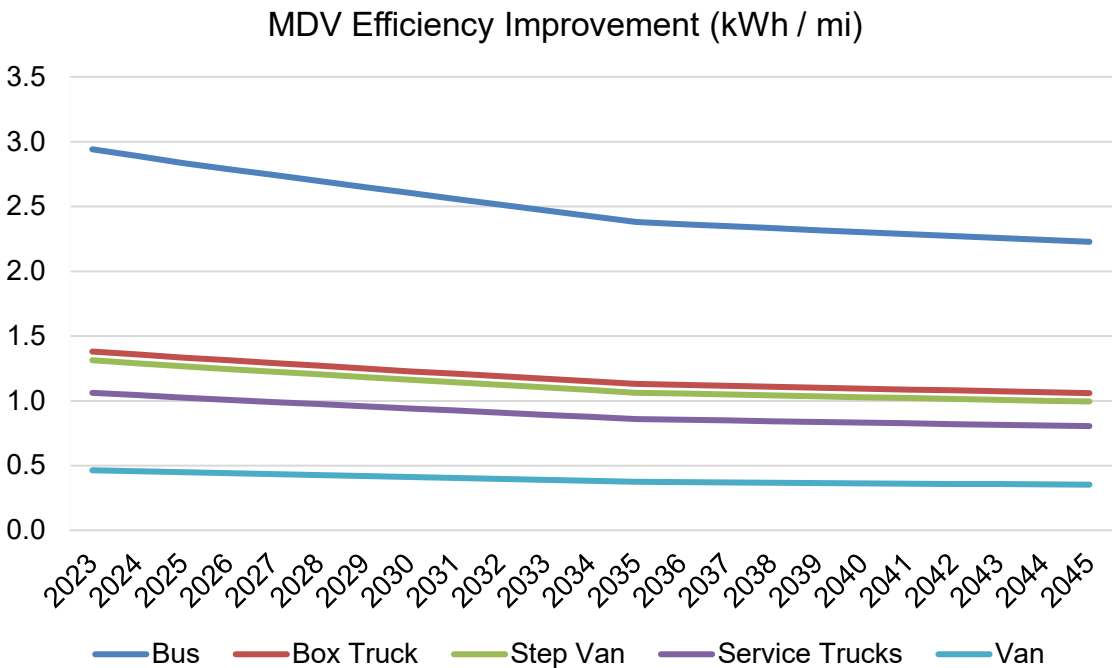

Temperature Dependence

- Transit vehicles have high temperature dependence, as larger buses require space heating of large areas with high heat loss
- Estimated 44% energy demand increase for coldest hours of the year, and 10% for hottest hours

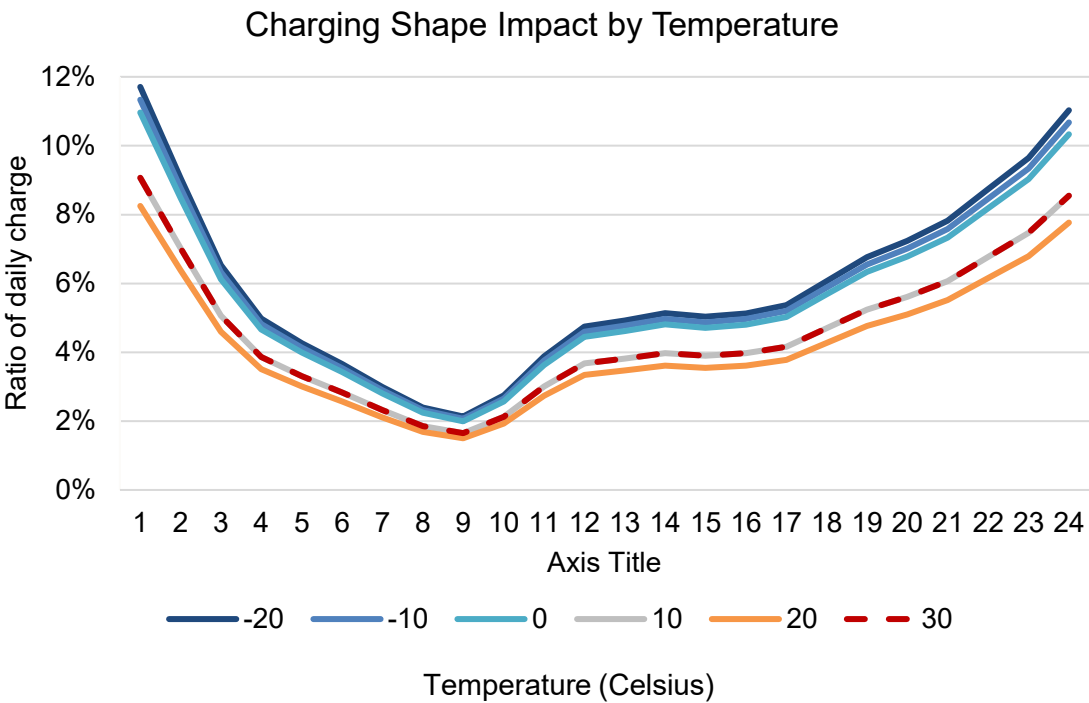

MDV (NON-TRANSIT) EV FORECAST


Near-term Trends

- NIPSCO has baselined the existing MDV fleet using EV registration data from the Indiana Fuel Dashboard
- NIPSCO has crafted an approach that uses ICE vehicle turnover (assuming 10-year avg lifespan) and EVs as a % of new MDV vehicle sales to estimate the number of EVs on the road in a given year.

Long-term Trends

- CRA anticipates moderated adoption compared to LDVs, as some MDVs may be difficult to decarbonize with limited EV options available

Number of non-transit MDVs registered

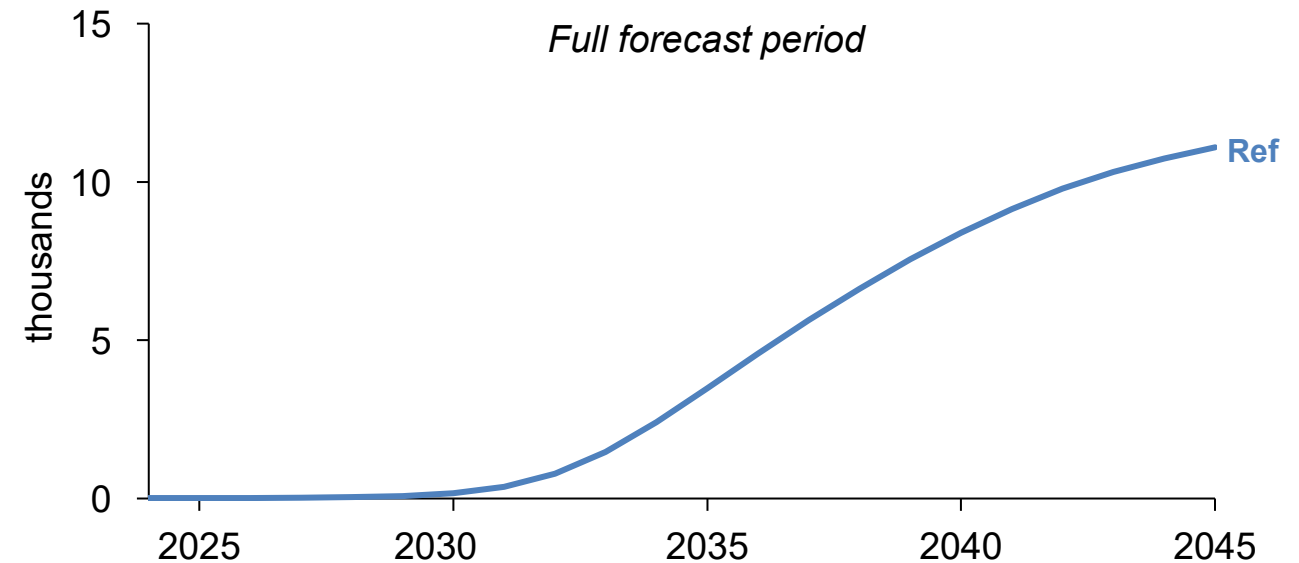

MDV (TRANSIT) EV FORECAST


Near-term Trends

- NIPSCO has baselined the existing transit fleet using the 2022 National Transportation Database (NTD)
- NIPSCO has crafted an approach that uses ICE vehicle turnover (assuming avg lifespan by vehicle type from NTD) and EVs as a % of new MDV vehicle sales to estimate the number of transit EVs on the road in a given year.

Long-term Trends

- NIPSCO anticipates moderated adoption compared to LDVs as some MDVs may be difficult to decarbonize with limited EV options available

Number of transit MDVs registered

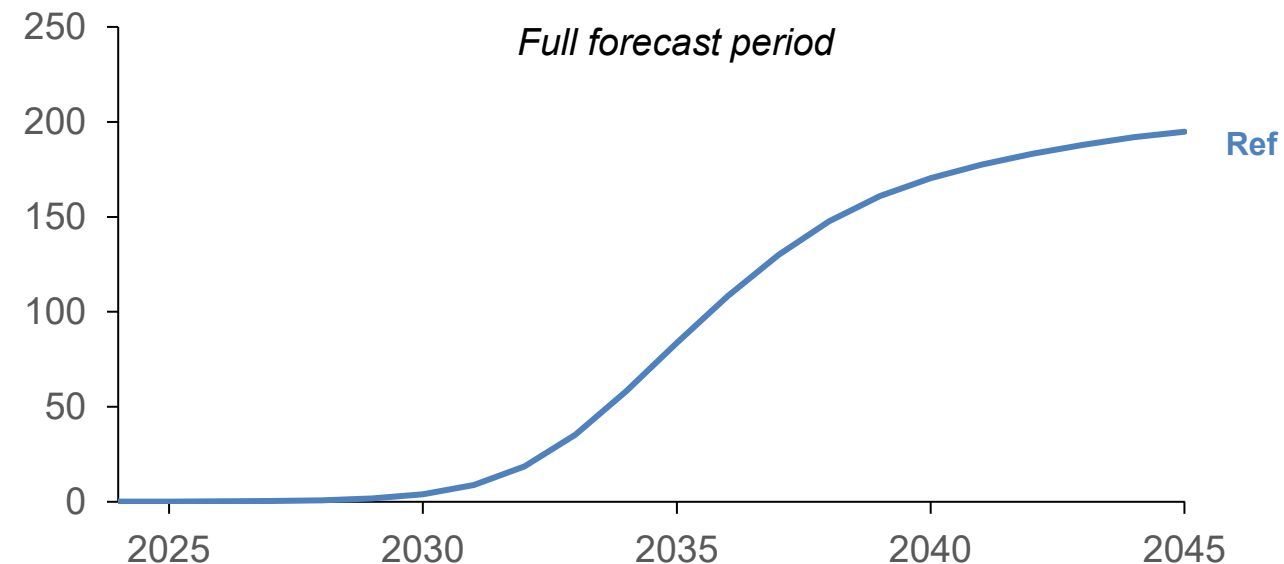


MDV CHARGING BEHAVIOR: UNMANAGED VS. MANAGED CHARGING

Unmanaged charging:

- Current methodology is based on an NREL study, [Field Evaluation of Medium-Duty Plug-In Electric Delivery Trucks](#)
- Utilizes real-meter data (similar approach was taken by NIPSCO in its 2021 IRP)
- Shape is used from 2024 - 2030, when a blend of managed charging loads begins to emerge, based on the assumption that rates and managed charging infrastructure will begin to displace unmanaged behavior in later years


MDV - unmanaged charging behavior

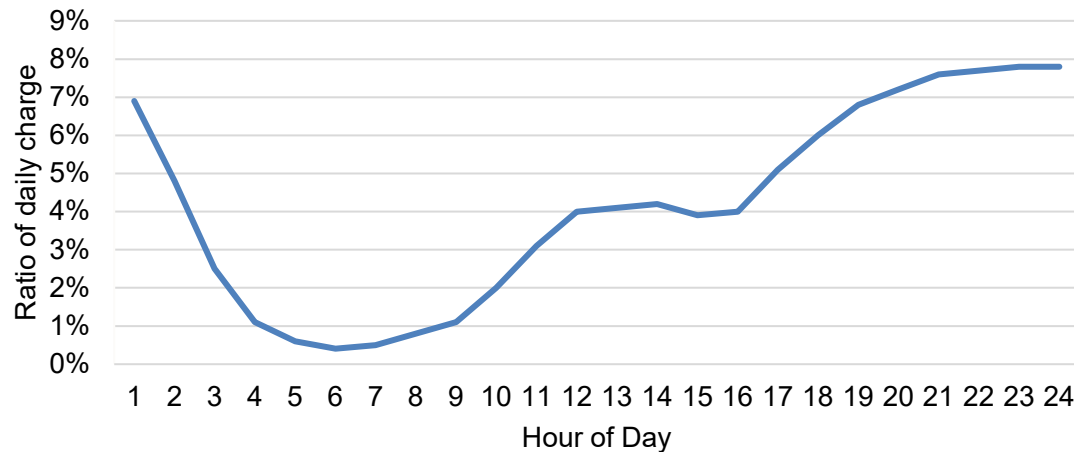

Managed charging:

- Managed profile adapted from recent data releases from 2021 study from [Berkeley Lab](#)
- This approach assumes the adoption of new rate design and managed charging approaches and is used as a baseline future projection for how MDV loads may balance from 2030 – 2045 (although some degree of unmanaged charging remains for the duration of the forecast period)

MDV – managed charging behavior

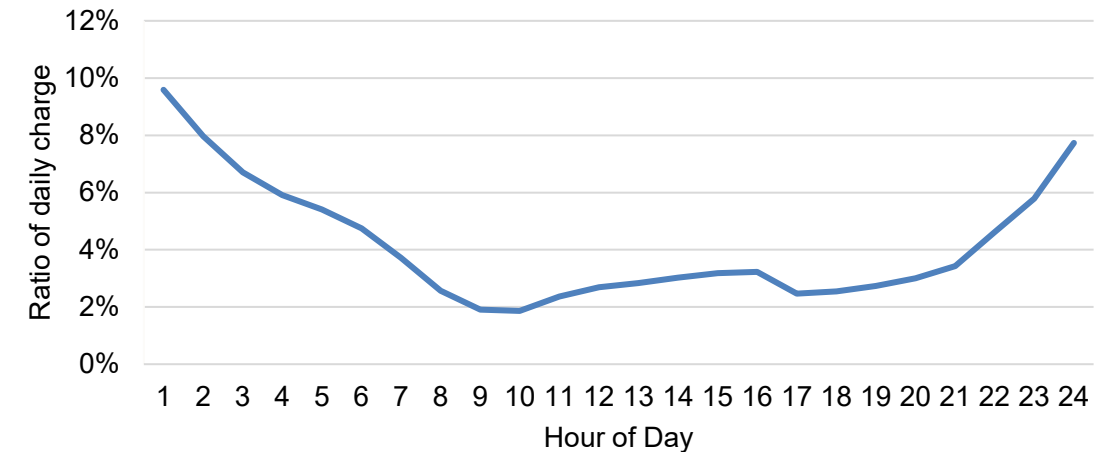

REFERENCE CASE EV MDV LOAD SHAPES: 2030 REFERENCE (50% managed)

Total registered MDVs: 171

EV Type	Fleet / Delivery	Transit
Count	167	4
kWh / mi	1.18	0.81
VMT / day	37	55


Grid Impacts

Coincident Peak (MW)	0.23
Coincident Peak Date	Aug 5, 6pm
Annual Sales (MWh)	2,923
MDV Annual Peak (MW)	0.81
MDV Annual Peak Date	Jan 4, 1am

Takeaways

- Low adoption of MDVs in 2030 will lead to negligible grid impact from a transmission-level perspective
- Managed charging will lower evening peak load, and distribute to 12am – 2am

2030 Weekday Profile (kW / vehicle)

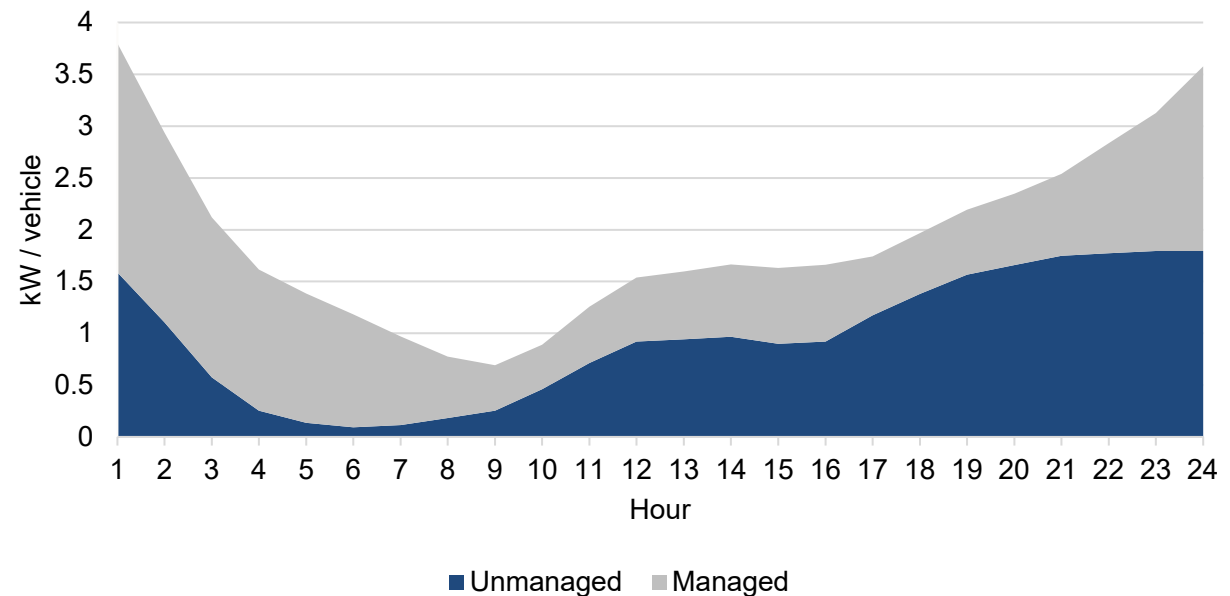

REFERENCE CASE EV MDV LOAD SHAPES: 2040 REFERENCE (90% MANAGED)

Total registered MDVs: 8,563

EV Type	Fleet / Delivery	Transit
Count	8,939	170
kWh / mi	1.05	0.73
VMT / day	37	55


Grid Impacts

Coincident Peak (MW)	7.38
Coincident Peak Date	Aug 5, 6pm
Annual Sales (MWh)	130,000
MDV Annual Peak (MW)	40.6
MDV Annual Peak Date	Jan 4, 1am

Takeaways

- Growth in managed charging behavior as commercial customers adopt time-shifting techniques and concentrate almost 50% of daily charging demand between 10pm – 5am
- High growth of fleet vehicles will drive majority of MDV load impacts, with coincident peak impacts estimated around 7 MW

2040 Weekday Profile (MW)

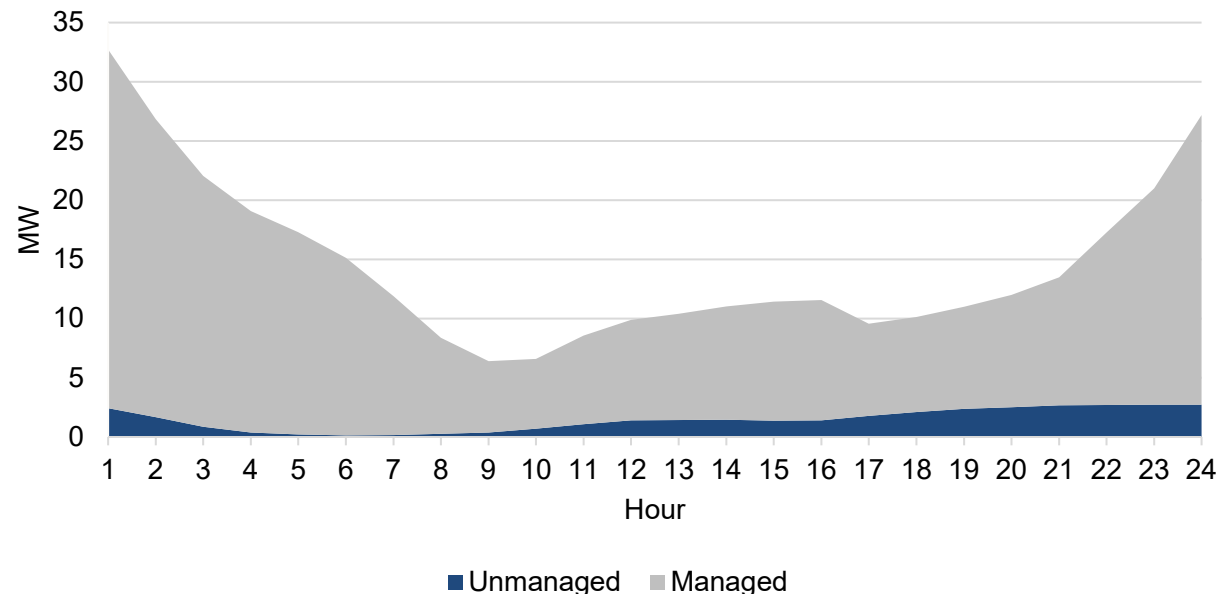

EV POLICY INCENTIVES, TARGETS, AND FEES WILL IMPACT EV ADOPTION RATES IN INDIANA

	Federal	Indiana State & Utilities
EV Tax Credits	<ul style="list-style-type: none">Up to \$7,500 tax credit for new EV and PHEV vehiclesUp to \$4,000 or 30% of the price¹ on used EV and PHEVs	<ul style="list-style-type: none">Indiana does not have tax credits for new or used EVs
EV Charger Tax Credits	<ul style="list-style-type: none">30% of the cost of hardware and installation, up to \$1,000, through 2032 (applies to residential and commercial)	<ul style="list-style-type: none">Various utilities have TOU rates and charging station rebates for LDVs and MDVs but there is no centralized state program
Targets	<ul style="list-style-type: none">EVs to be 50% of all vehicle sales by 2030	<ul style="list-style-type: none">Indiana does not have electric vehicle targets
Other		<ul style="list-style-type: none">In 2024, EVs and PHEVs will be subject to an additional annual registration fee of \$221 and \$74², respectively. After 2024, fees will be indexed to inflation.


¹ Used tax credit is for whichever amount is less
² Source: https://www.in.gov/bmv/files/Fee_Chart.pdf

BLOOMBERG NEW ENERGY FINANCE (BNEF) EXPECTS RAPID EV ADOPTION IN THE NEXT 3 YEARS

Overview

- BNEF assumes U.S. EV share of LDV sales to reach nearly 30% by 2026
- The EV share of global new passenger vehicle sales jumps from 14% in 2022 to 30% in 2026.
- In the US, the Inflation Reduction Act causes EVs make up nearly 28% of passenger vehicle sales by 2026, up from 7.6% in 2022.

Figure 1: Global near-term passenger EV sales and share of new passenger vehicle sales by market

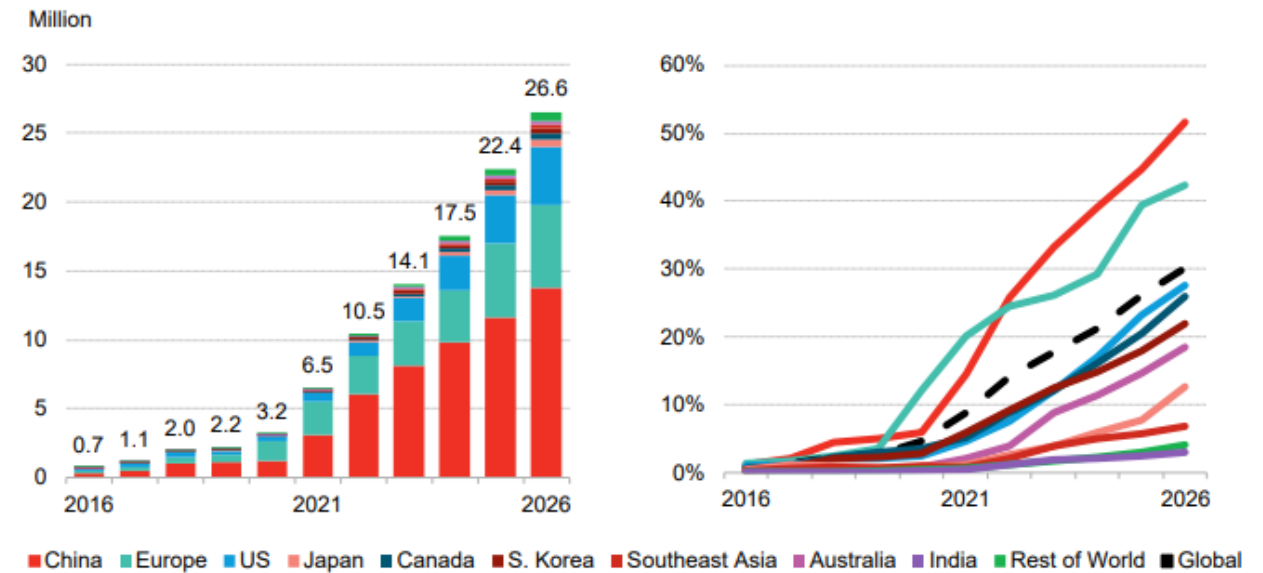

Source: BloombergNEF. Note: Europe includes the EU, the UK and EFTA countries. EV includes BEVs and PHEVs.

Source: BNEF, [Electric Vehicle Outlook 2023, Exec Summary](#) (2023)



We exist to deliver safe, reliable energy that drives value to our customers

JD POWER EXPECTS EV ADOPTION TO GROW DISPARATELY ACROSS THE STATES BUT TO REACH 70% BY 2035 AT A NATIONAL LEVEL

Overview

- A JD Power September 2023 report shows that nationwide, electric vehicle (EV) adoption is up 1 index point through the first half of 2023 vs. the same period a year ago
 - At the state level, however, a stark division is emerging between the **top 10 states** for EV adoption, where **EV adoption rates are growing steadily**, and the **bottom 10 states** for EV adoption, where **year-over-year average adoption rates are declining**
- They forecast that through 2035, state EV adoption will grow increasingly divided
- At a national level, JD Power estimates 70% EV market share by 2035

Source: JD Power, [America Grows Increasingly Divided on EV Adoption](#) (Sept 2023)

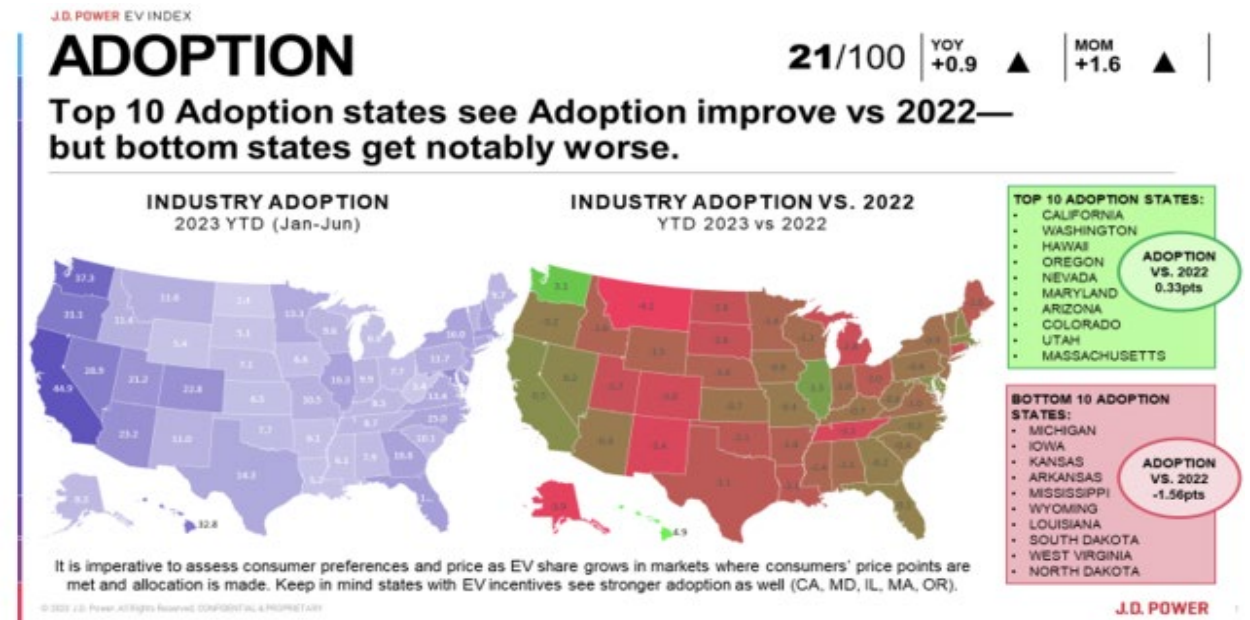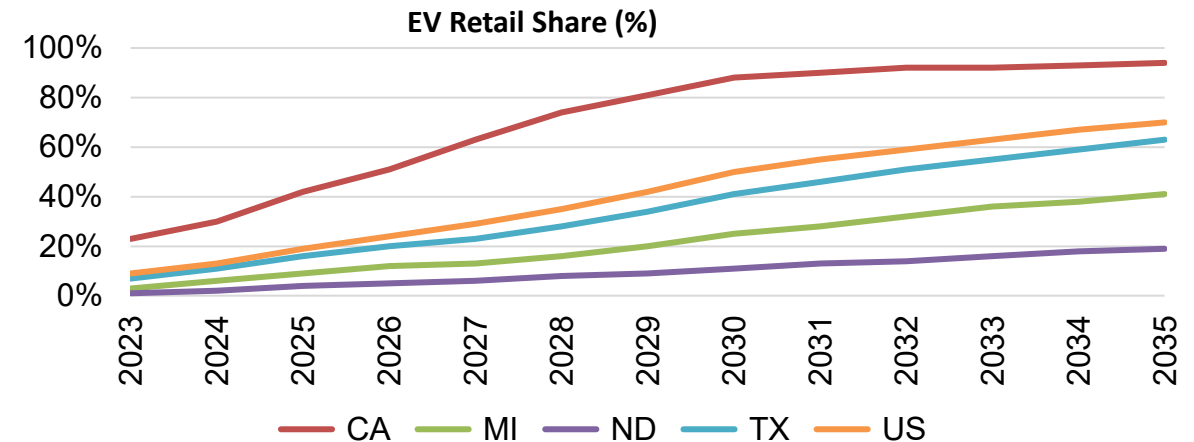


We exist to deliver safe, reliable energy that drives value to our customers

EV: DATA ASSUMPTIONS – VEHICLE TRAVELING DISTANCE

Average daily miles traveled per vehicle: 43 miles

- [Bureau of Transportation Statistics data](#) from 2009 shows Indiana vehicle trips ranged from 32 – 55 miles per day, varying by urban / suburban / rural distinction, 43 miles per day used as midpoint
- No change forecasted in average vehicle miles traveled between 2024 and 2040

EV Penetration by zip code (registered in NIPSCO county)

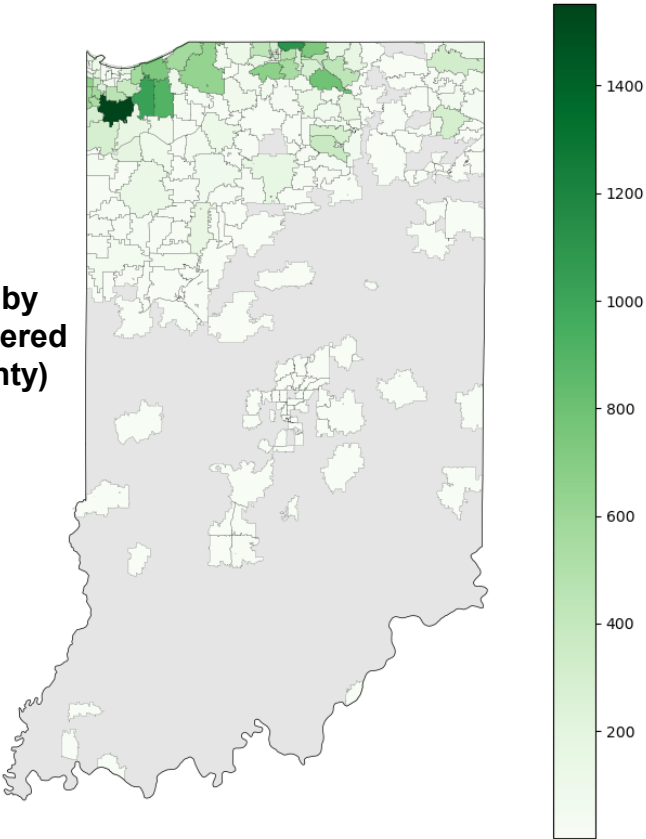


State	Mean Census Tract estimate by urban group					
	Vehicle miles traveled			Vehicle trips		
	Urban	Suburban	Rural	Urban	Suburban	Rural
Indiana	32.89	42.99	55.36	4.99	5.60	5.78

EV: DATA ASSUMPTIONS – TEMPERATURE

Temperature: Variable

- Average temperature data taken from Michigan City weather station
- EVI Pro-Lite takes in increments of 10 degrees Celsius, so it is not essential to perfect this data point, but rather use it to shape seasonal trends

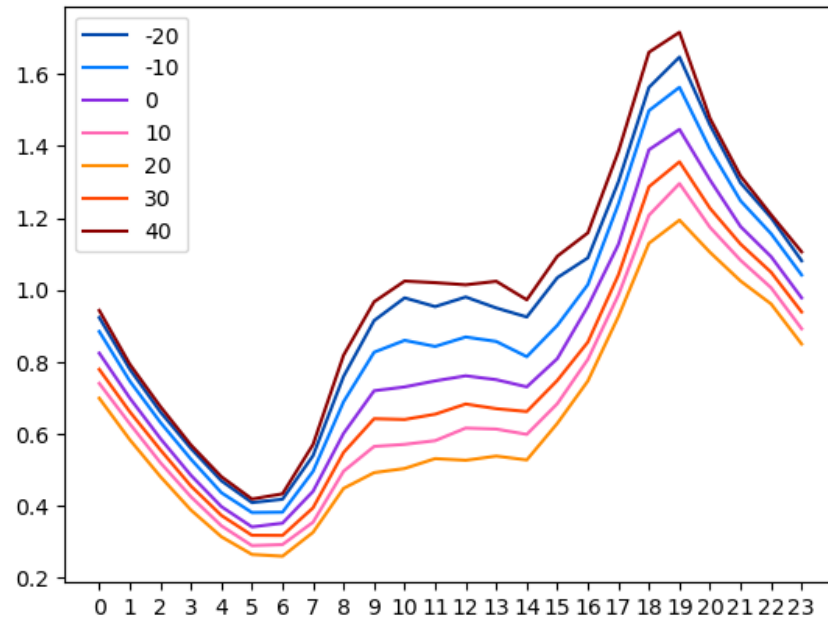

EV shape can vary substantially by temperature, with lowest load in 20 degree Celsius weather.

Given 10 deg C granularity of model, changes in climate patterns **do not** currently appear to have a major impact on long-term EV load